



See V1K Installation Guide For Terminal Wire Size And Torque Information.

Note: Maintain Clearance of 3 Inches on All Sides To Other Equipment.


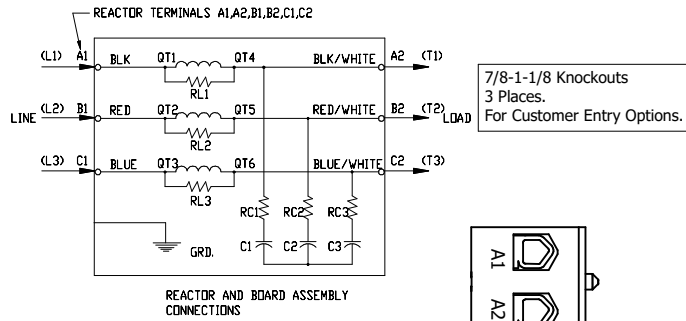


REACTOR AND BOARD ASSEMBLY CONNECTIONS

(Customer Connections) Markings On Terminal Block For Reference Only.



Back Of V1K Mounted Against Wall

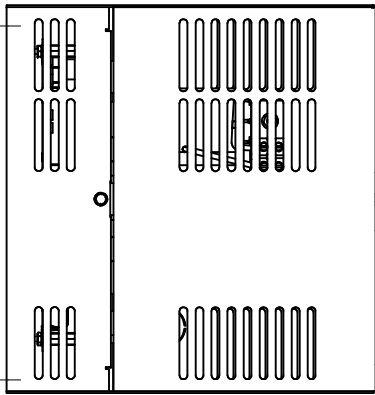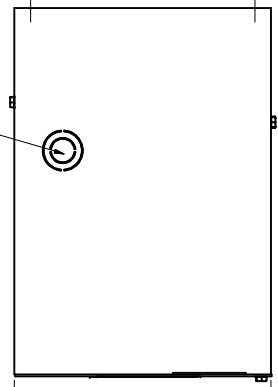


Front Of V1k With Cover.

Product Label.


Information Label.

Mounting Orientation-Up

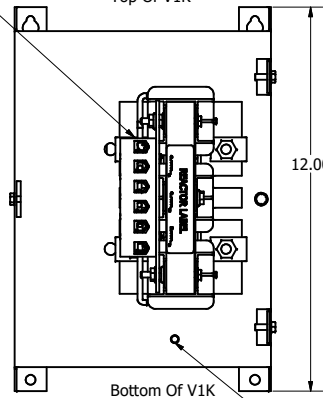


(0.25-20 Ground Stud)

Knockout

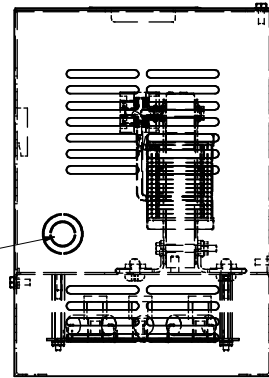


V1K Part Number	Max Voltage	Amps	Phase	Weight (LBS)
V1K35A01	600	35	3	23
V1K35A01EX	600	35	3	23
V1K45A01	600	45	3	23
V1K45A01EX	600	45	3	23
V1K55A01	600	55	3	23
V1K55A01EX	600	55	3	23

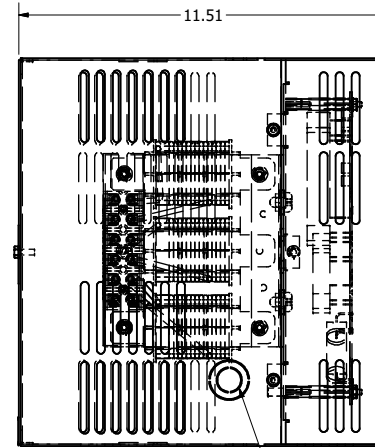

Knockout

0.31 Dia Holes 4 Places.

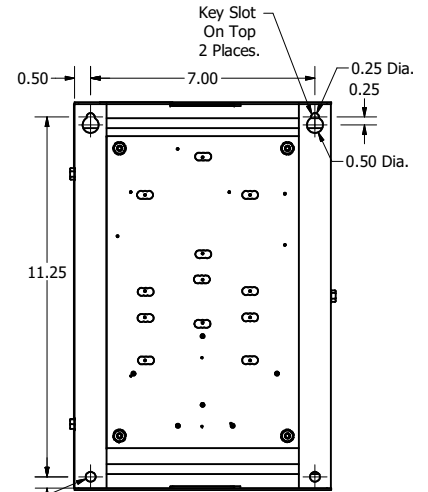

Metal Plate Provided To Mount The V1K On A Composite Surface.

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.
Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY	ANGULAR
G	4658 Rated To Max Voltage	03/04/19	JRN	FRACTIONAL
F	4030, Combine V1K Drawings	6/23/17	DSW	± 1/16
NO	REVISION	DATE	BY	± 1°

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .25
.XXX ± .10
FRACTIONAL
± 1/16
ANGULAR
± 1°

TCI W132 N10611 Grant Drive
Germantown, WI 53022

V1K, Enclosed, TYPE 1
35 Amps to 55 Amps

OWN BY: DSW DATE: 4/26/17
SCALE: TO FIT DRAWN BY: CFC
102403DG
SHT 1 OF 1