

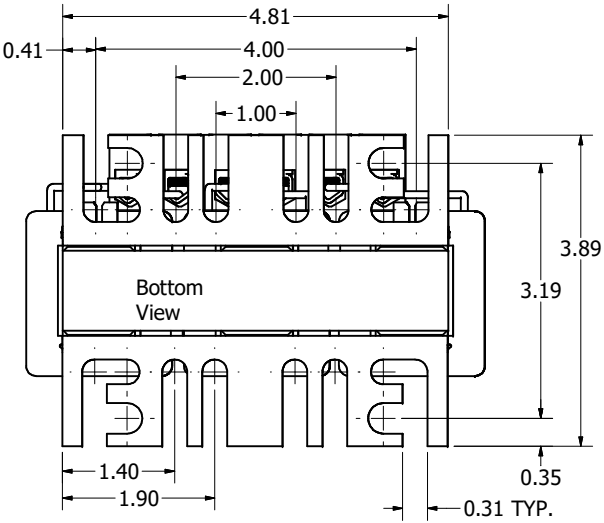
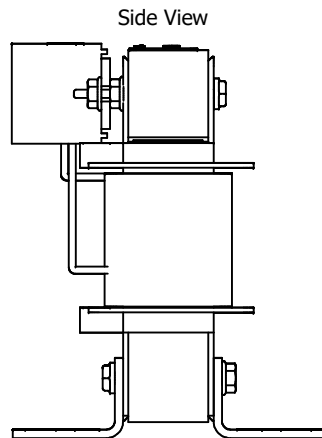


(Customer Connections) Markings On Terminal Block For Reference Only. Wire Range: 4-18 AWG. Torque : 20 IN-LBS (2.3 Nm)

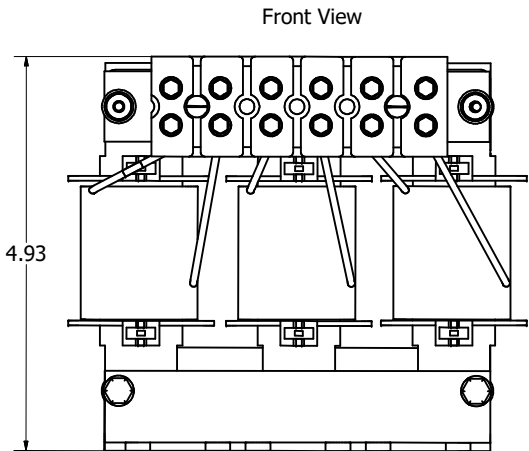

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)
KDRB42H	7 1/2	9	10	5370	61	8
KDRB43H	10	11	11	4340	70	8
KDRB44H	15	17	18.5	2630	73	8

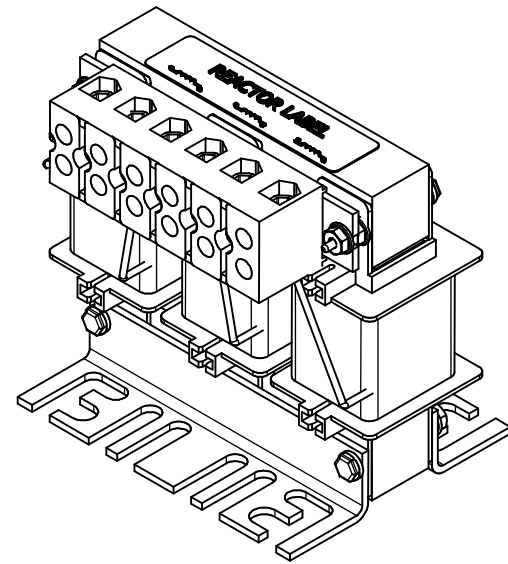


TCL (800) 824-8282 transcoil.com

KDRUL Drive Reactor
 KDR Motor Amps ---
 3PH, 50/60Hz, ---V Rated, 600V Max, -A Max, Rat18
 40C Amp Max, 138C Rise
 Manual #30895

UL cULus Listed File E116124
 CE

DATE CODE A1 A2 B1 B2 C1 C2

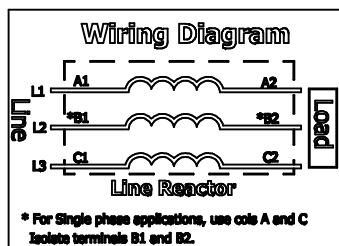

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. KDR IOM Manual Part Number 30895
 4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	± 1"
----	----------	------	----	------

TOLERANCES (EXCEPT AS NOTED)
 DECIMAL
 .XX ± .25
 .XXX ± .10
 FRACTIONAL
 ± 1/16
 ANGULAR
 ± 1°

TCL W132N10611 (Rev 13 Feb 2024)
 Germantown, WI 53022
 © 2024 TCL, LLC
 An Official Motion Company
 KDR B Frame, Terminal Block
 Reactor Drawing

DRN BY: DSW DATE: 1/22/2018 107511-3DG
 SCALE: 1:1.2 DRAWN: DSW

SHT 1 OF 1