



Wire Range: 4-18 AWG.  
 Torque : 20 IN-LBS (2.3 Nm)

(Customer Connections)  
 Markings On Terminal Block  
 For Reference Only.

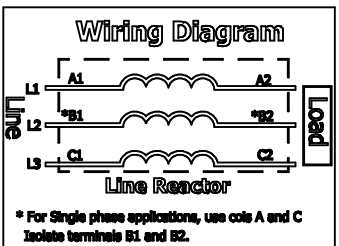

208/240 Rated Voltage, 600 Max Voltage, High Z, Impedance.					
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)
KDRC22H	20	59.4	62	278	15

575 Rated Voltage, 600 Max Voltage, Output					
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)
KDRC31P	50	52	55	237	15

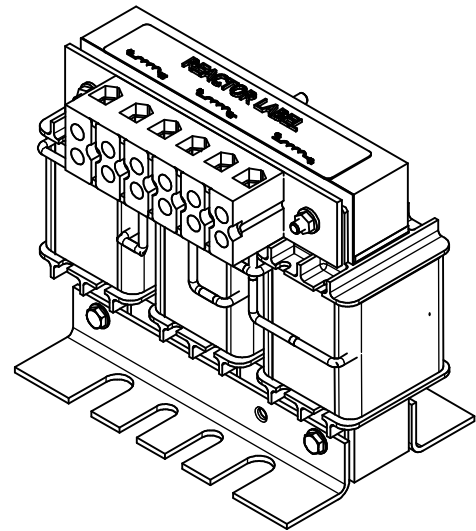

**TCI** (900) 824-8282 transcoil.com  
 TCI, LLC  
 Germantown, WI, USA.  
 transcoil.com  
 800-824-8282

KDRUL Drive Reactor  
 KDR- Motor Amps ---  
 3PH, 50/60Hz, ---V Rated, 600V Max, -A Max, RoHS  
 40C Amb Max, 136C Rise  
 Manual #30895

UL LISTED CE  
 200-0000-10-0000

DATE CODE A1 A2 B1 B2 C1 C2

Notes:

- UL file number: cULus Listed File E116124.
- KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
- KDR IOM Manual Part Number 30895
- NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
- Material(s) Shall be RoHS Compliant
- Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		TCI An Official Motors Company KDR C Frame Terminal Block Reactor Drawing	
NO	REVISION	DATE	BY	SCALE	DATE	DRW BY	FILE
F	6812, Match Revisions	9/24/2024	DSW	DECIMAL .XX ± .25 .XXX ± .10		107512-1DG	
B	4686, TB SCREWS Updated	5/9/2019	DSW	FRACTIONAL ± 1/16			
A	Combined Drawings	1/22/2019	DSW	ANGULAR ± 1°			
NO							

W132N10611 (Rev 13Feb)  
 Germantown, WI 53022  
 © 2024 TCI, LLC

SCALE: 1:1.5