
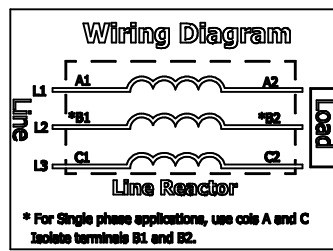
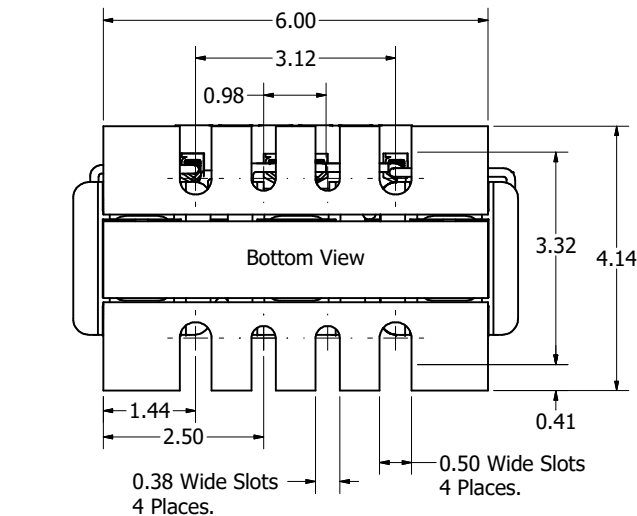
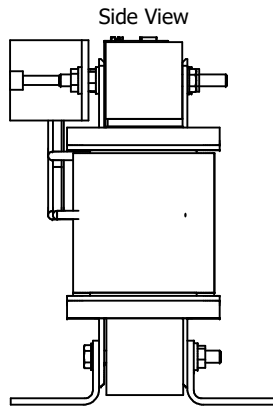



(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 4-18 AWG.
Torque : 20 IN-LBS (2.3 Nm)

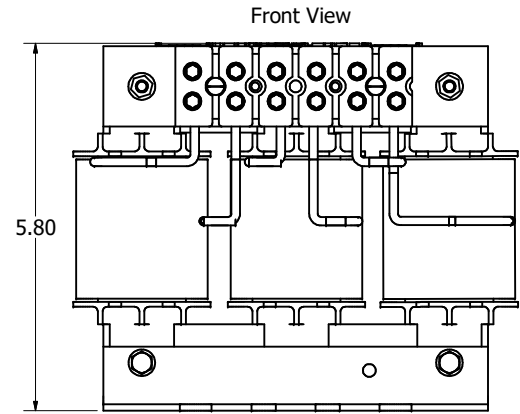

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.					
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)
KDRC43H	25	27	30	1670	15

480 Rated Voltage, 600 Max Voltage, Output					
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)
KDRC1P	40	52	55	246	15

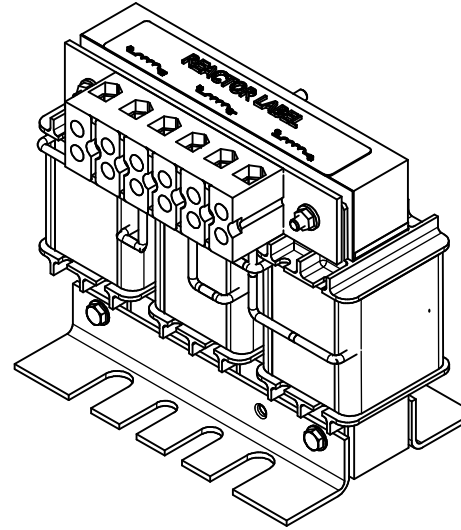

TCI (900) 824-8282 transcoil.com
 TCI, LLC Germanstown, WI USA. transcoil.com 800-824-8282
 KDRUL Drive Reactor Motor Amps ---
 3PH, 50/60Hz, ---V Rated, 600V Max, ---A Max, RoHS
 40C Amb Max, 135C Rise Manual #30895
 UL LISTED CE
 200-0000-10, 2000
 DATE CODE A1 A2 B1 B2 C1 C2

Notes:

- UL file number: cULus Listed File E116124.
- KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
- KDR IOM Manual Part Number 30895
- NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
- Material(s) Shall be RoHS Compliant
- Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
.XX	± .25		
.XXX	± .10		
FRACTIONAL			
	± 1/16		
ANGULAR			
	± 1°		
REV	6812, Match Revisions	DATE	9/25/2024
BY	DSW	DATE	9/25/24
NO	REVISION	DATE	BY

TCI W132N10611 (Rev 1) 15Feb
 Germanstown, WI 53022
 © 2024 TCI, LLC
 An Official Motors Company
 KDR C Frame, Terminal Block
 Reactor Drawing
 DWN BY: DSW DATE: 9/25/24 107512-6DG
 SCALE: 1:1.5 DRAWN BY: DSW
 SHEET 1 OF 1