
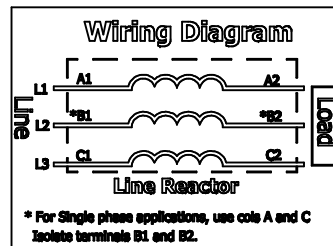
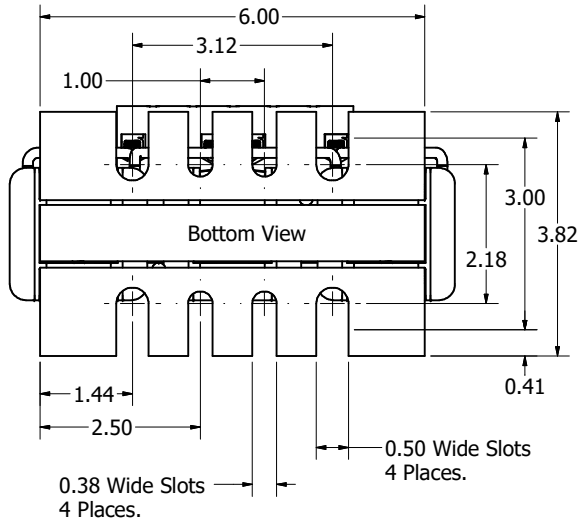
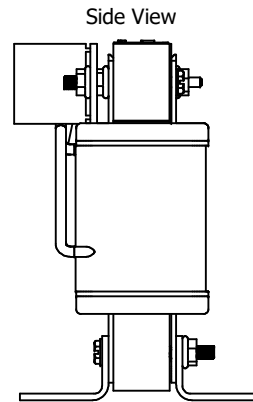
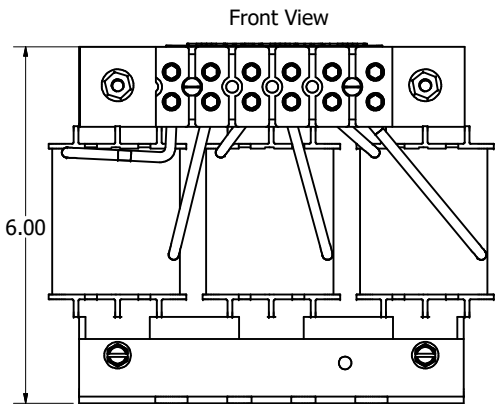


(Customer Connections)
Markings On Terminal Block
For Reference Only.

Wire Range: 4-18 AWG.
Torque : 20 IN-LBS (2.3 Nm)

208/240 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)
KDRULD21H	10	30.8	31	554	92	12
KDRULD22H	15	46.2	47	375	108	12

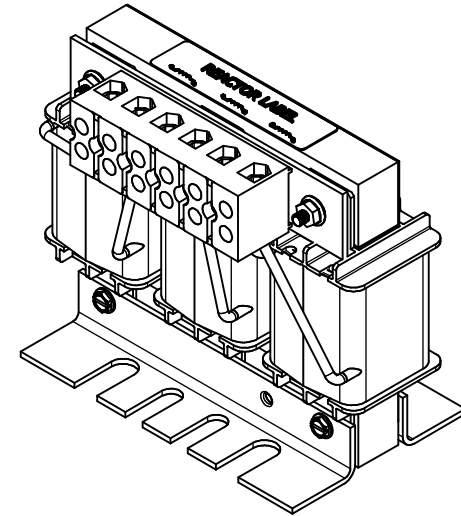

TCL (800) 824-8282 transcoil.com

TCL, LLC
Greenwood, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR— Motor Amps —
30% 20/40Hz, —1 Rated, 600V Max, —A Max, RoHS
40C Amb Max, 135C Rise
Manual #30895

UL LISTED CE
200-0000-10-1000

DATE CODE

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	SCALE
A	6688, 107513-2 to 107513-10	6/17/2024	DSW	1/11.5

TCL W132N10611 (Rev 13 Feb 2024)
Greenwood, WI 53022
© 2024 TCL, LLC
An Allied Motion Company

KDRUL D Frame, Terminal Block
Reactor Drawing

DRN BY: DSW DATE: 6/17/2024 FILE: 107513-10DG
SCALE: 1/11.5 DRAWN BY: DSW

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .25
.XXX ± .10
FRACTIONAL
± 1/16
ANGULAR
± 1°

SHT 1 OF 1