

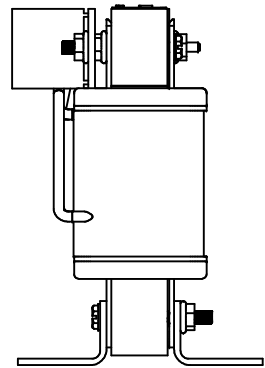


Wire Range: 4-18 AWG.
Torque : 20 IN-LBS (2.3 Nm)

(Customer Connections)
Markings On Terminal Block
For Reference Only.

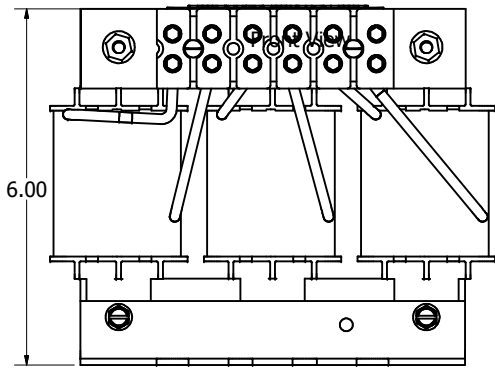


Side Views

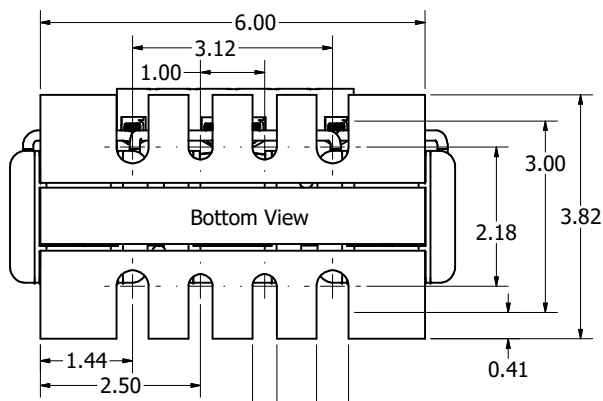


0.38 Wide Slots
4 Places.

0.50 Wide Slots
4 Places.

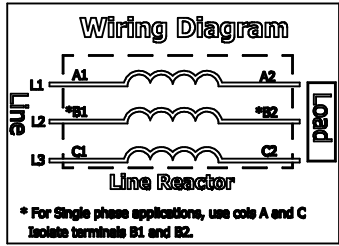

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.						
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)
KDRULD42L	30	32	32	853	106	12

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.						
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)
KDRULD41H	20	22	23	2070	105	12

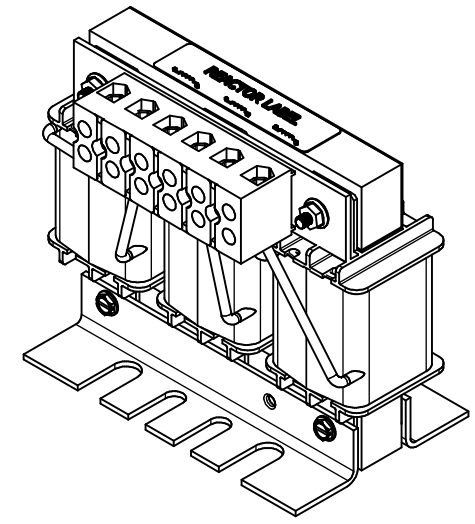

TCL (800) 824-8282 transcoil.com

TCL, LLC
Germantown, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR — Motor Amps —
30/1, 30/40/12, —1 Rated, 600V Max, —A Max, RoHS
40C Amb Max, 135C Rise
Manual #30895

UL LISTED CE
200-0000, 10, 1000

DATE CODE

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. KDR IOM Manual Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		 W132N10611 (Rev 13 Feb) Germantown, WI 53022 © 2024 TCL, LLC An <i>Official Motors Company</i> KDRUL D Frame, Terminal Block Reactor Drawing DWN BY: DSW DATE: 6/17/2024 107513-11DG SCALE: 1/11.5 DRAWN BY: JSC SHEET 1 OF 1	
NO	REVISION	DATE	BY	NO	DATE	BY	NO