
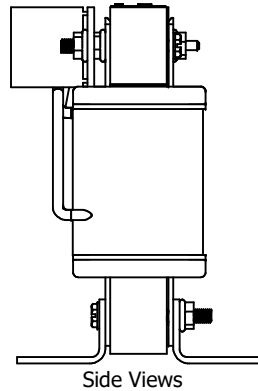





(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 4-18 AWG.  
Torque : 20 IN-LBS (2.3 Nm)

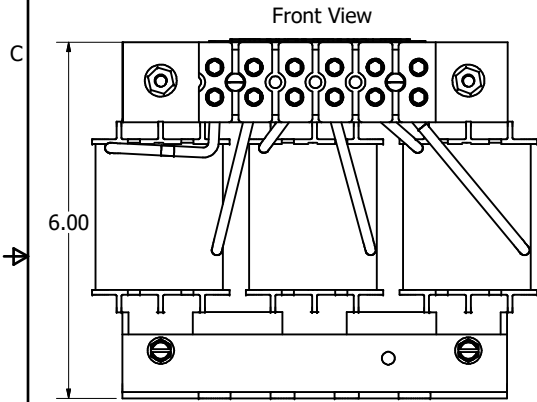

480 Rated Voltage, 600 Max Voltage, Output

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)
KDRULD1P	15	21	21	548	30	10
KDRULD2P	20	27	27	444	43	10
KDRULD3P	25	35	35	305	55	12
KDRULD4P	30	45	45	262	59	12

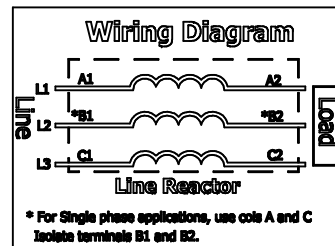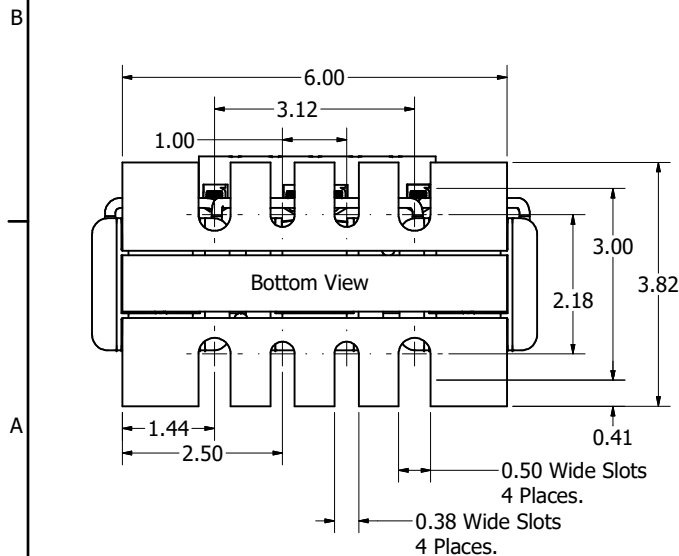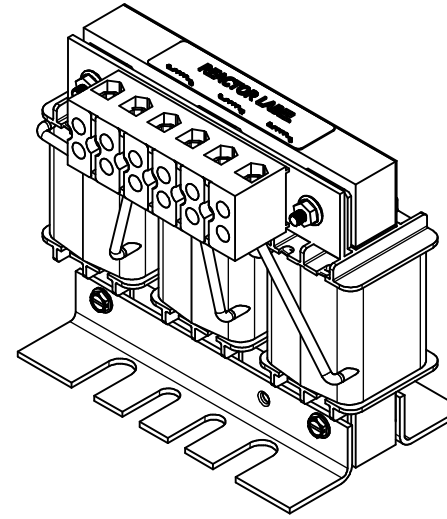

**TCL** (800) 824-8282 [transcoil.com](http://transcoil.com)

TCL, LLC  
Germanstown, WI, USA  
[transcoil.com](http://transcoil.com)  
800-824-8282

KDRUL Drive Reactor  
KDR- Motor Amps —  
3PH, 20/60Hz, —V Rated, 600V Max, —A Max, RoHS  
40C Amb Max, 150C Rise  
Manual #30895

UL LISTED  
cULus Listed  
E116124

DATE CODE

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		W132N10611 (Rev 13 Feb 2024) Germanstown, WI 53022 © 2024 TCL, LLC	
				DECIMAL		KDRUL D Frame, Terminal Block	
				.XX ± .25		Reactor Drawing	
				.XXX ± .10		DRN BY: DSW DATE: 6/17/2024 SCALE: 1/11.5 DRAWN: CSE	
				FRACTIONAL		107513-12DG	
				± 1/16		SHT 1 OF 1	
				ANGULAR			
				± 1°			
NO REVISION		DATE		BY			