

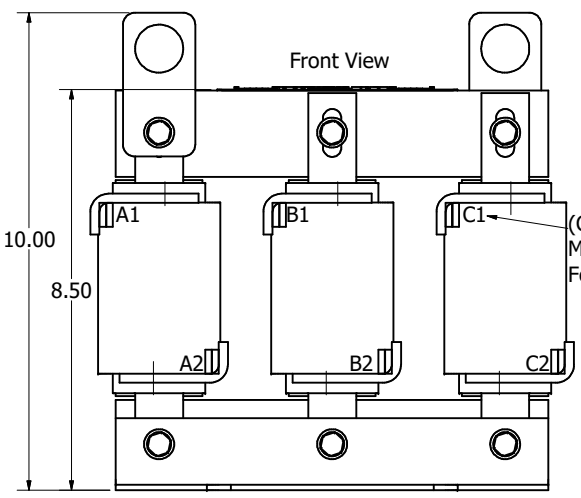
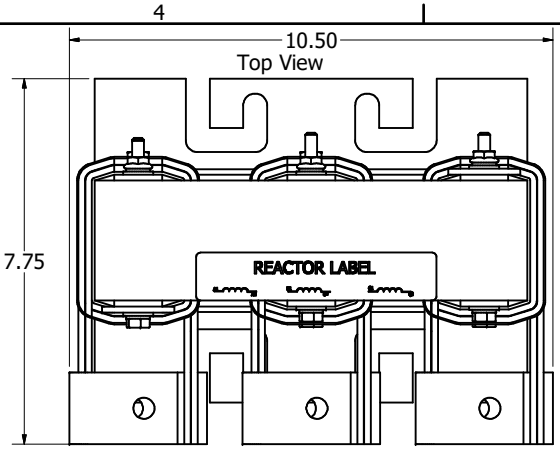
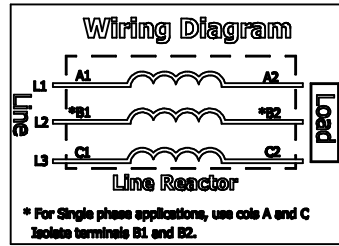
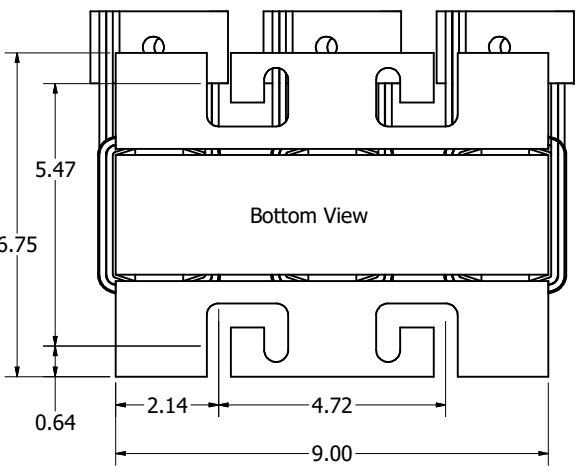


480 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG1P	200	240	250	41.3	161	60	SLK12	0.44

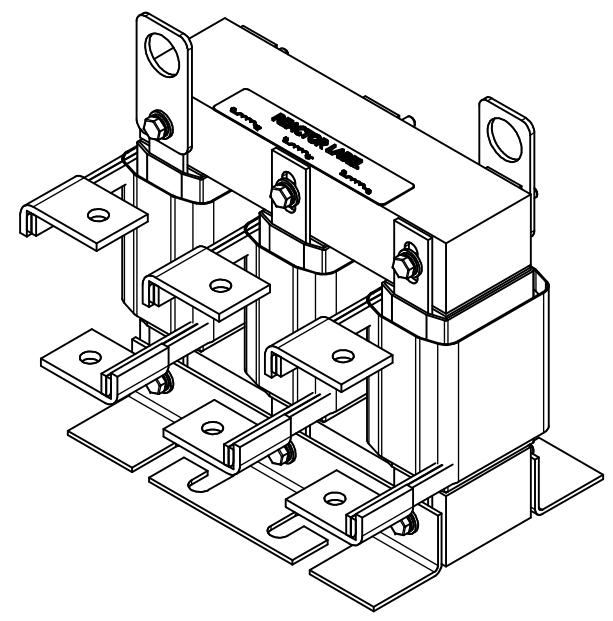

(Customer Connections) Markings On Coils For Reference Only.

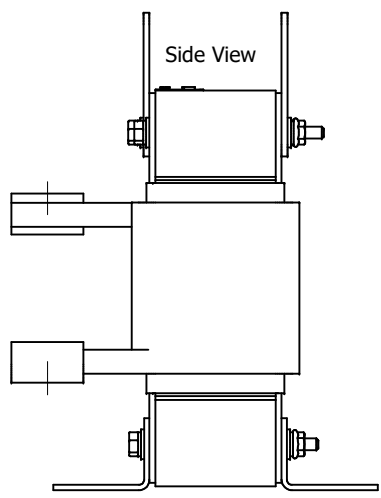

TCl (800) 824-8282 transcoll.com

TCl, LLC
Germantown, WI, USA
transcoll.com
800-824-8282

KDRUL Drive Reactor
KDR - Motor Amps -
3PH, 50/60Hz, -V Rated, 600V Max, -A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK-

UL LISTED
cULus LISTED
E116124

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCl.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev 11/16) Germantown, WI 53022 © 2024 TCl, LLC An Official Motion Systems Company KDR G Frame, Copper Bus Reactor Drawing DWG BY: DSW DATE: 6/24/2024 107533-11DG SCALE: 1/2 DRAWN: JSE SHT 1 OF 1	
A	6708, 107533-3 to 107533-11	6/24/2024	DSW						
NO	REVISION	DATE	BY						