
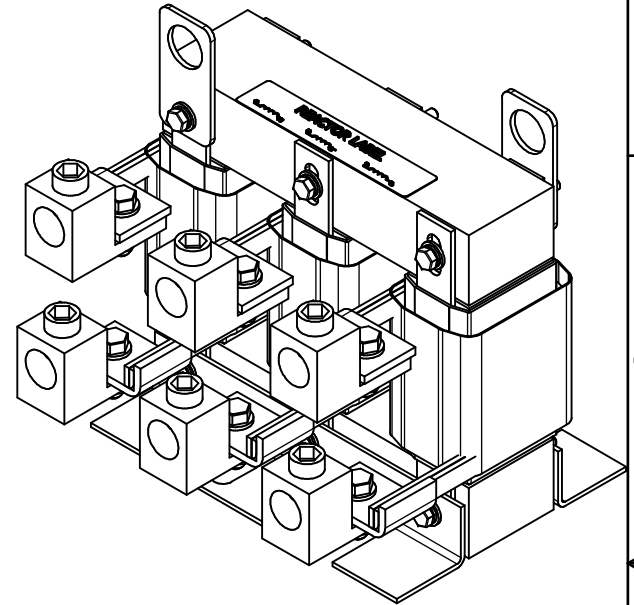


(Customer Connections) Markings On Coils For Reference Only.

480 Rated Voltage, 600 Max Voltage, Output							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULG1P	200	240	250	41.3	161	62	SLK12

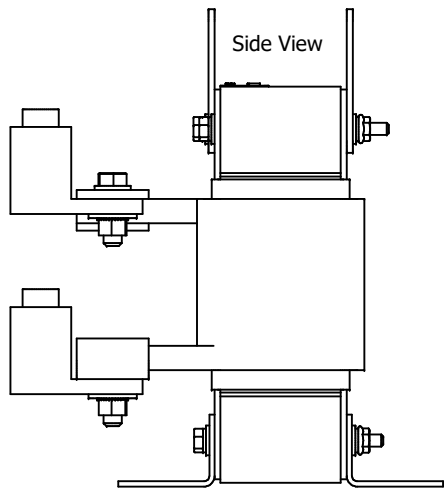

**TCL** (800) 824-8282 transcoil.com


TCL, LLC  
 Germantown, WI, USA  
 transcoil.com  
 800-824-8282

KDRUL Drive Reactor  
 KDR - Motor Amps -  
 3PH, 50/60Hz, -V Rated, 600V Max, -A Max  
 40C Amb Max, 155C Rise, RoHS  
 Manual #30895 LUG KIT #SLK-

UL LISTED CE  
 2nd ed. 10, 1996

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. UL file number: cULus Listed File E116124.
  2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. KDR IOM Manual Part Number 30895
  4. Material(s) Shall be RoHS Compliant
  5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

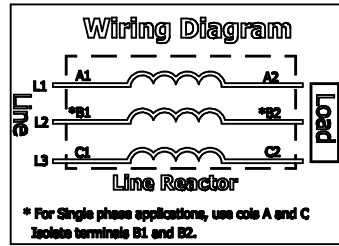

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		 W132N10611 (Rev. 11/16) Germantown, WI 53022 © 2024 TCL, LLC An Official Motors Group KDRUL G Frame, Copper Bus Reactor Drawing DES. BY: DSW DATE: 6/24/2024 107533-12DG SCALE: 1/2 DRAWN: JSE SHEET 1 OF 1	
A	6708, 107533-4 to 107533-12	6/24/2024	DSW				
NO	REVISION	DATE	BY				