

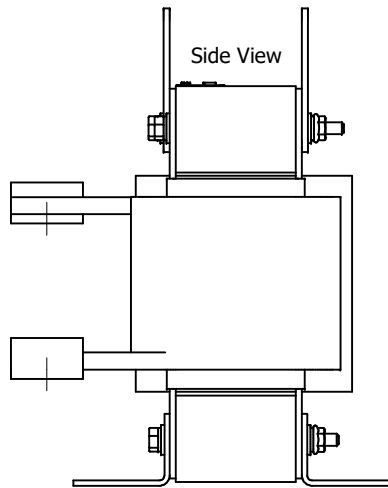
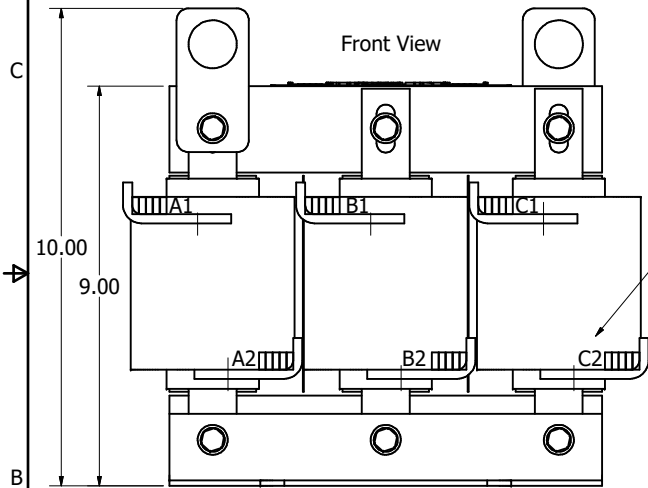
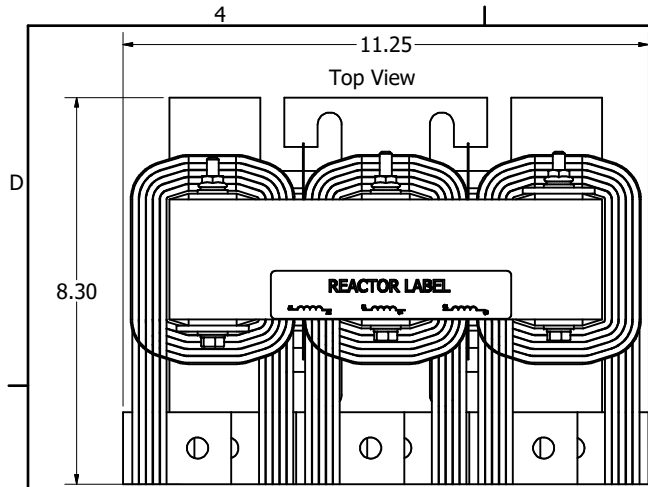


575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG45L	300	289	292	98.8	374	65	SLK12	0.44

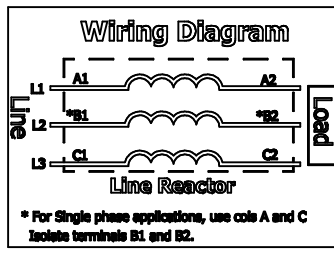

(Customer Connections) Markings On Coils For Reference Only.

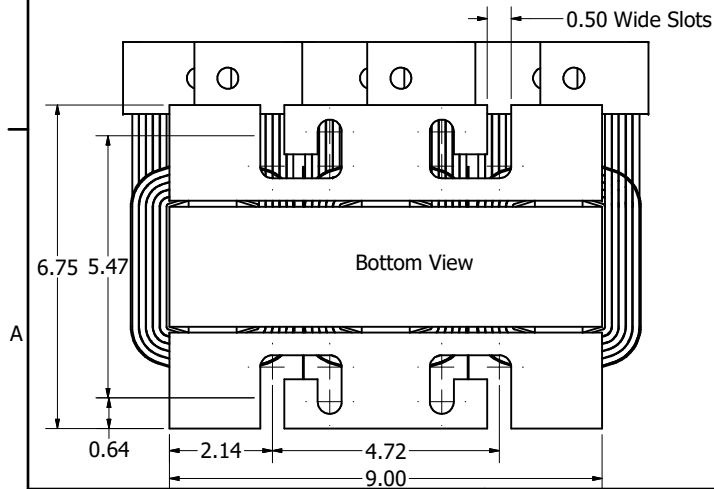

TCL (800) 824-8282 transcoil.com

TCL, LLC
Germantown, WI, USA.
transcoil.com
800-824-8282

KDR/L Drive Reactor
KDR - Motor Amps ---
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK---

UL LISTED CE
200-0207-10, 2000

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCL.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
A	107533-3 to 107533-13	6/21/2024	DSW

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .25
.XXX ± .10
FRACTIONAL
± 1/32
ANGULAR
± 1°

TCL W182N10611 (Rev 13) Feb 2024
Germantown, WI 53022
© 2024 TCL, LLC
An Official Motors Gateway
KDR G Frame, Copper Bus
Reactor Drawing

DRN BY: DSW DATE: 6/21/2024 107533-13DG
SCALE: 1/2 DRAWN BY: DSW

SHT 1 OF 1