
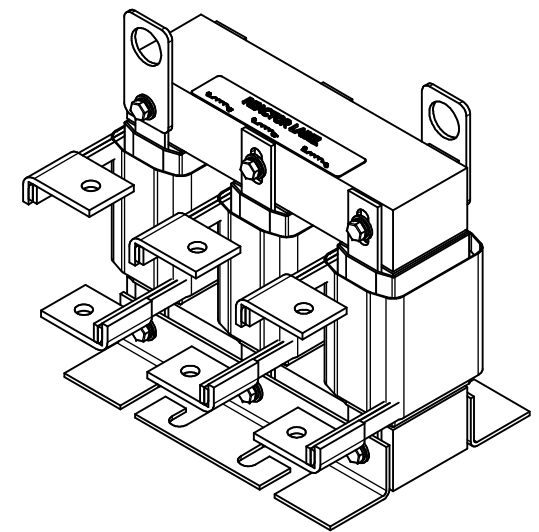


575 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG31P	250	242	250	44	161	60	SLK12	0.44

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG47L	250	242	242	108	394	65	SLK12	0.44

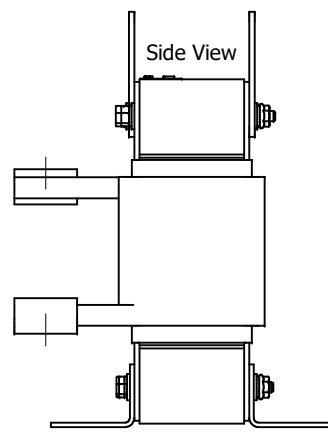

TCl (800) 824-8282 transcoll.com

TCl, LLC
 Germantown, WI, USA
 transcoll.com
 800-824-8282


KDR/L Drive Reactor
 KDR - Motor Amps -
 3PH, 50/60Hz, -V Rated, 600V Max, -A Max
 40C Amb Max, 155C Rise, RoHS
 Manual #30895 LUG KIT #SLK-

UL LISTED
 250-0000-10, 1550

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCl.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

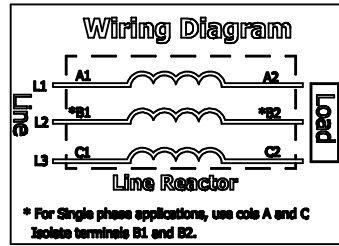

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev 13 Feb 2024) Germantown, WI 53022 © 2024 TCl, LLC An Official Motion Systems Company KDR G Frame, Copper Bus Reactor Drawing DWN BY: DSW DATE: 6/21/2024 107533-16DG SCALE: 1/2 DRAWN BY: JCE SHEET 1 OF 1	
NO	REVISION	DATE	BY	NO	DATE	BY	NO	DATE	BY