
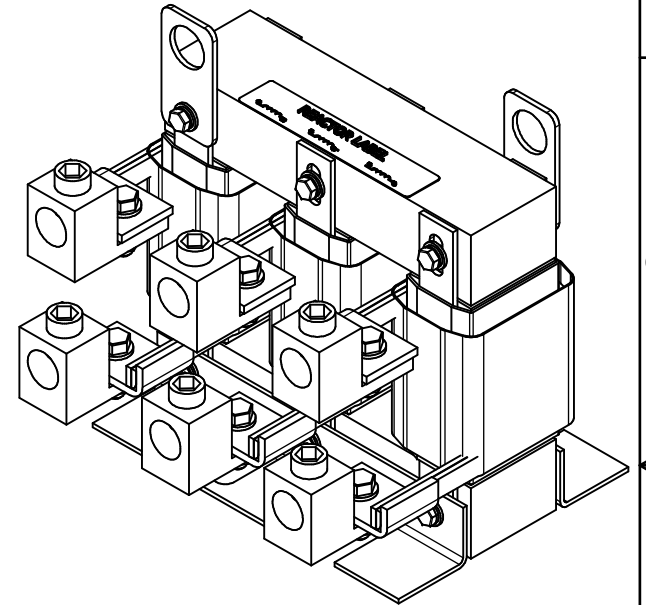


(Customer Connections)
Markings On Coils
For Reference Only.

575 Rated Voltage, 600 Max Voltage, Output							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULG31P	250	242	250	44	161	62	SLK12

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULG47L	250	242	242	108	394	67	SLK12

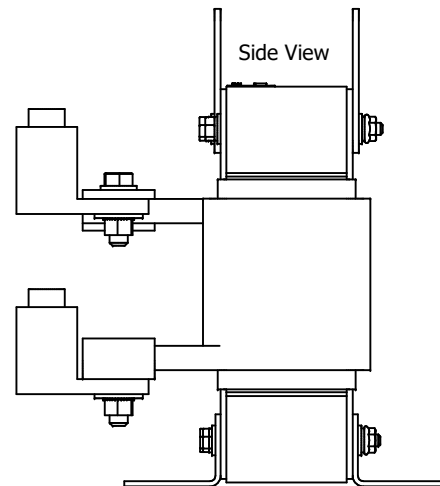

TCL (800) 824-8282 transcoil.com

TCL, LLC
Germantown, WI, USA.
transcoil.com
800-824-8282


KDRUL Drive Reactor
KDR- Motor Amps ---
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK---

UL LISTED
3rd party, 10, 1998

DATE CODE A1 A2 B1 B2 C1 C2

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

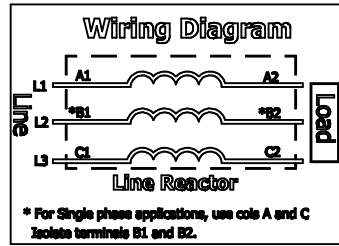

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		W132N10611 (Rev 11 Feb 2024) Germantown, WI 53022 © 2024 TCL, LLC An Official Motion Company KDRUL G Frame, Copper Bus Reactor Drawing DWG BY: DSW DATE: 6/25/2024 107533-17DG SCALE: 1/2 DRAWN BY: JSC SHEET 1 OF 1	
A	6708, 107533-4 to 107533-17	6/25/2024	DSW				
NO	REVISION	DATE	BY				