

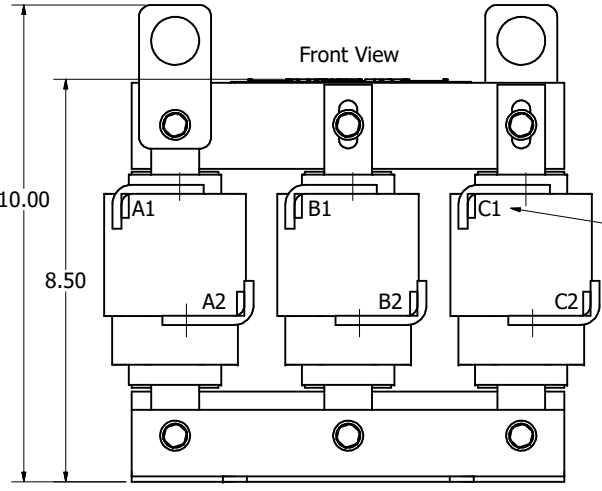
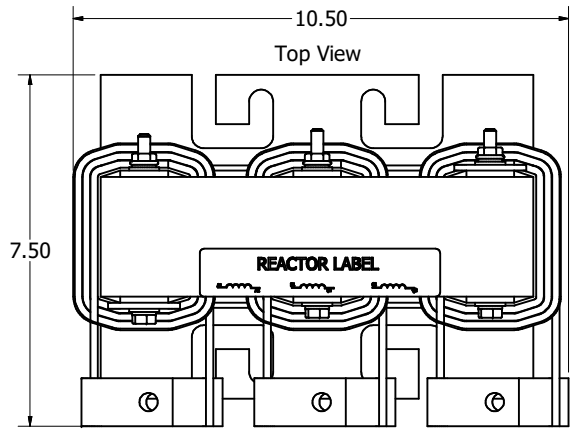
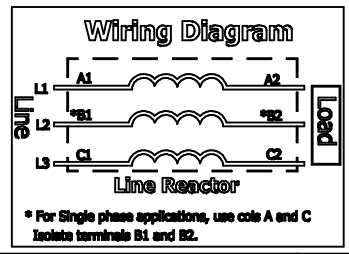
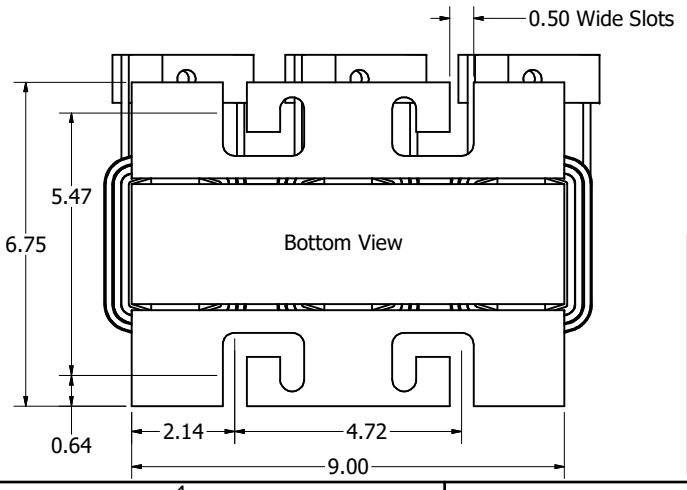


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG45H	150	144	155	326	400	65	SLK11	0.44

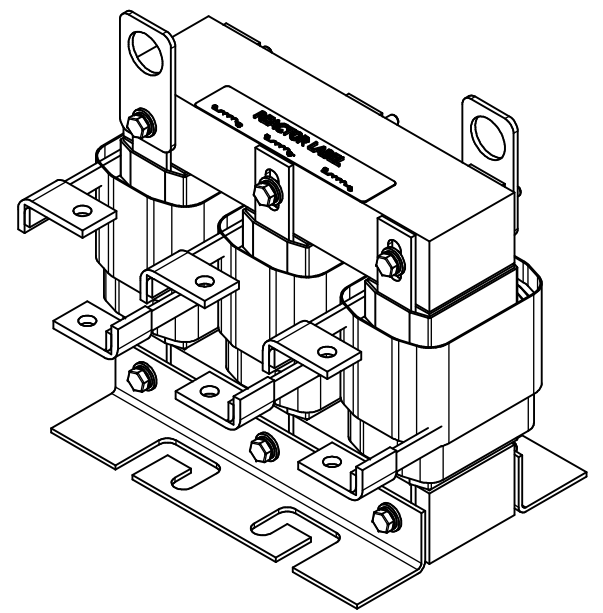

(Customer Connections) Markings On Coils For Reference Only.

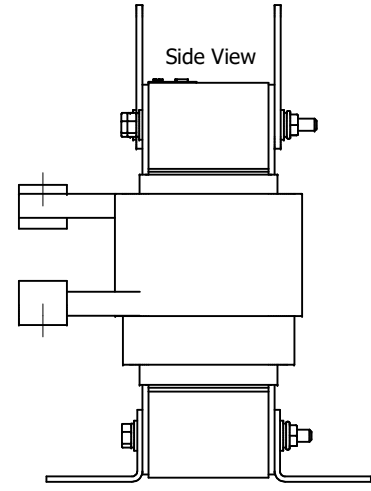

**TCI** (800) 824-8282 transcoll.com

TCI, LLC Germantown, WI, USA. transcoll.com 800-824-8282

KDRUL Drive Reactor  
KDR - Motor Amps ---  
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max  
40C Amb Max, 155C Rise, RoHS  
Manual #30895 LUG KIT #SLK---

UL LISTED CE  
cULus Listed File E116124

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
  2. UL file number: cULus Listed File E116124.
  3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  4. KDR IOM Manual Part Number 30895
  5. Material(s) Shall be RoHS Compliant
  6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		W132N10611 (Rev 13 Feb 2024) Germantown, WI 53022 © 2024 TCI, LLC An Official Motion Systems Company KDR G Frame, Copper Bus Reactor Drawing DWN BY: DSW DATE: 6/24/2024 107533-18DG SCALE: 1/2 DRAWN: JCE SHEET 1 OF 1	
A	107533-3 to 107533-18	6/24/2024	DSW				
NO	REVISION	DATE	BY				