
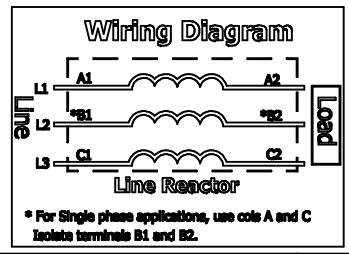


(Customer Connections) Markings On Coils For Reference Only.

480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULG3L	200	240	240	83.9	280	67	LK12

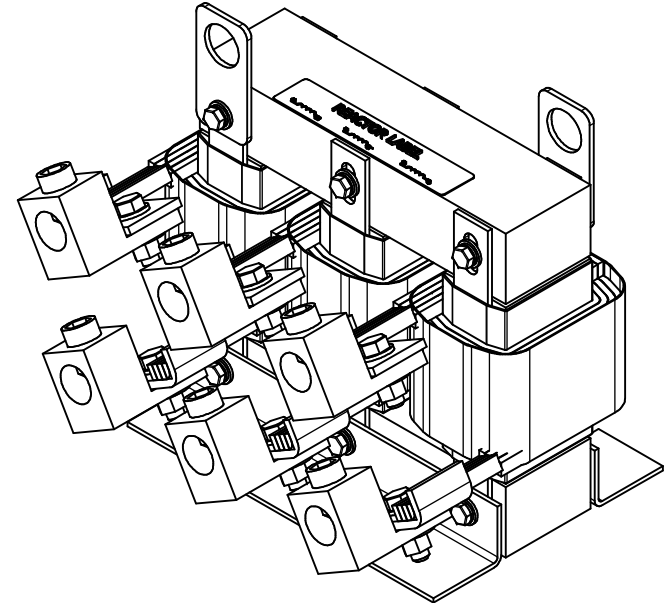

TCL (800) 824-8282 transcoil.com

TCL, LLC
 Germantown, WI, USA
 transcoil.com
 800-824-8282

KDRUL Drive Reactor
 KDR- Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max
 40C Amb Max, 155C Rise, RoHS
 Manual #30895 LUG KIT #9LK—

UL LISTED CE
 330 CON. 03, 0100

DATE CODE: A1, A2, B1, B2, C1, C2

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. KDR IOM Manual Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		W132N10611 (Rev 13 Feb 2024) Germantown, WI 53022 © 2024 TCL, LLC An Allied Motion Company KDRUL G Frame, Copper Bus Reactor Drawing DWG BY: DSW DATE: 6/24/2024 107533-21DG SCALE: 1/2 DRAWN: JSC SHEET 1 OF 1	
A	107533-4 to 107533-21	6/24/2024	DSW				
NO	REVISION	DATE	BY				