



(Customer Connections) Markings On Coils For Reference Only.

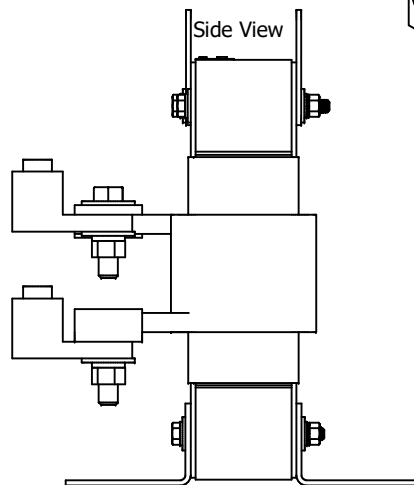

480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULL1L	450	515	575	36.3	509	115	SLK14
KDRULL2L	500	590	610	31.5	518	115	SLK14

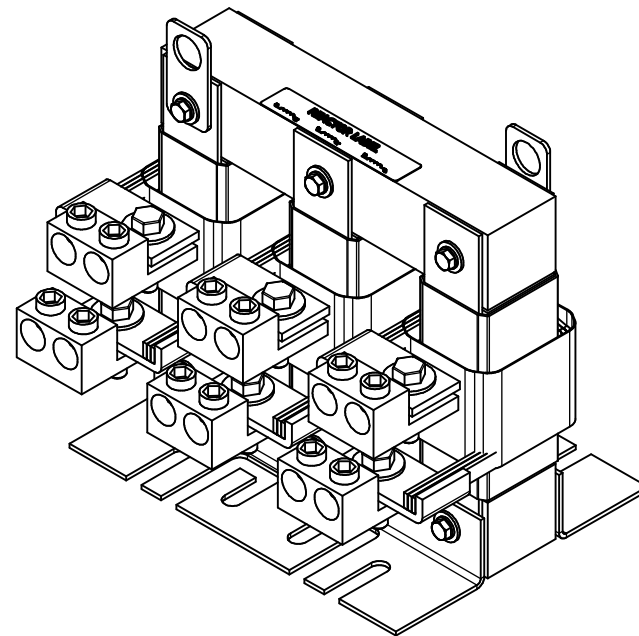

**TCS** (800) 824-8282 transcoll.com  
 TCS, LLC  
 Germantown, WI, USA  
 transcoll.com  
 800-824-8282


KDRUL Drive Reactor  
 KDR— Motor Amps —  
 3PH, 3Ø/60Hz, —V Rated, 600V Max, —A Max  
 40C Amb Max, 1SEC Rise, RoHS  
 Manual #30895 LUG KIT #SLK—

UL LISTED CE  
 2020 cULus 140 2014

DATE CODE A1 B1 C1

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

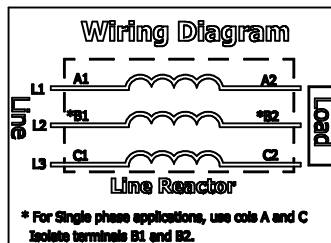

TOLERANCES (EXCEPT AS NOTED)	THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALIENT INC. AND ITS SUBSIDIARIES.	DESIGNED BY: DSW	DATE: 6/25/2024	SCALE: 1/3.2	SIZE: C	REVISED BY: NO	DATE: 6/25/2024	BY: DSW	NO.	REVISION	DATE	BY	SCALE	107537-14DG	SIZE	SHT. 1 OF 1
------------------------------	--	------------------	-----------------	--------------	---------	----------------	-----------------	---------	-----	----------	------	----	-------	-------------	------	-------------

**Allient Power**  
 W132N10611 Grant Drive  
 Germantown, WI 53022  
 © 2024 Allient Inc.

KDRUL L Frame, Copper Bus