

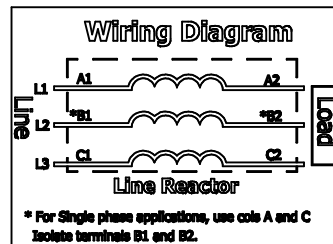


(Customer Connections)
Markings On Coils
For Reference Only.

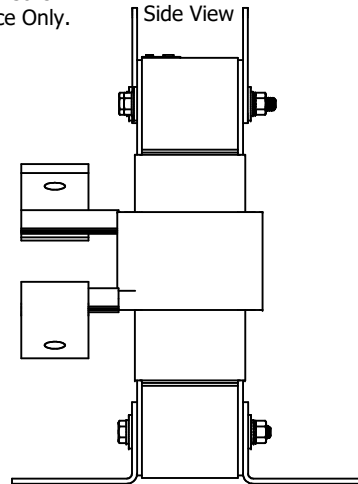

480 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL1P	350	414	420	26.4	275	85	SLK13	0.53

575 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL31P	400	382	420	26.5	420	85	SLK13	0.53
KDRL35P	450	412	420	26.4	420	85	SLK13	0.53

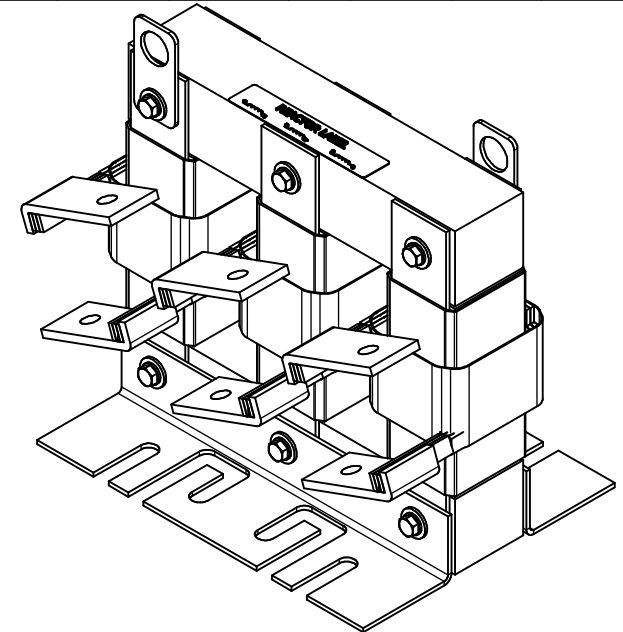

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germanstown, WI, USA
transcoil.com
800-824-8282

KDRL Drive Reactor
KDR - Motor Amps -
3PH, 30/40/50, -1/1 Rated, 600V Max, -A Max
400 Amp Max, 1.525 Max, Rating
Manual #30895 LUG KIT #SLK-

UL LISTED
200 CONV. EQ. 5000

CE

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL	.XX ± .25	.XXX ± .10	
FRACTIONAL	± 1/32		
ANGULAR	± 1°		

TCI W132N10611 (Rev. 11/16)
Germanstown, WI 53022
© 2024 TCI, LLC
An Official Motors Company
KDR L Frame, Copper Bus
Reactor Drawing

DESIGNED BY	DSW	DATE	7/2/2024	DWG NO.	107537-17DG
SCALE	1/3.2	REVISED BY		SIZE	

SHT 1 OF 1