

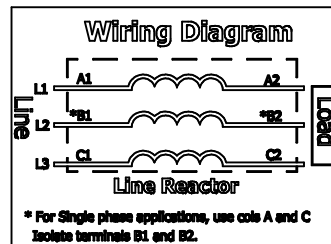
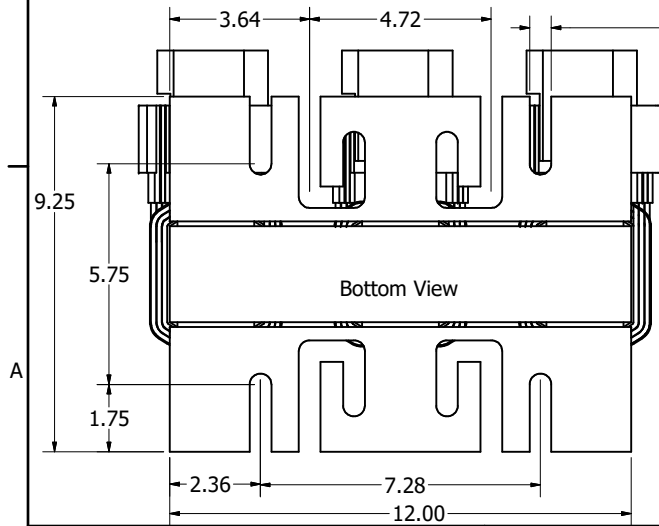


(Customer Connections)
Markings On Coils
For Reference Only.

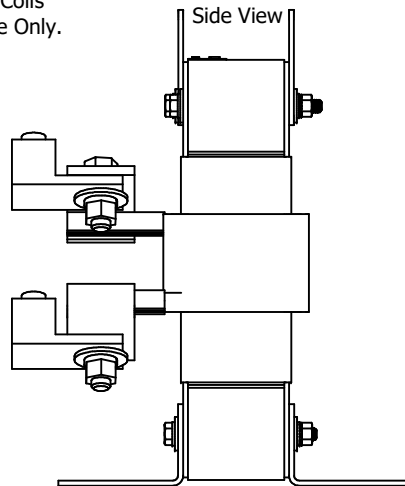

480 Rated Voltage, 600 Max Voltage, Output							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULL1P	350	414	420	26.4	275	88	SLK13

575 Rated Voltage, 600 Max Voltage, Output							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULL31P	400	382	420	26.5	420	88	SLK13
KDRULL35P	450	412	420	26.4	420	88	SLK13

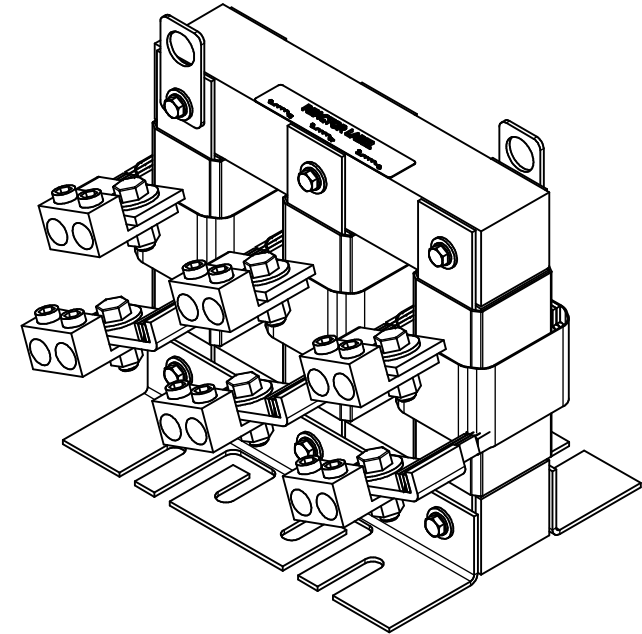

TCL (800) 824-8282 transcoil.com

TCL, LLC
Greenwood, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR - Motor Amps -
350, 400/400, 450, 475, 500, 550, 600/600 Max. -A Max
400 Amp Max. 1.525" Rise, Rating
Manual #30895 LUG KIT #SLK-

UL LISTED CE
3RD PARTY, 99, 10000

DATE CODE A1 B1 C1

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
.XX	± .25		
.XXX	± .10		
FRACTIONAL			
± 1/32			
ANGULAR			
± 1°			

NO	REVISION	DATE	BY
A	6688, 107537-6 to 107537-18	7/2/2024	DSW

TCL W132N10611 (Rev 13 Feb)
Greenwood, WI 53022

An Official Motors Company
© 2024 TCL, LLC

KDRUL L Frame, Copper Bus
Reactor Drawing

DRN BY: DSW	DATE: 7/2/2024	107537-18DG
SCALE: 1/3.2	DRWN	REV: 0

SHT 1 OF 1