
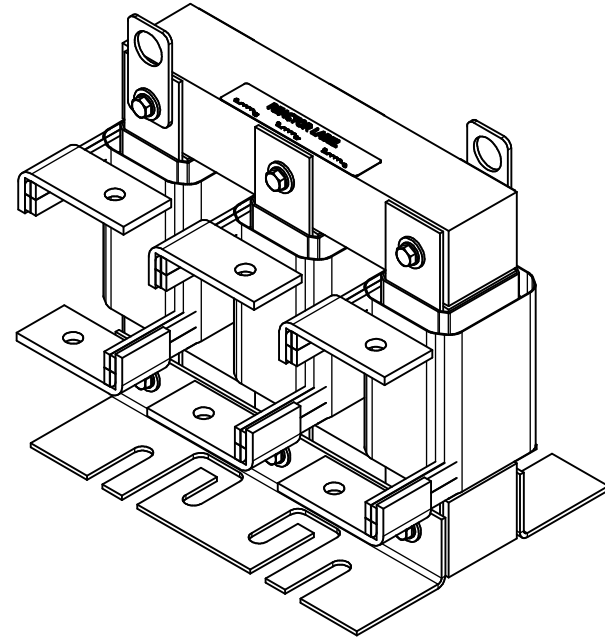


(Customer Connections)
Markings On Coils
For Reference Only.

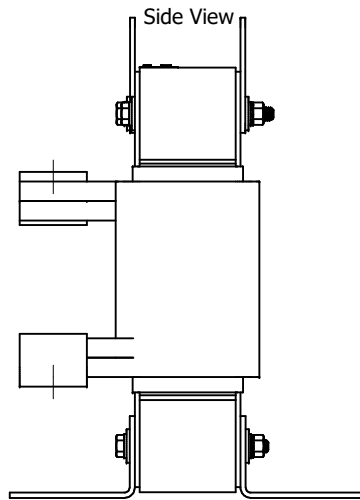

480 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL3P	450	515	600	19	338	100	SLK14	0.53
KDRL4P	500	590	600	18.7	338	100	SLK14	0.53

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germanstown, PA, USA
transcoil.com
800-824-8282


KDRL Drive Reactor
KDR - Motor Amps -
3PH, 30/40/50, -1/1 Rated, 600V Max, -A Max
480V Amb Max, 1500V Rise, Rating
Manual #30895 LUG KIT #SLK-

UL LISTED
cULus Listed
200 conv. eq. 1000

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

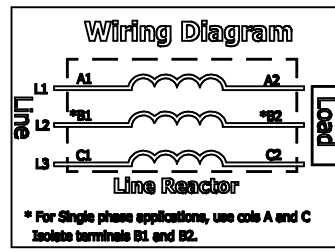

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
.XX	± .25		
.XXX	± .10		
FRACTIONAL			
± 1/32			
ANGULAR			
± 1°			
A	6688, 107537-5 to 107537-19	7/2/2024	DSW
NO	REVISION	DATE	BY

TCI W132N10611 (Rev 1) Feb 2024
Germanstown, PA, WI 50022
© 2024 TCI, LLC
An Official Motion Systems Company
KDR L-Frame, Copper Bus
Reactor Drawing

DRN BY: DSW	DATE: 7/2/2024	107537-19DG
SCALE: 1/3.2	DRWN BY: DSW	DATE: 7/2/2024
		107537-19DG

SHT 1 OF 1