
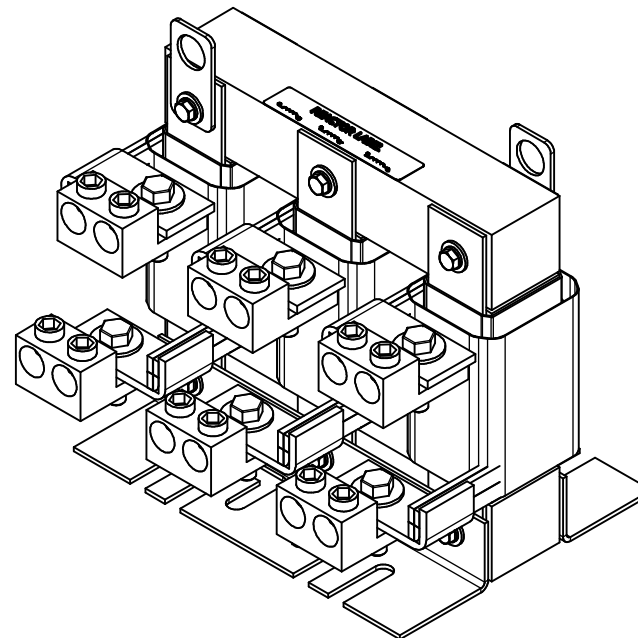


(Customer Connections)  
Markings On Coils  
For Reference Only.

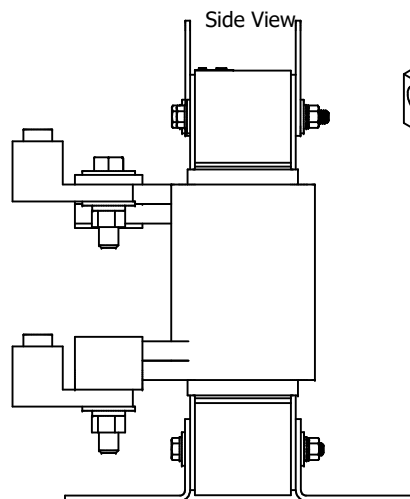

480 Rated Voltage, 600 Max Voltage, Output							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULL3P	450	515	600	19	338	105	SLK14
KDRULL4P	500	590	600	18.7	338	105	SLK14

**TCI** (800) 824-8282 [transcoil.com](http://transcoil.com)

TCL, LLC  
Germanstown, WI, USA  
[transcoil.com](http://transcoil.com)  
800-824-8282


KDRUL Drive Reactor  
KDR - Motor Amps -  
3P/1, 3P/480V, -1/ Rated, 600V Max, -A Max  
480V Amb Max, 1500V Rise, 60Hz  
Manual #30895 LUG KIT #SLK-

UL LISTED CE  
200 CONV. 09. 0000

DATE CODE A1 B1 C1

Notes:

1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. KDR IOM Manual Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

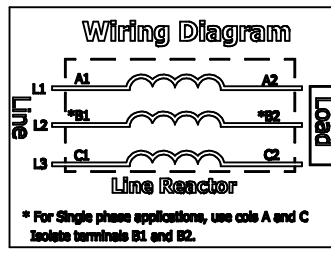

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
A	6688, 107537-6 to 107537-20	7/2/2024	DSW

TOLERANCES (EXCEPT AS NOTED)  
DECIMAL  
.XX ± .25  
.XXX ± .10  
FRACTIONAL  
± 1/32  
ANGULAR  
± 1°

**TCL** W132N10611 (Rev 13 Feb 2024)  
Germanstown, WI 53022  
© 2024 TCL, LLC  
An Official Motors Group  
KDRUL L Frame, Copper Bus  
Reactor Drawing  
OWN BY: DSW DATE: 7/2/2024 107537-20DG  
SCALE: 1/3.2 DRAWN BY: DSW SHEET: 1 OF 1