

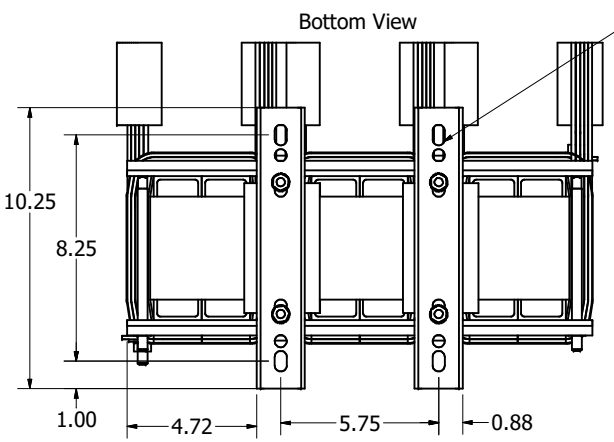
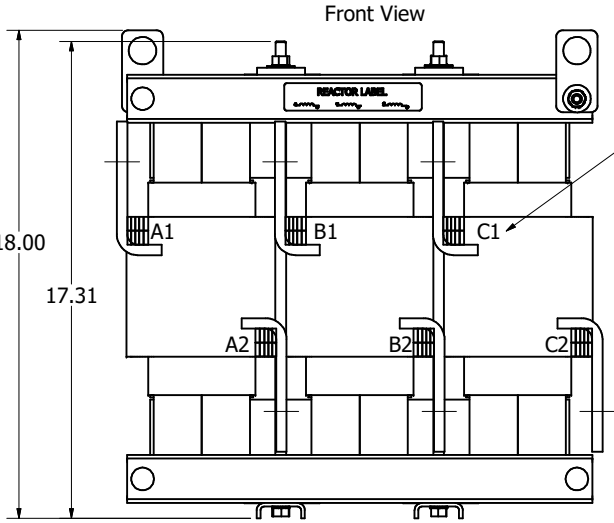
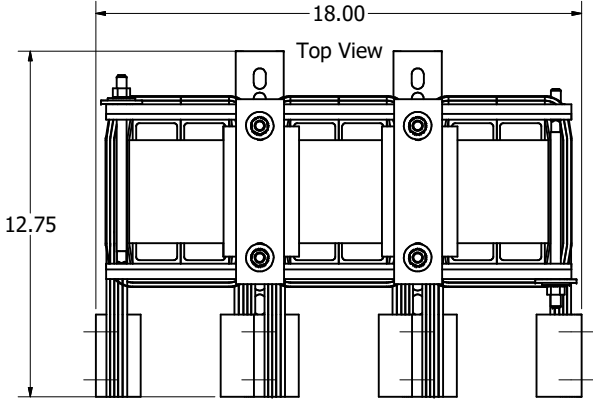
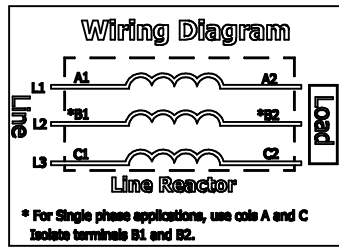


575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX42L	1000	960	1000	23.9	1194	280	SLK16	0.53

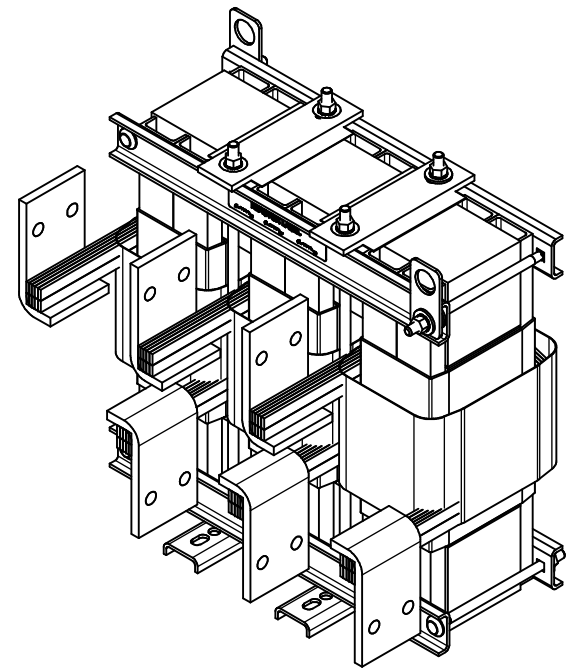

(Customer Connections) Markings On Coils For Reference Only.

0.44 x 0.75 Slots 4 Places.

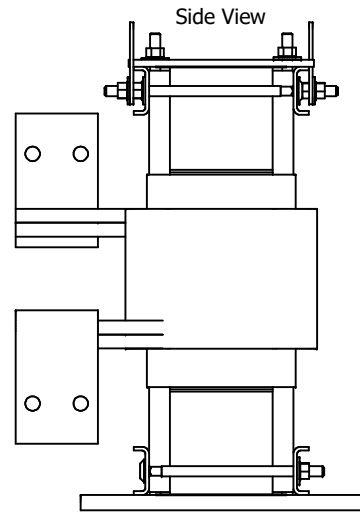

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI (800) 824-8282 transcoll.com

TCI, LLC
 Germantown, WI, USA.
transcoll.com
 800-824-8282

KDRXL Drive Reactor
 1200 - Motor Amps -
 300V, 60/60Hz - V Rated, 600V Max. - A Max
 40C Amb Max. 250C Fin. Set 15
 Manual #30895 LUG KIT #016

UL LISTED CE
 cULus LISTED

DATE CODE

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	SCALE
A	6688 107539-1 to 107539-11	6/21/2024	DSW	

TOLERANCES (EXCEPT AS NOTED)
 DECIMAL
 .XX ± .25
 .XXX ± .10

FRACTIONAL
 ± 1/16
 ANGULAR
 ± 1°

TCI W132N10611 (Rev. 11Feb) Germantown, WI 53022 © 2024 TCI, LLC
 An *Official Motors Company*
 KDR X Frame Copper Bus
 Reactor Drawing

DRN BY: DSW DATE: 6/21/2024 107539-11
 SCALE: 1:4.5 DRAWN BY: DSW SHEET: 1 OF 1