


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULX41L	900	864	900	26.6	1075	290	SLK16

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Attached Lug Kit
KDRULX44H	800	768	840	49.8	1100	320	SLK16

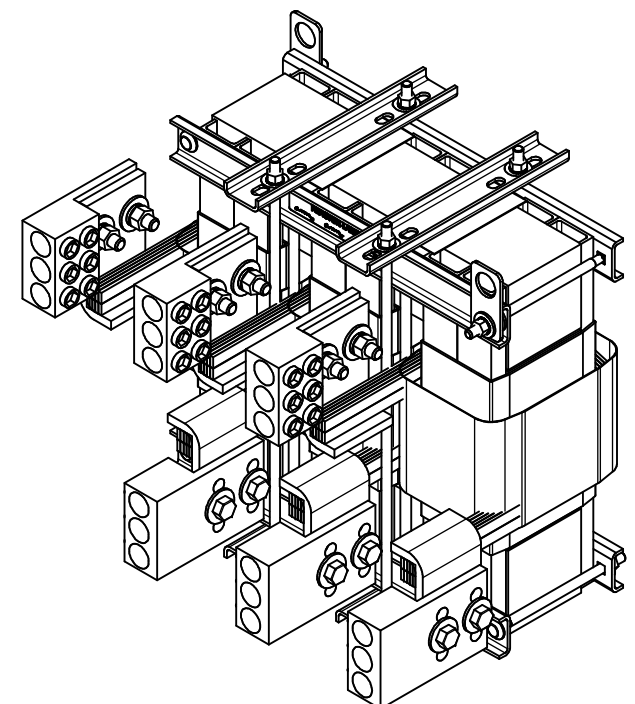

TCL (800) 824-8282 transcoll.com

TCL, LLC
Germanstown, WI, USA
transcoll.com
800-824-8282

KDRUL Drive Reactor
KDRUL— Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Turn Torque— 15-in

UL LISTED
cULus LISTED
E116124

DATE CODE A1 B1 C1

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°			
C	6688 X44L, 850 TO 840 A MAX.	6/25/2024	DSW	© 2024 TCI, LLC			
B	5796, Title blk updated, chg lift ring sides	12/8/2021	DSW	KDRUL X Frame Copper Bus			
A	A Combined Drawings	3/5/2018	DSW	Reactor Drawing			
NO	REVISION	DATE	BY	DRN BY: DSW	DATE: 3/5/2018	107539-2DG	SCALE: 1:4.5