
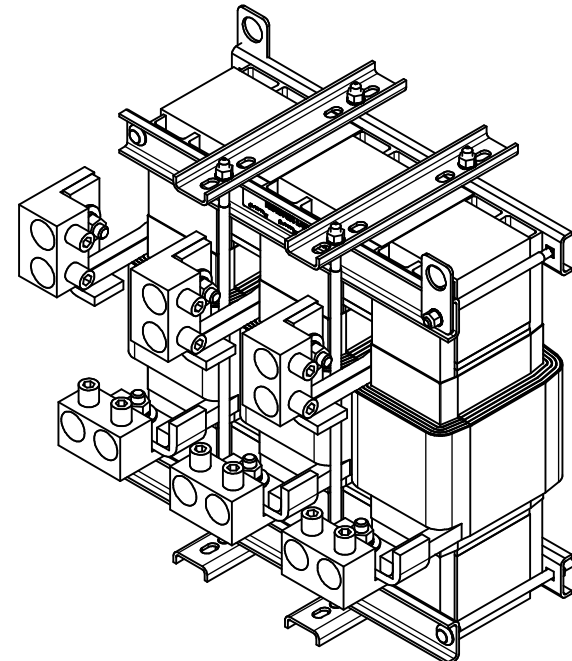
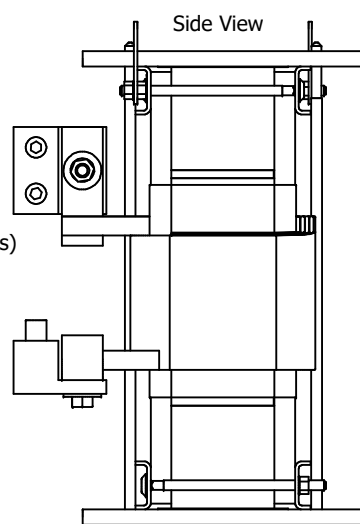
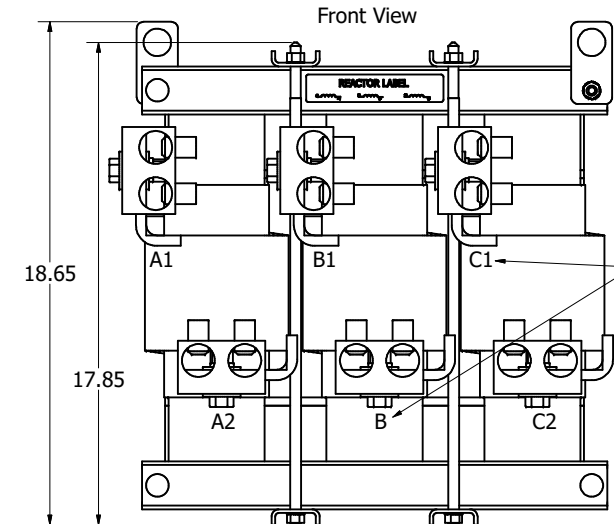




575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX45H	700	672	750	57	280	1393	SLK15

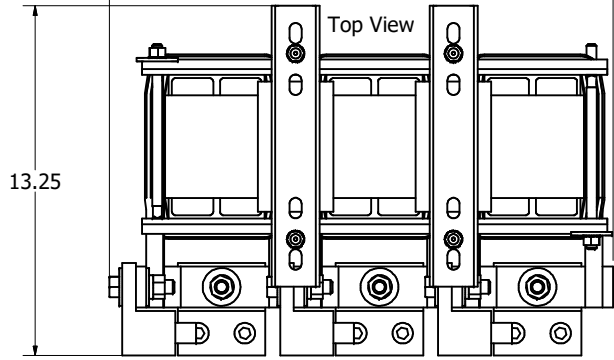

(Customer Connections) Markings On Pressure Terminals For Reference Only.

0.44 Wide x 0.75 Long Slots 4 Places.

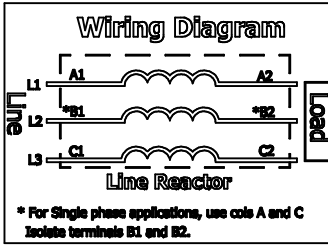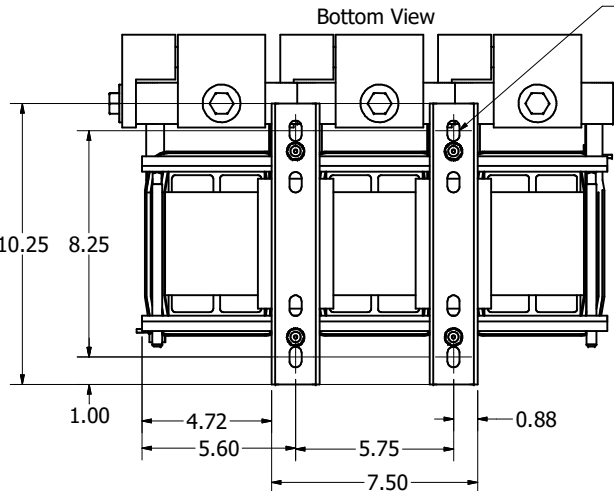

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germantown, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDRUL— Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Term Torque— lb-in

UL LISTED CE

DATE CODE A1 A2 B1 C1 C2

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		W132N10611 (Rev 11/16) Germantown, WI 53022 © 2024 TCI, LLC An Official Motors Group KDRUL X Frame, Copper Bus Reactor Drawing	
				DECIMAL	.XX ± .25		
					.XXX ± .10		
B	6688, 760A to 750A Max	6/20/2024	DSW	FRACTIONAL	± 1/16	DRN BY DSW	DATE 3/5/2018
A	Combined Drawings	3/5/2018	DSW	ANGULAR	± 1°	SCALE 1:3.5	107539-6DG
NO	REVISION	DATE	BY			DRN BY	DATE