

Drawings:
 General Schematic: 30955
 Customer Connection: 25027-3
 Interface/Display Module: 28282-1 & 28283-1
 Current Transformer: 26461

Notes:
 Weight lbs (kg): 1425 (646)
 Total Heat Loss:
 300A: 8,000 watts, 27,297 Btu/h.
 350A: 10,600 watts, 36,169 Btu/h.

The 300A unit is rated for 220A when applied with a 480V/600V autotransformer.


The 350A unit is rated for 260A when applied with a 480V/600V autotransformer.

NO	REVISION	DATE	BY	SCALE	ANGULAR	TOLERANCES (EXCEPT AS NOTED)
D	5641 Clearance note modified	6/22/2021	JSG			DECIMAL
C	#5376 heat loss update	8/31/20	MJS			.XX ± .03 .XXX ± .010
B	updated floor std kit	3/3/20	MJS			FRACTIONAL
A	air flow symbols added	12/11/19	MJS			± 1/32
02	as redesigned	11/26/19	MJS			± 1°
01	AS DESIGNED	03/29/19	JHM			
NO	REVISION	DATE	BY	SCALE	ANGULAR	TOLERANCES (EXCEPT AS NOTED)


Material(s) Shall be RoHS Compliant


TCL W132N10611 Grant Drive
 Germantown, WI 53022
 © 2021 TCL, LLC
 An **Applied Motion** Company
 Outline Installation, N3R
 Active Filter, 300/350A
 DESIGNED BY: JHM DATE: 03/29/19 107580
 DRAWN BY: JHM DATE: 03/29/19
 SCALE: 1"=1'-0" SIZE: C

Door Operator Detail

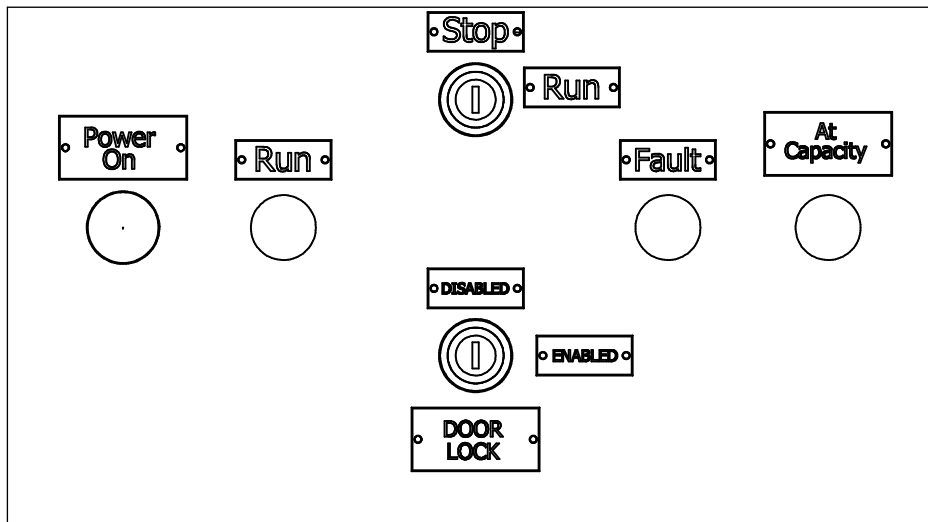

NO Door Operators

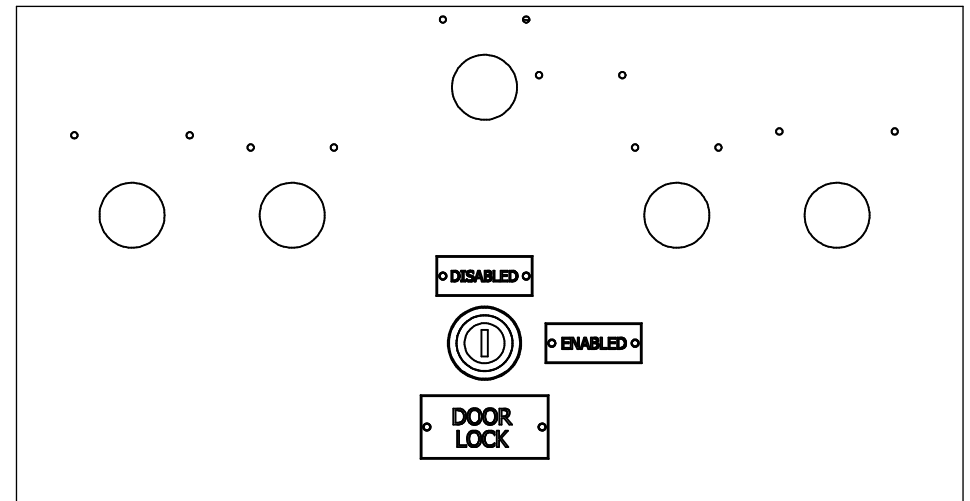

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.					TOLERANCES (EXCEPT AS NOTED)	 W132N10611 Grant Drive Germantown, WI 53022 © TCI, LLC An <i>Active Filter</i> Motion Company Outline, Installation, N3R Active Filter, 350A	
					DECIMAL		
					.XX ± .03 .XXX ± .010		
					FRACTIONAL		
	SEE SHEET 1				ANGULAR	DRN BY: JHM DATE: 03/29/19 107580	
NO	REVISION	DATE	BY		SCALE:	DRW: JHM DATE: 03/29/19 107580	
						SCALE: DATE: 03/29/19 107580	