

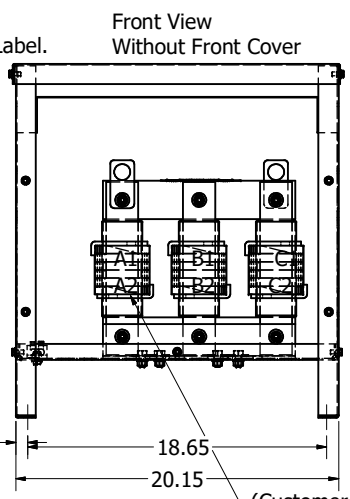


480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.


Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL1LE01	450	515	575	36.3	176	509	SLK14	0.53
KDRL2LE01	500	590	610	31.5	176	518	SLK14	0.53

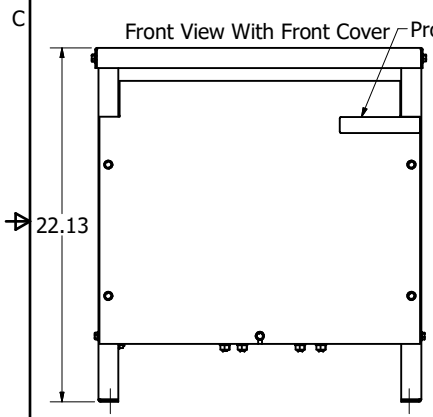

Suggested Customer Wire Entrance Bottom Of Enclosure.
See Note: 6
(Non Removeable Panel)

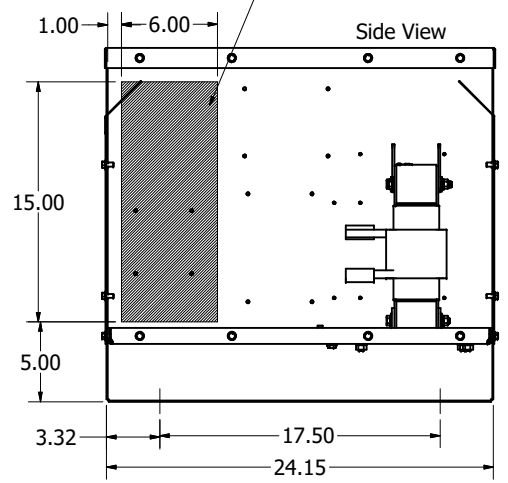


Suggested Customer Entrance Either Side Of Enclosure.
See Note: 6
(Non Removeable Panel)

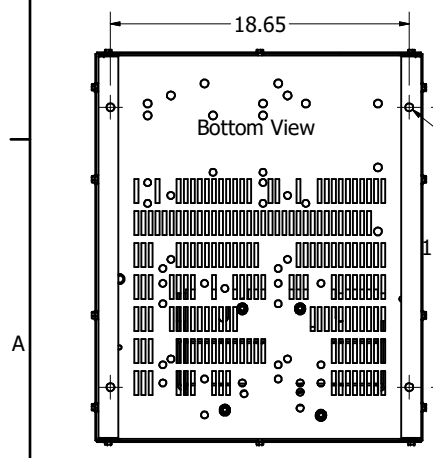

0.50 Dia Mounting Holes
4 Places, (Bottom of Enclosure)

(Customer Connections) Markings On Coils For Reference Only.

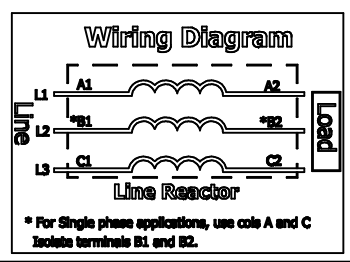

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germantown, WI, USA
transcoil.com
800-824-8282

KDR L Drive Reactor
KDR - Motor Amps -
3PH, 50/60Hz, -V Rated, 600V Max, -A Max
40C Amb Max, 1BSC Film, RoHS
Manual #30895 LUG KIT #SLK-

UL LISTED CE
3B5-0002, 04, 05, 06, 07, 08, 09, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. UL file number: cULus Listed File E116124.
 3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 4. KDR IOM Manual Part Number 30895
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TOLERANCES (EXCEPT AS NOTED)		THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLENT INC. AND ITS SUBSIDIARIES.		ISSN BY	DATE	SCALE	SIZE	SHT. 1 OF 1
DECIMAL	.XX ± .25 .XXX ± .10			DSW	7/1/2024	1/6	C	
FRACTIONAL	± 1/32							
ANGULAR	± 1°							
NO	REVISION			DATE	BY			
		6688, 107614-5 to 107614-13		7/1/2024	DSW			
							KDR L Frame Enclosed Type 1 107614-13DG	
							W132N10611 Grant Drive Germantown, WI 53022 © 2024 Allient Inc.	