

TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)	Measured Gap	Item Number	Terminal Hole Size (Inches)
KTRMG80A	80	480	60	598	90	.190	13R	.28
KTRMG110A	110	480	60	435	95	.163	13R, 14R	.28
KTRMG130A	130	480	60	368	130	.106	13R, 14R	.28
KTRMG65C	65	600	60	919	95	.209	13R	.28
KTRMG80C	80	600	60	747	95	.228	13R	.28
KTRMG110C	110	600	60	543	115	.163	13R, 14R	.28
KTRMG130C	130	600	60	460	120	.190	13R	.34




TCI, LLC
Germantown, WI
www.transcoil.com
800-824-8282

KDR Drive Reactor
KTRMG— (Motor Amps) Or (Rating Amps)
3 PH, 50/60Hz, 600V Max. —Max.
40C Amb Max, 155C Rise.

(800) 824-8282 • transcoil.com

SA CE

A1 A2 B1 B2 C1 C2

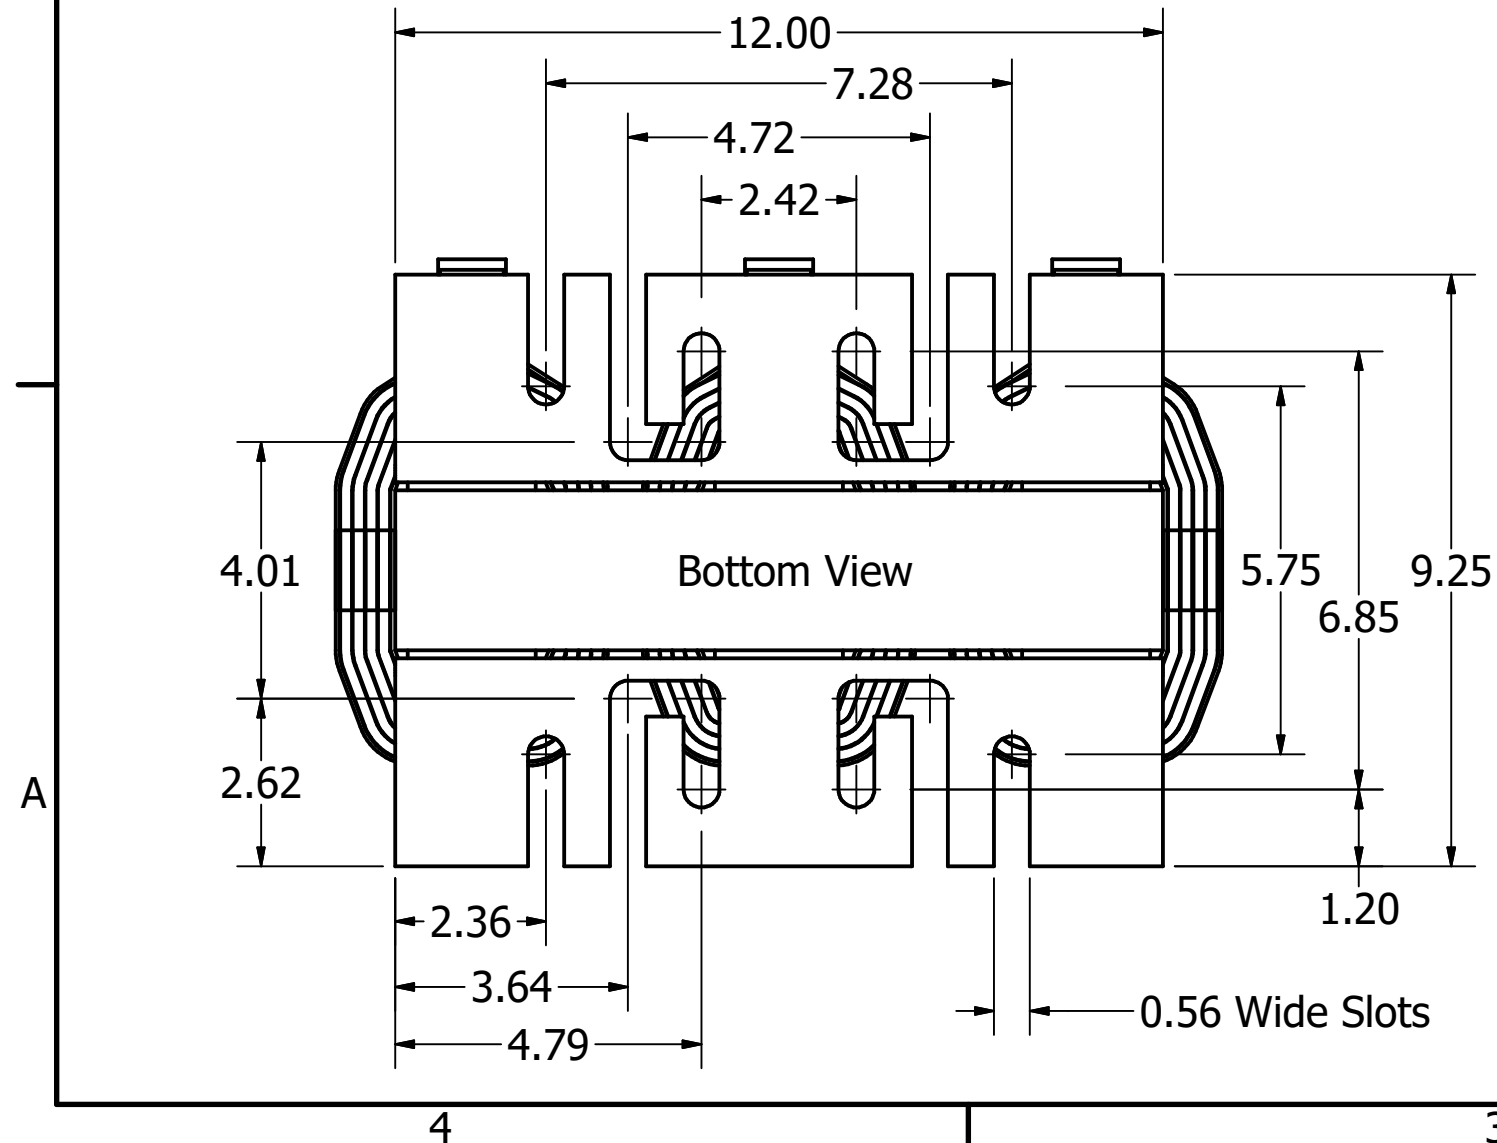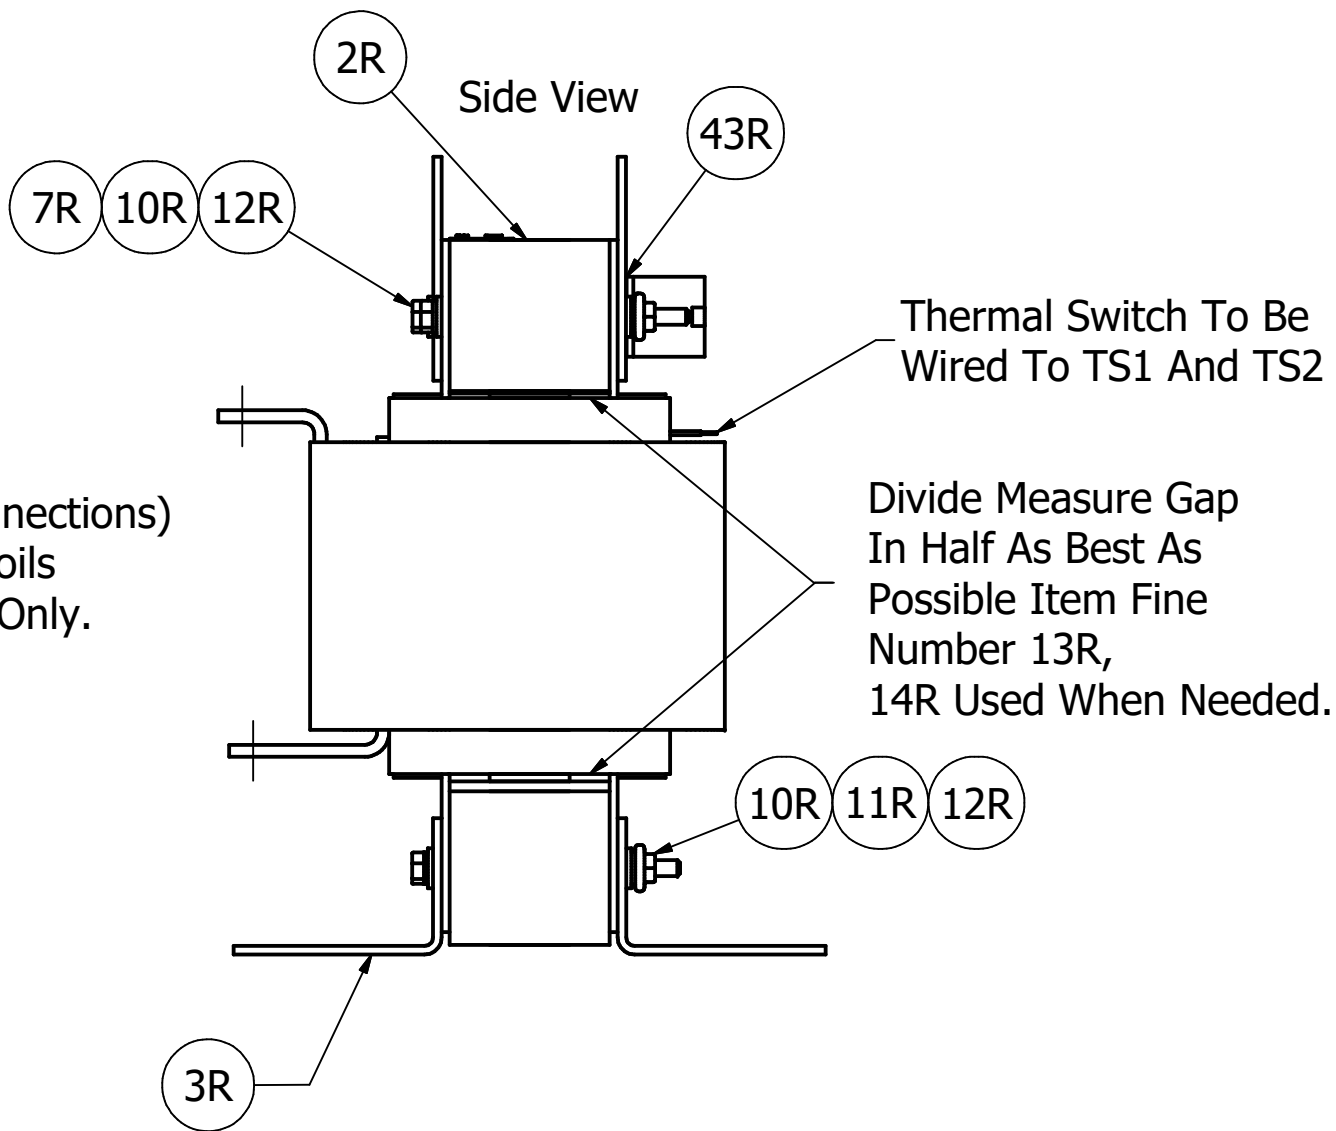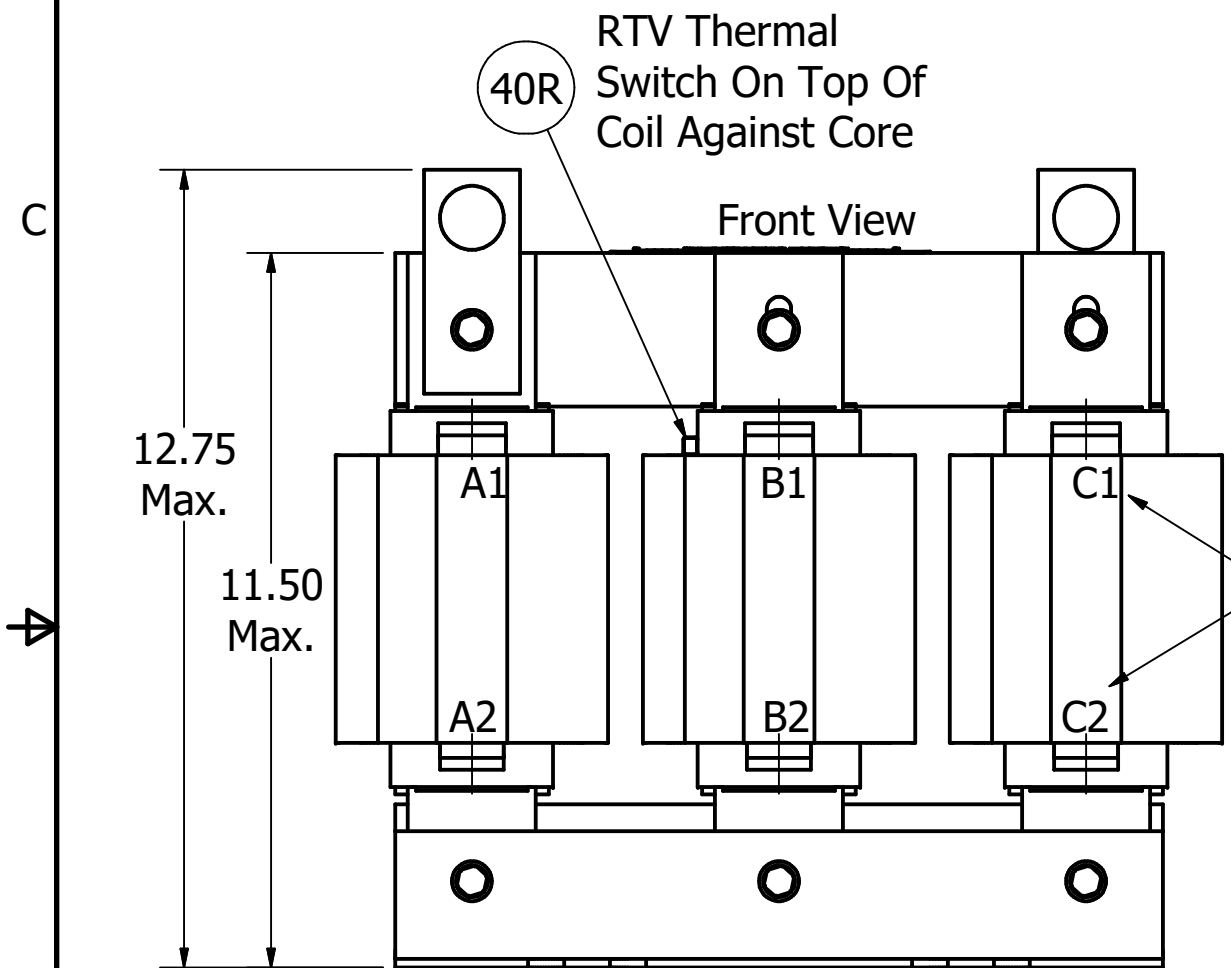

Strip - 2.4 2.5 Stack

Hi-Pot Volt	Dip
2650	468-2

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .25
.XXX ± .10
FRACTIONAL
± 1/16
ANGULAR
± 1°

W132 N10611 Grant Drive
Germantown, WI 53022

KTRMG L Frame, Copper Bus
Reactor Drawing

DRN BY: JRN DATE: 04/09/19 108083
SCALE: 1/3 APRVD: SIZE: C SHT. 1 OF 1

NO	REVISION	DATE	BY