




UNIT SPECIFICATIONS						
HP	VOLT	PHASE	HZ	HARMONIC	KVAR	AMPS
550	480	3	60	5TH	80	655

SCHMATIC : 31462-50-1
Top View


GROUND LUG:
WIRE RANGE - THREE 600MCM-2
TIGHTENING TORQUE 500 LB-IN.

L1 L2 L3 T1 T2 T3
CUSTOMER CONNECTIONS:
WIRE RANGE - THREE 600MCM-2
TIGHTENING TORQUE 500 LB-IN.


- Notes:
1. Customer is responsible for installation to meet all national and local electrical codes.
 2. Use only hubs or fittings that comply with UL514B for type 3R enclosures.
 3. Approx. WT LBS : 950
 4. Enclosure Color: RAL 7006 Beige Grey

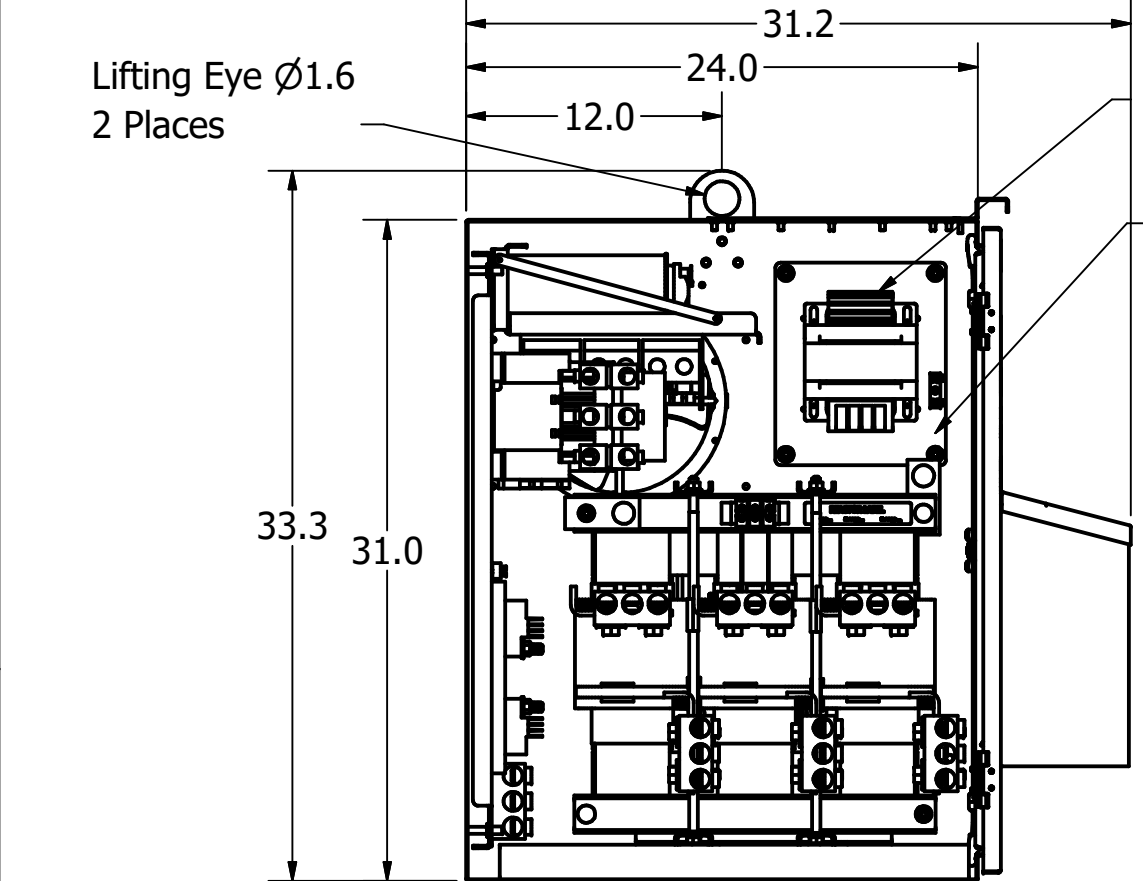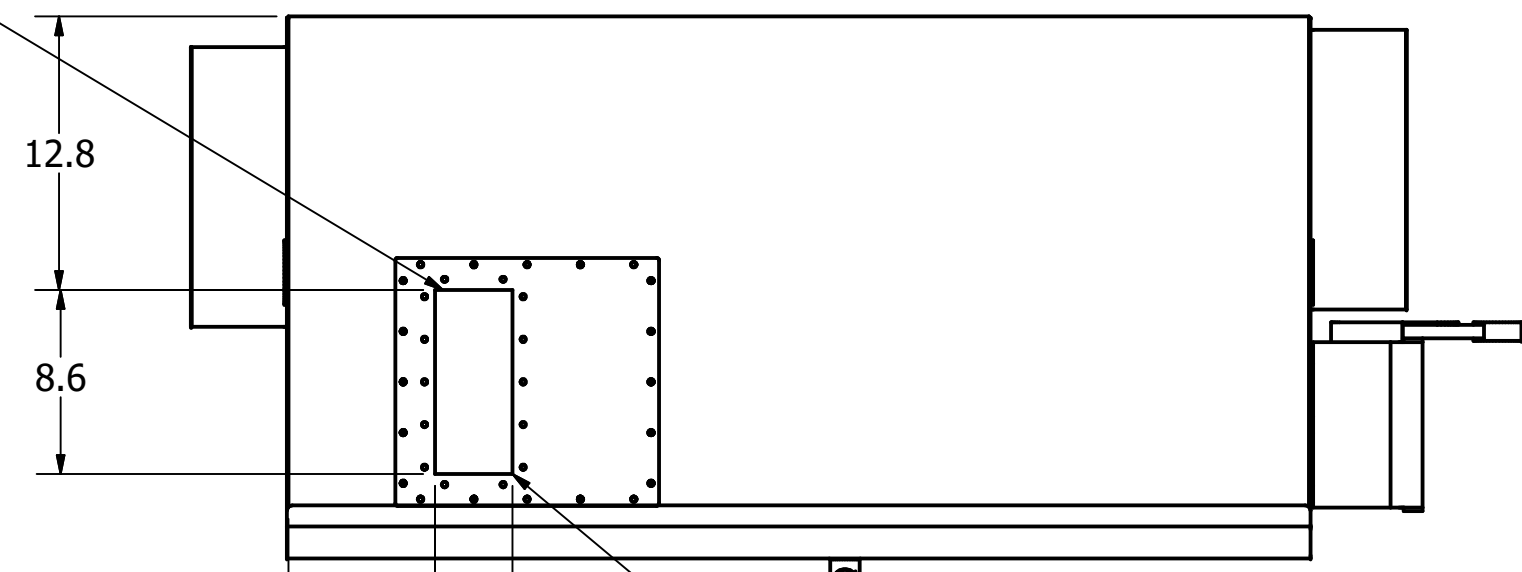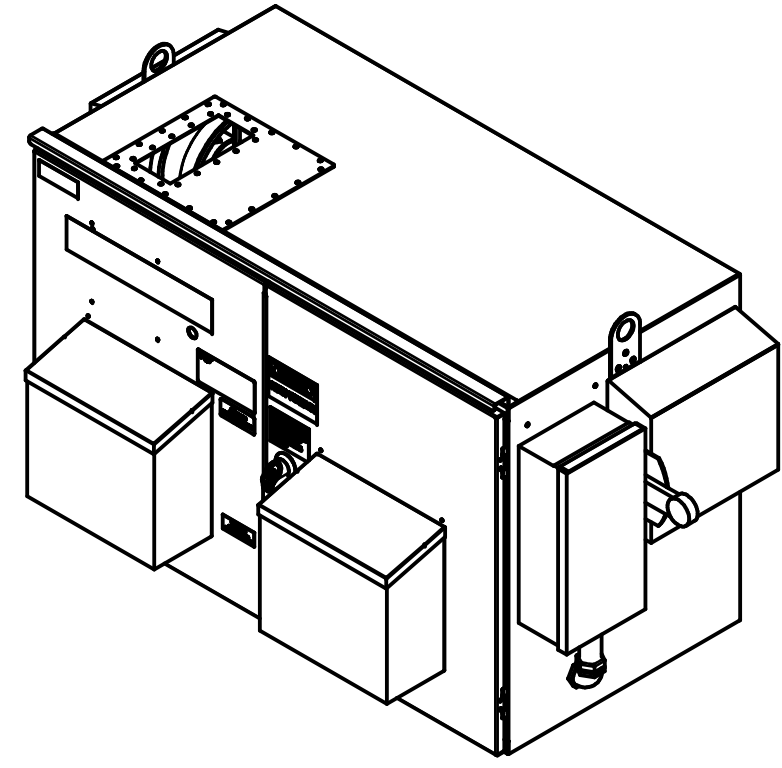


Side View Without Wall

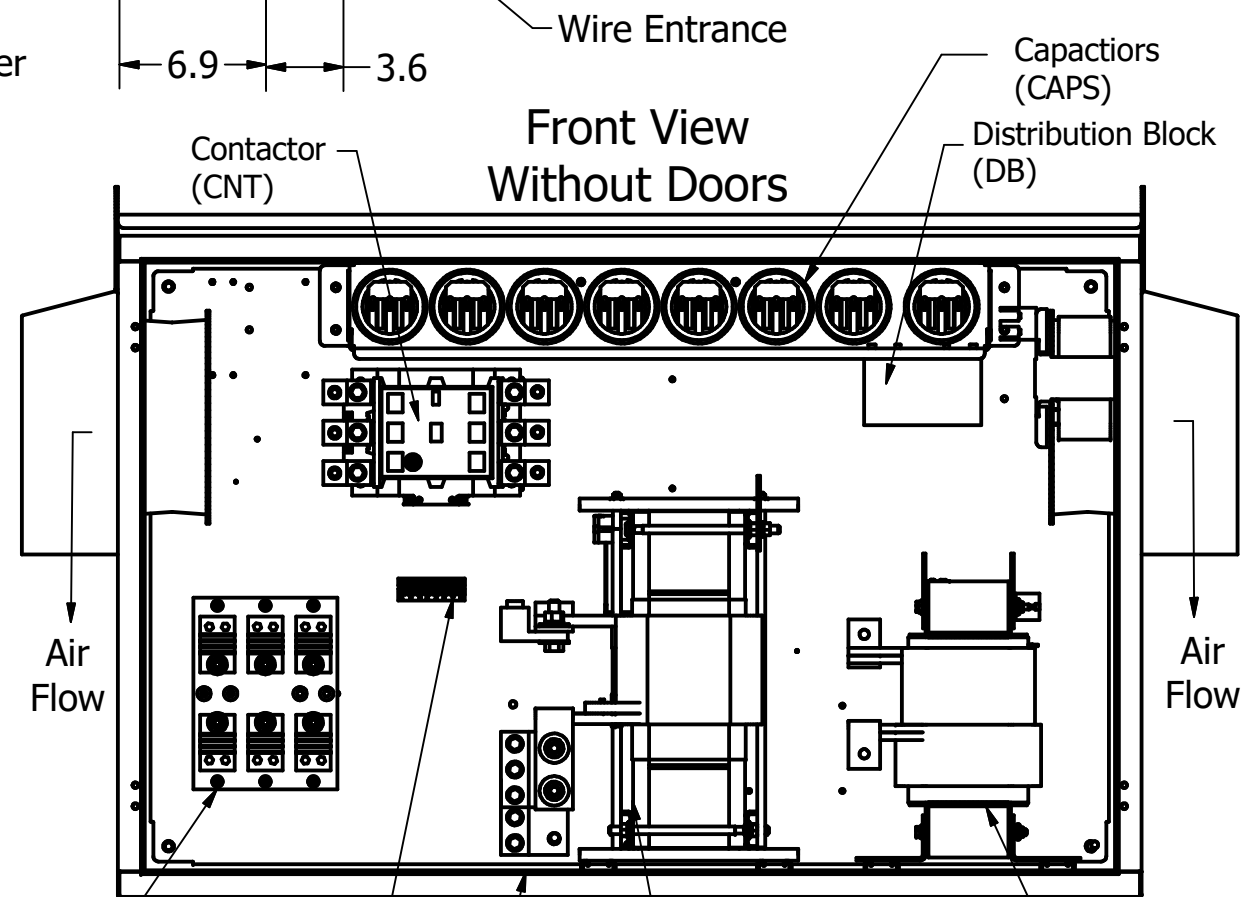

Front View Without Doors

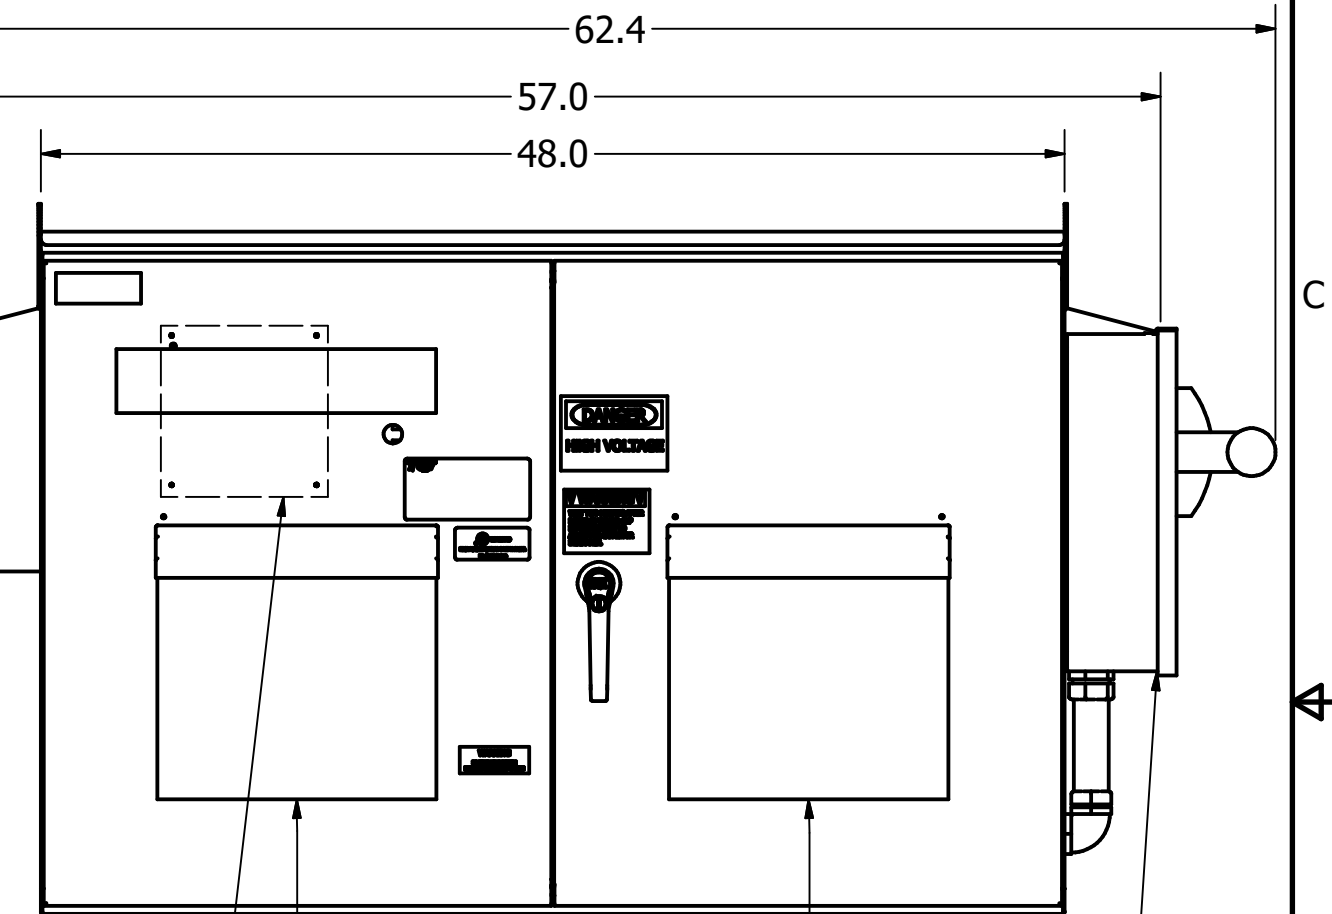



Front View

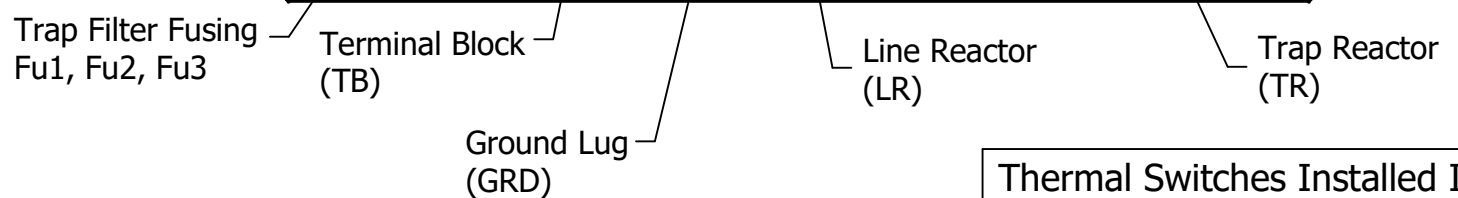

Thermal Switches Installed In Line Reactor And Tuning Reactor Wired To PQconnect For Monitoring

PQconnect Contactor Control Board Mounted To Inside Of Door

Customer Connection Form C Fault Relay J10

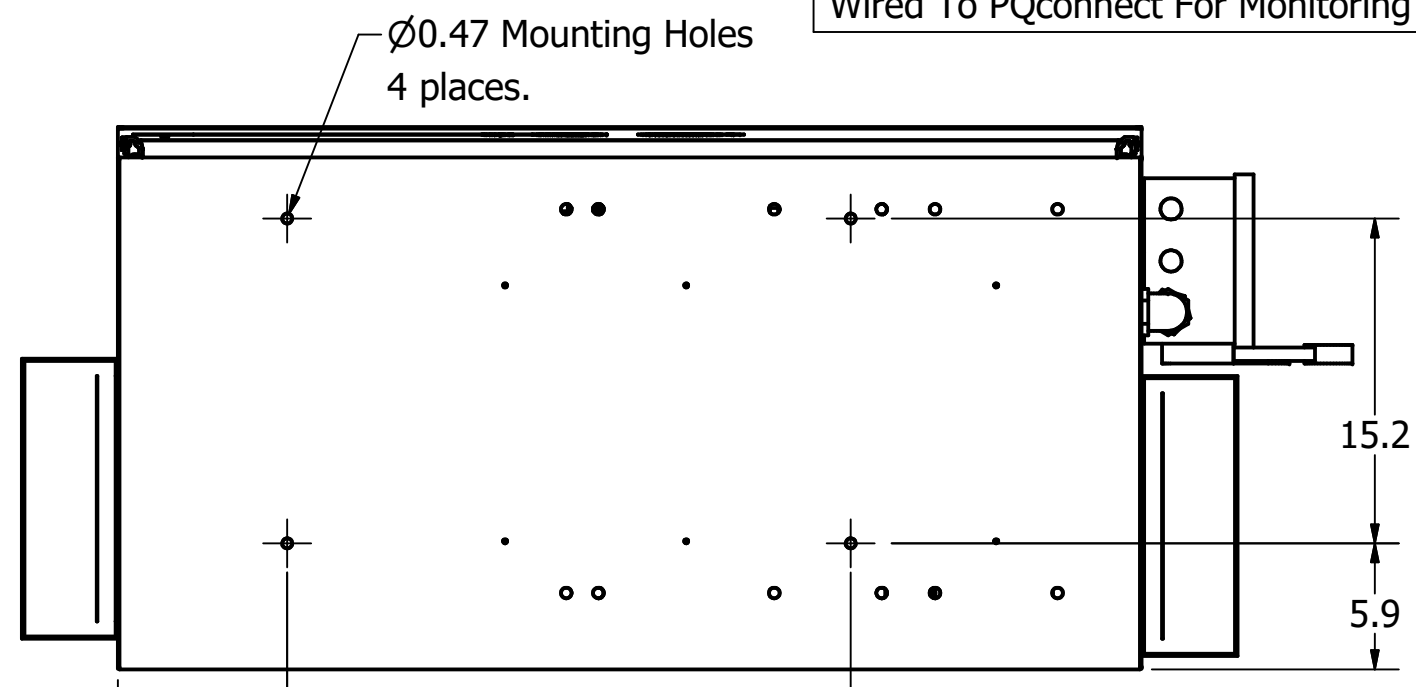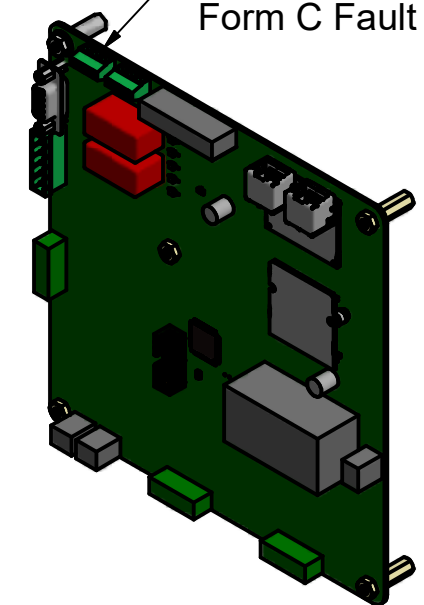

Bottom View

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 HarmonicGuard Low Capacitance 550HP, 480/3/60, Type 3R, JCI, PQconnect, 60A Fused Filtered Disconnect DRN BY JRN DATE 11/14/19 SCALE 1/12 APRVD: 108197-01DG SIZE C SHT.1 OF 1	
B	5363 Door Hoods Deeper, No Back Holes	08/20/20	JRN				
A	As Designed	11/14/19	JRN				
NO	REVISION	DATE	BY				