

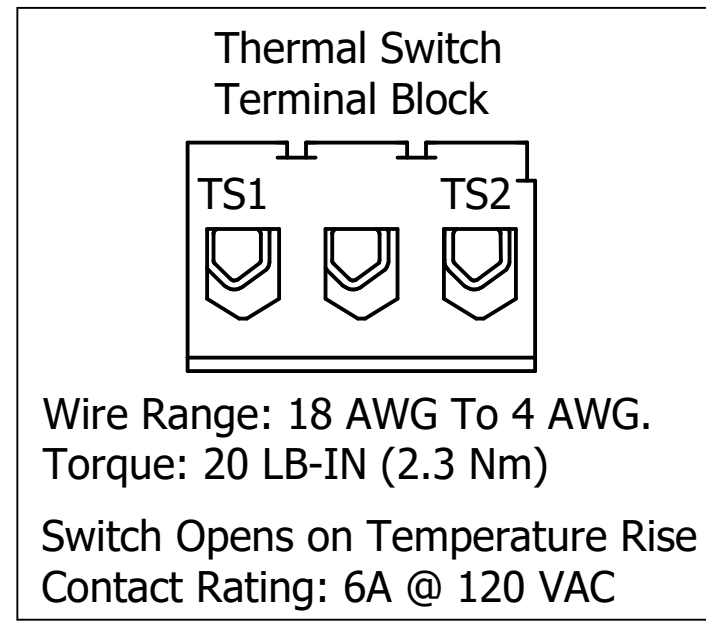
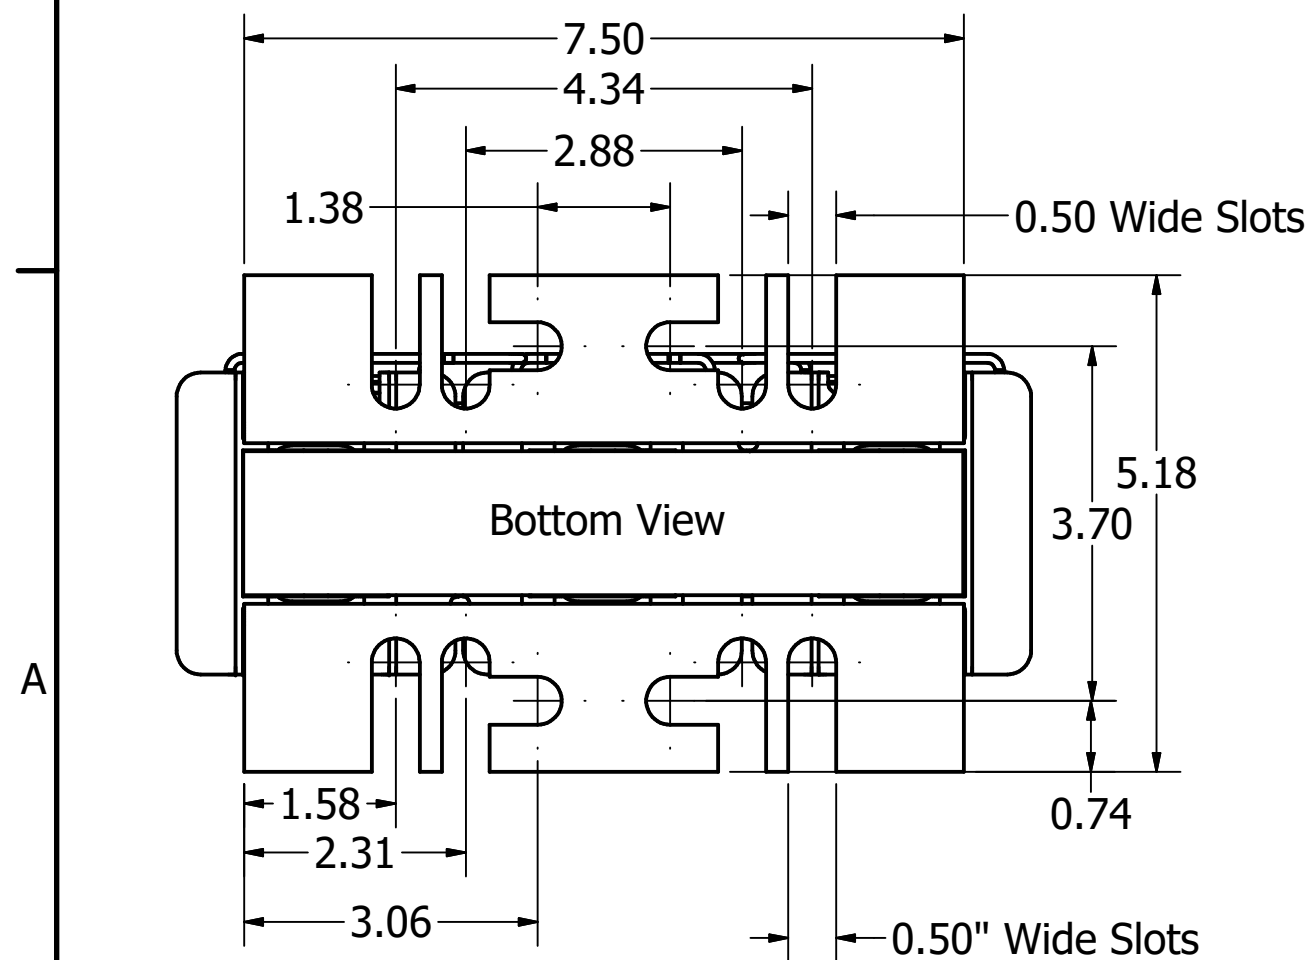


(Customer Connections)  
Markings On Terminal Block  
For Reference Only.

Wire Range: 1- 4 AWG. Torque : 35 LBS-IN (3.95 Nm)  
6- 14 AWG. Torque : 30 LBS-IN (3.39 Nm)  
16- 20 AWG. Torque : 25 LBS-IN (2.28 Nm)  
22 AWG. Torque : 20 LBS-IN (2.26 Nm)

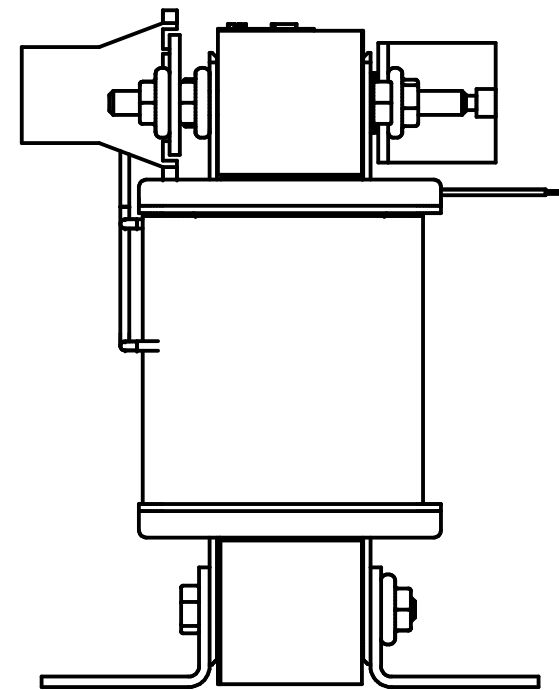

TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KLRUL23ATBMG	23	480	60	2080	25
KLRUL28BTBMG	28	240	60	8500	25

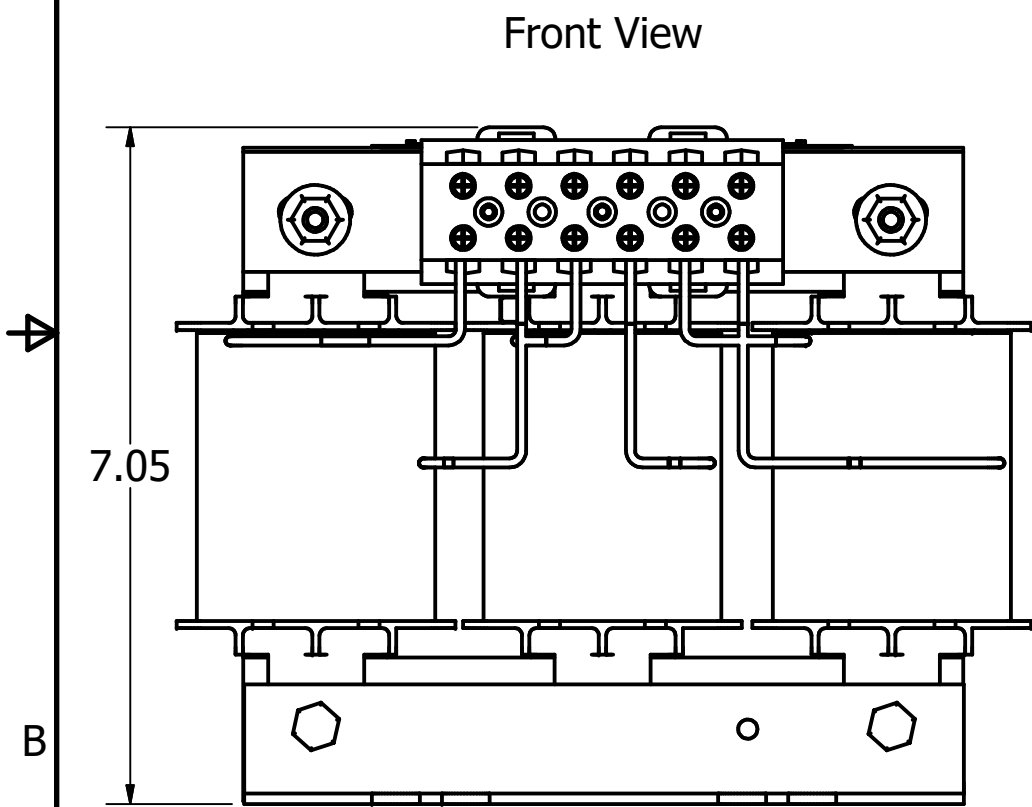

**TCI** (800) 824-8282 [transcoll.com](http://transcoll.com)

TCI, LLC  
Germantown, WI, USA.  
[transcoll.com](http://transcoll.com)  
800-824-8282

KLRUL Reactor  
KLRUL— Motor Amps —  
3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS  
40C Amb Max, RoHS  
Use 75C CU conductors only, Term Torque—lb-in

UL LISTED CE  
3RD CONT. EQ. MARK

DATE CODE A1 A2 B1 B2 C1 C2

Notes:

1. UL file number: cULus Listed File E116124.
2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. Material(s) Shall be RoHS Compliant
4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 KLRUL F Frame, Terminal Block Reactor Drawing, UL Listed DRN BY JRN DATE 03/02/20 108469DG SCALE 1/2 APRVD: SIZE C SHT.1 OF 1	
A	As Designed	03/02/20	JRN				
NO	REVISION	DATE	BY				