
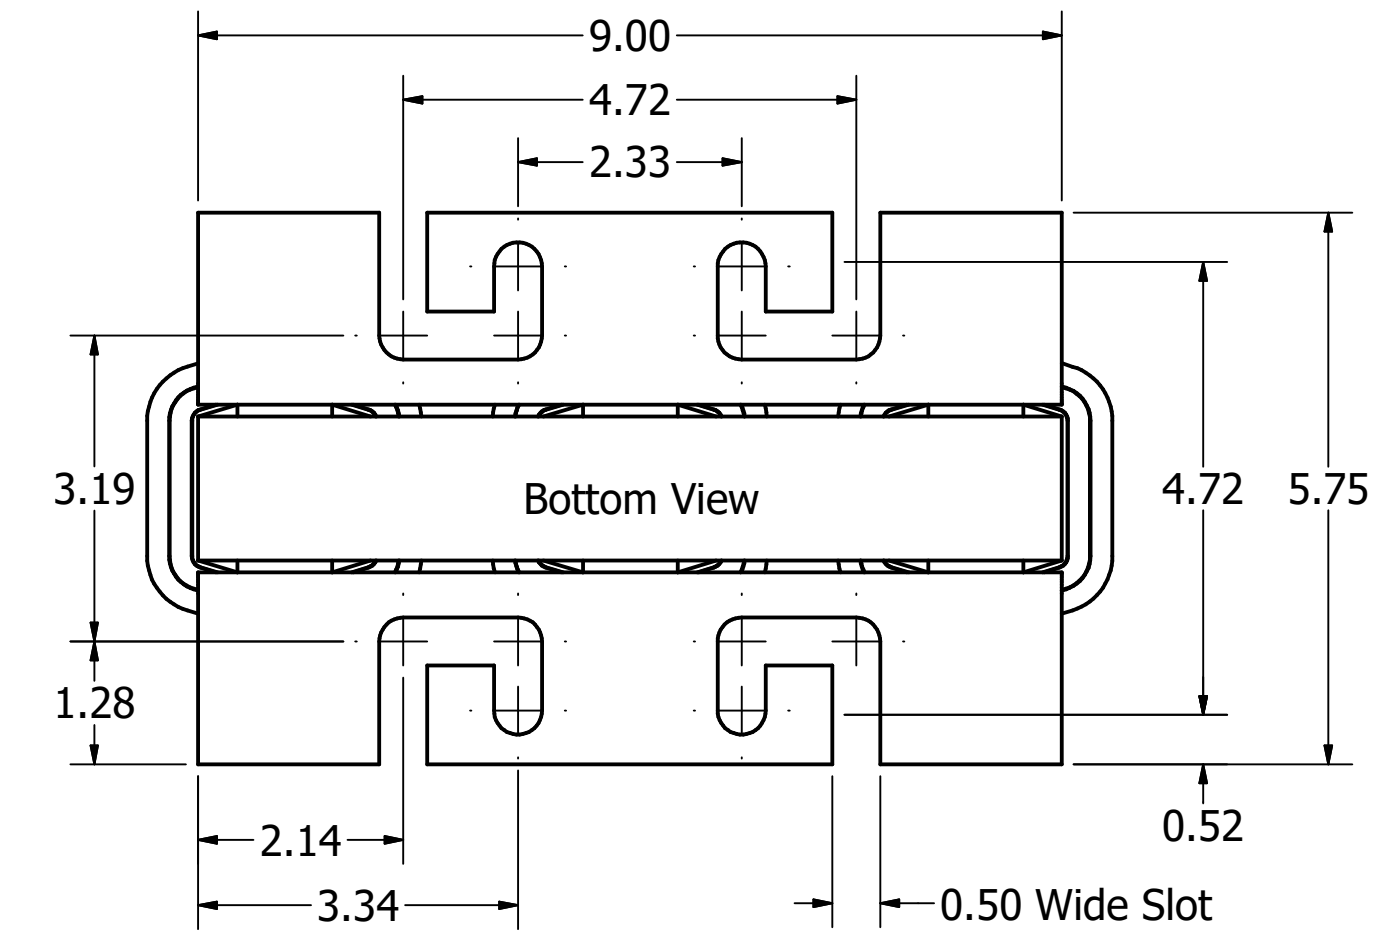
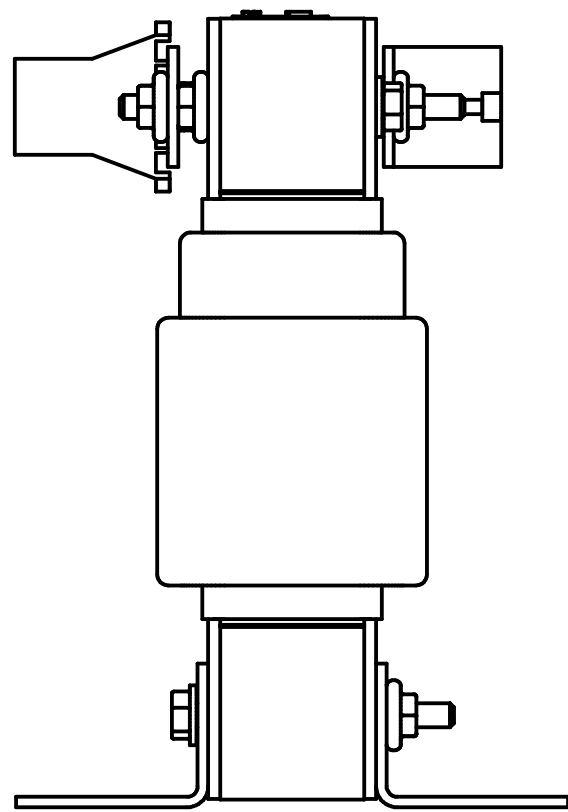


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KLRUL30ATBMG	30	480	60	1590	35
KLRUL35ATBMG	35	480	60	1370	35
KLRUL20CTBMG	20	600	60	2990	35
KLRUL25CTBMG	25	600	60	2390	35
KLRUL55BTBMG	55	240	50	315	35

(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 1- 4 AWG. Torque : 35 LBS-IN (3.95 Nm)  
 6- 14 AWG. Torque : 30 LBS-IN (3.39 Nm)  
 16- 20 AWG. Torque : 25 LBS-IN (2.28 Nm)  
 22 AWG. Torque : 20 LBS-IN (2.26 Nm)

Front View

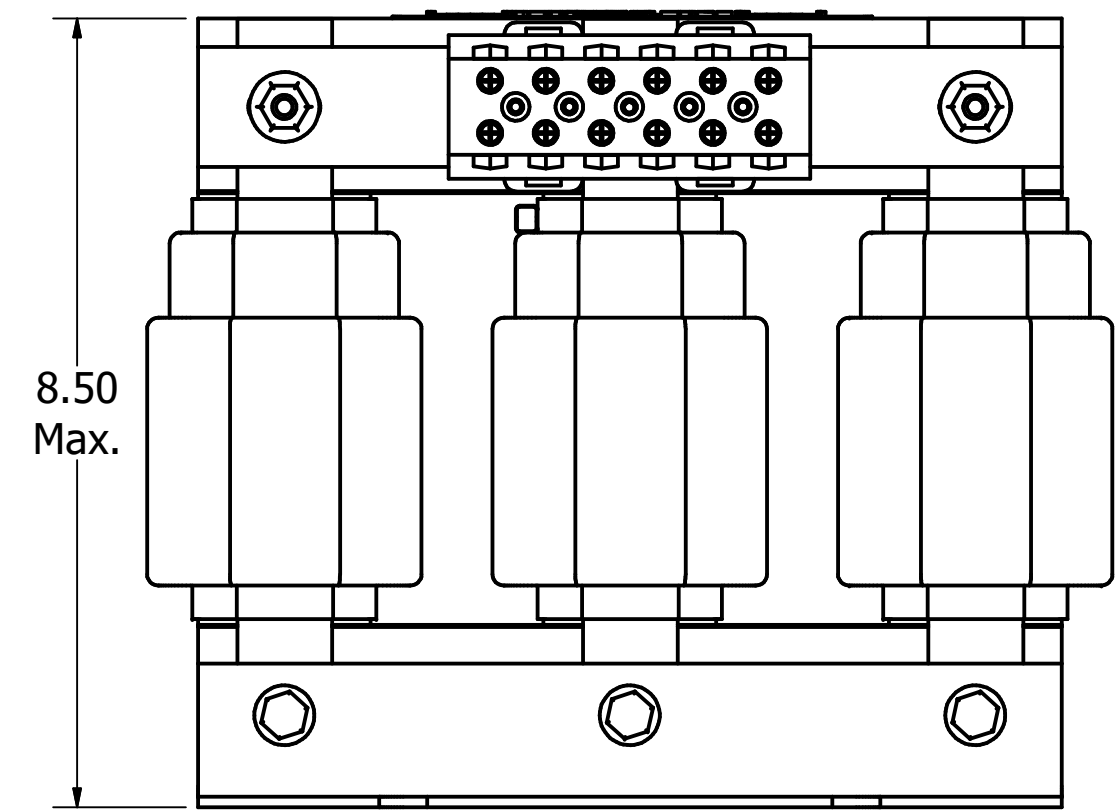

**TCI** (800) 824-8282 [transcoll.com](http://transcoll.com)

TCI, LLC  
 Germantown, WI, USA.  
[transcoll.com](http://transcoll.com)  
 800-824-8282

KLRUL Reactor  
 KLRUL— Motor Amps —  
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS  
 40C Amb Max, RoHS  
 Use 75C CU conductors only, Term Torque—lb-in

UL LISTED CE  
 2ND CONT. EQ. MARK

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. UL file number: cULus Listed File E116124.
  2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. Material(s) Shall be RoHS Compliant
  4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 KLRUL H Frame, Terminal Block Reactor Drawing, UL Listed	
NO	REVISION	DATE	BY	SCALE: 1/2	APRVD:	108470DG	SIZE C
A	As Designed	02/28/20	JRN				