
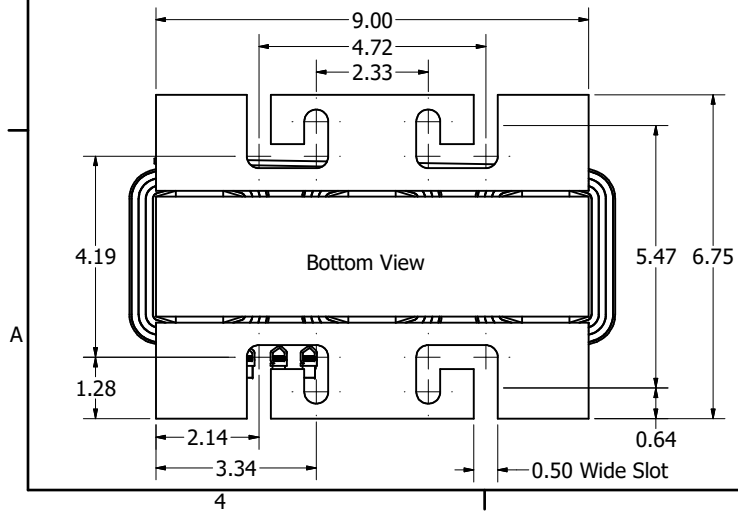
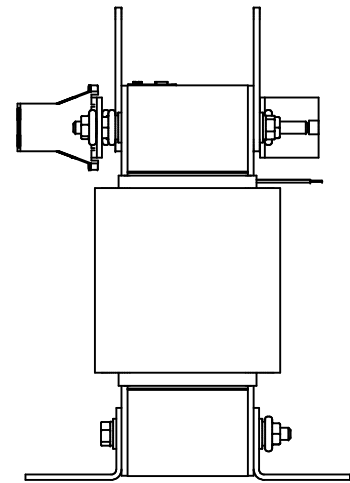


Wire Range: 1- 4 AWG. Torque : 35 LBS-IN (3.95 Nm)
6- 14 AWG. Torque : 30 LBS-IN (3.39 Nm)
16- 20 AWG. Torque : 25 LBS-IN (2.28 Nm)
22 AWG. Torque : 20 LBS-IN (2.26 Nm)

TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KLRUL45ATBMG	45	480	60	1060	50
KLRUL35CTBMG	35	600	60	1710	50

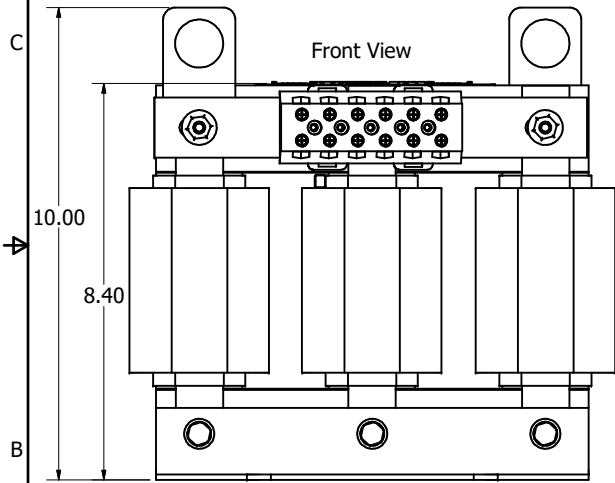

TCI (800) 824-8282 transcoll.com

TCI, LLC
Germanstown, WJ. USA.
transcoll.com
800-824-8282

KLRUL Reactor
KLRUL — Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS
40C Amb Max
Use 75C CU conductors only, Term Torque—lb-in

DATE CODE

UL LISTED CE
350 CONV. EQ. 0000

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. Material(s) Shall be RoHS Compliant
 4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°				W132N10611 Grant Drive Germanstown, WI 53022 © 2021 TCI, LLC An <i>allied Motion</i> Company KLRUL G Frame, Terminal Block Reactor Drawing, UL Listed	
B	5657, Add lift rings	7/12/2021	DSW	JRN	DATE	02/28/20	DRN BY	108471DG	
A	As Designed	02/28/20	JRN	SCALE	1/2	DATE	02/28/20	108471DG	
NO	REVISION	DATE	BY	SCALE	1/2	DATE	02/28/20	108471DG	