
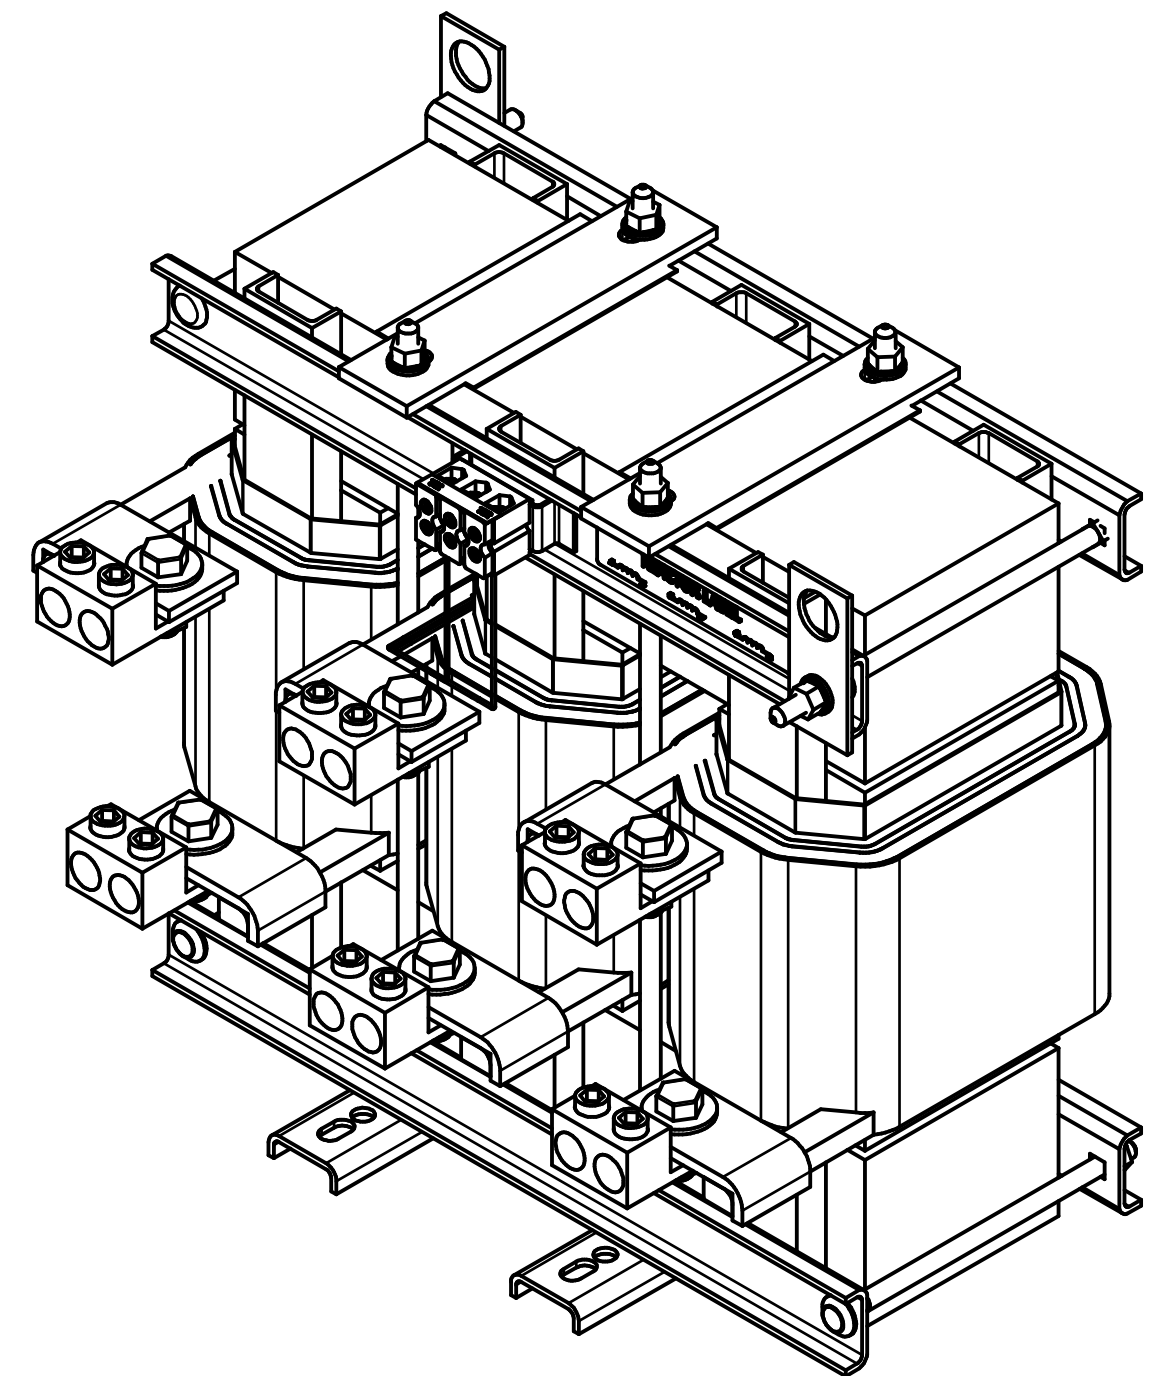
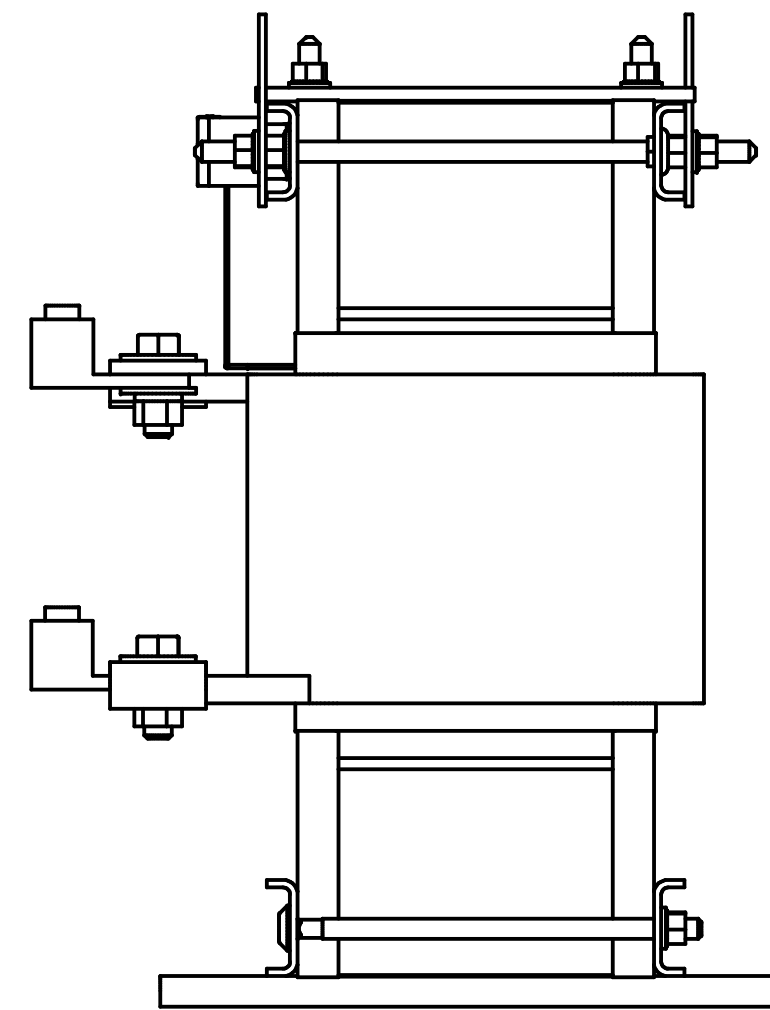


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)	Max Height (In)	Attached Lug Kit
KLRUL420APTMG	420	480	60	114	400	18.50	SLK13
KLRUL362CPTMG	362	600	60	165	465	22.00	SLK13
KLRUL420CPTMG	420	600	60	142	450	21.50	SLK13

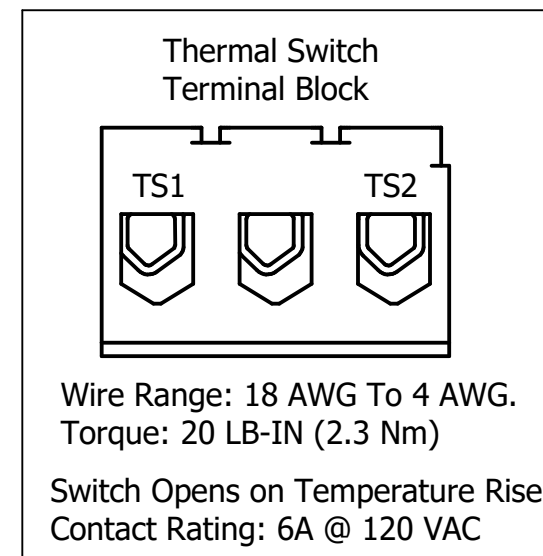

Wire Range	Tightening Torque
350MCM - 2 AWG	375 Lbs-In (42.4 N-m)
2 AWG - 6 AWG	275 Lbs-In (31.1 N-m)

Side View

**(800) 824-8282 transcoil.com**

**KLRUL Reactor**  
**KLRUL— Motor Amps —**  
**3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS**  
**40C Amb Max, RoHS**  
**Use 75C CU conductors only, Term Torque—lb-in**

**TCI, LLC**  
 Germantown, WI, USA.  
 transcoil.com  
 800-824-8282

2ND CONT. SQ. 2010

DATE CODE **A1** **A2**

**B1** **B2**

**C1** **C2**

Notes:

1. UL file number: cULus Listed File E116124.
2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. Material(s) Shall be RoHS Compliant
4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
	.XX ± .25		
	.XXX ± .10		
FRACTIONAL			
	± 1/16		
ANGULAR			
	± 1°		
A	As Designed	02/25/20	JRN
NO	REVISION	DATE	BY

W132 N10611 Grant Drive  
Germantown, WI 53022

**KLRUL Y Frame**  
 Reactor Drawing, UL Listed

DRN BY JRN	DATE 02/25/20	108478DG
SCALE 1/3.5	APRVD:	SIZE C

SHT. 1 OF 1