
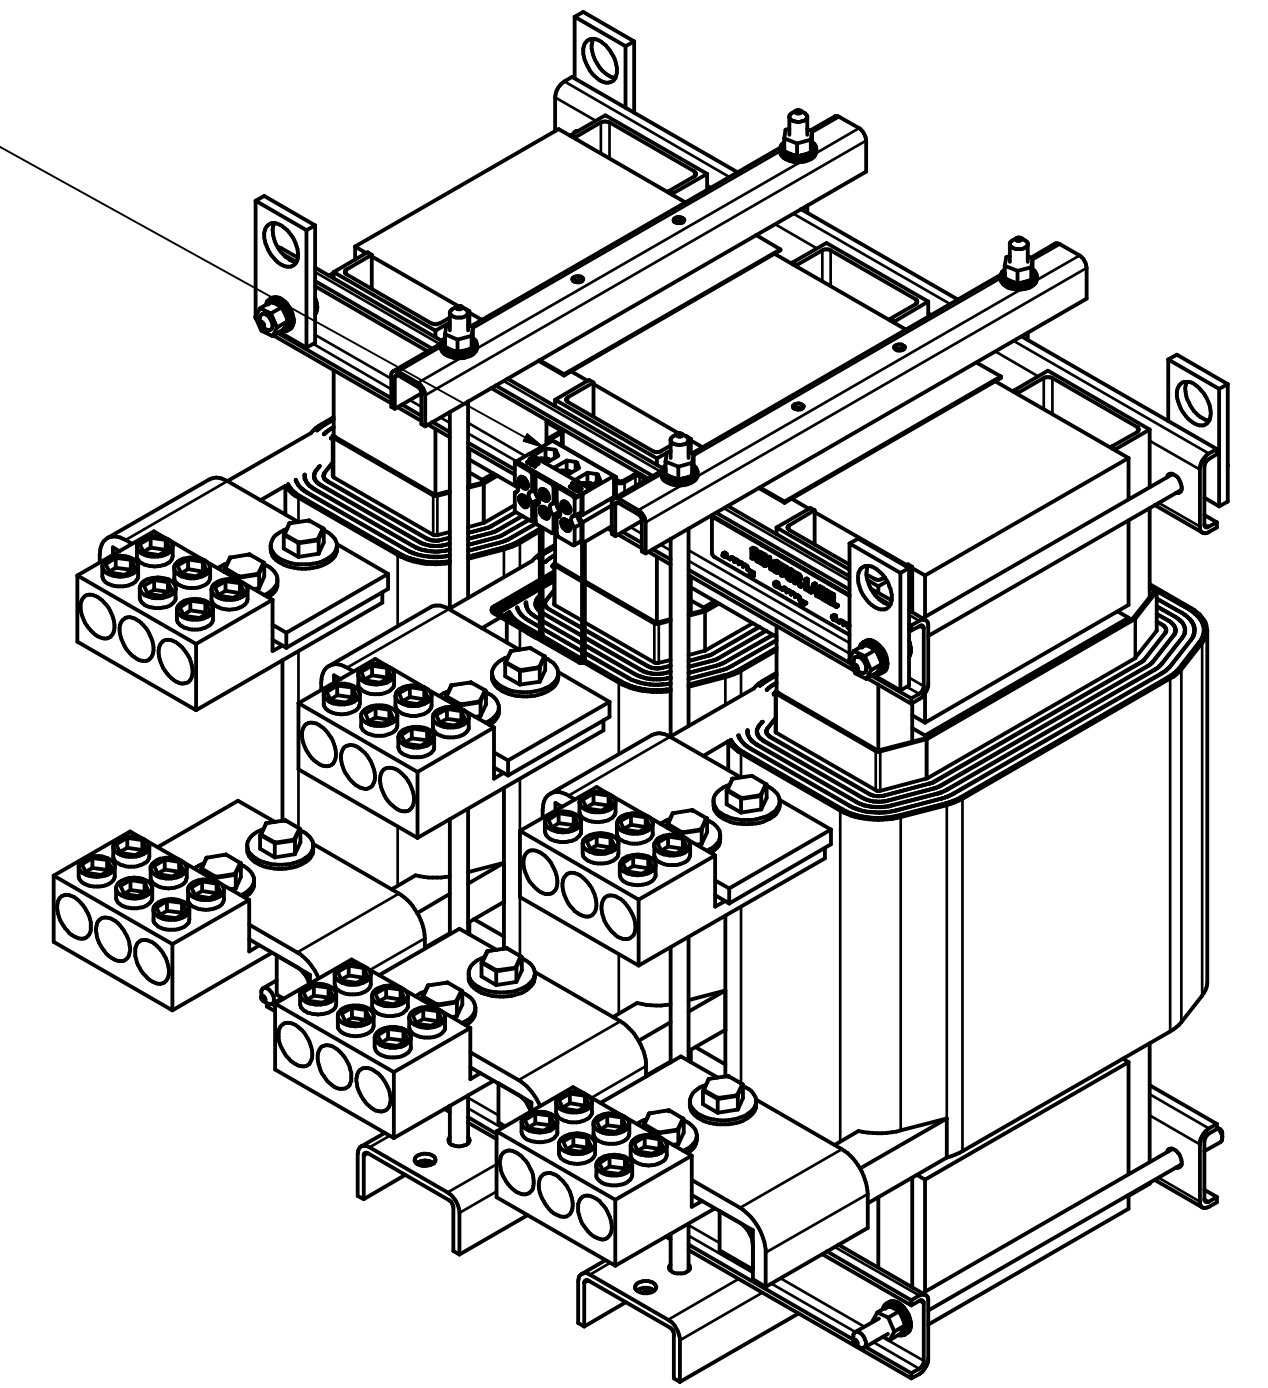
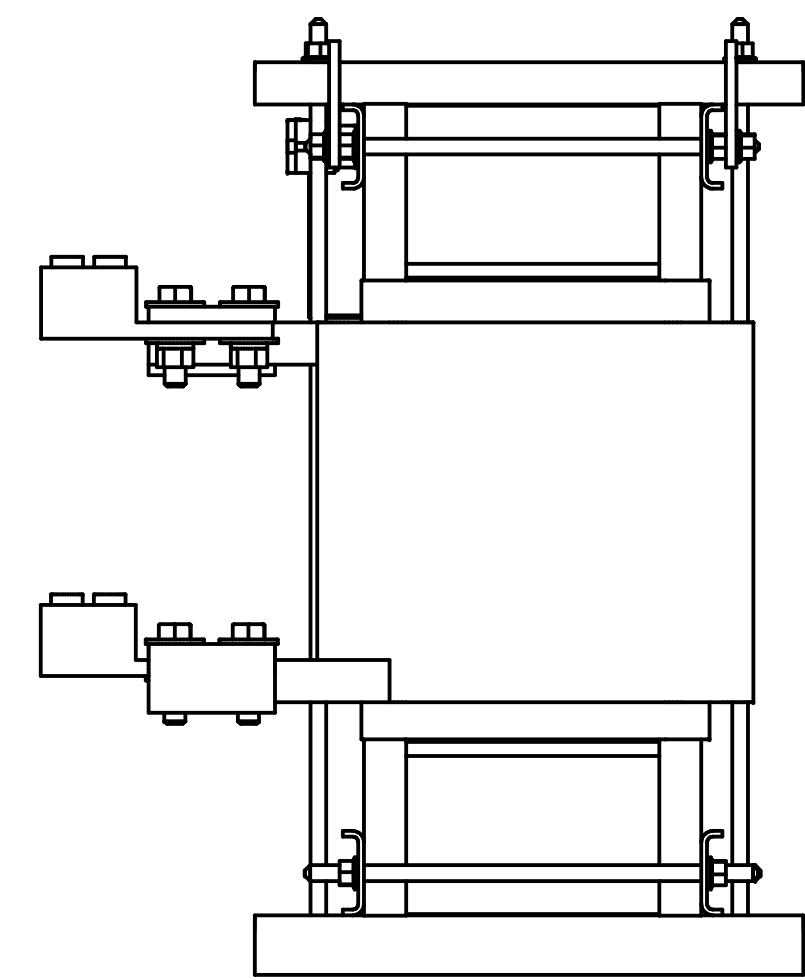
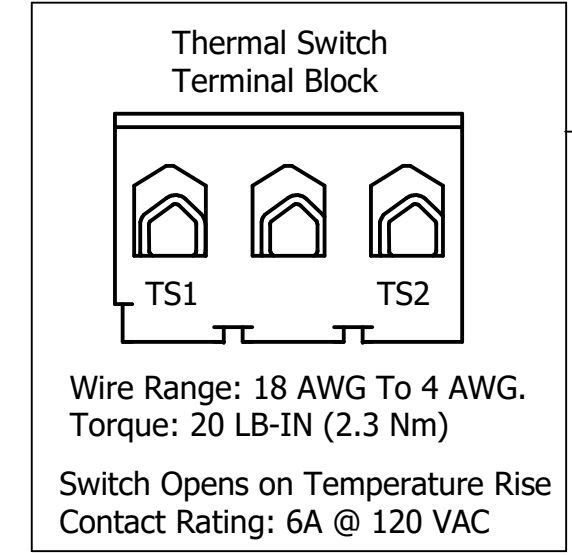
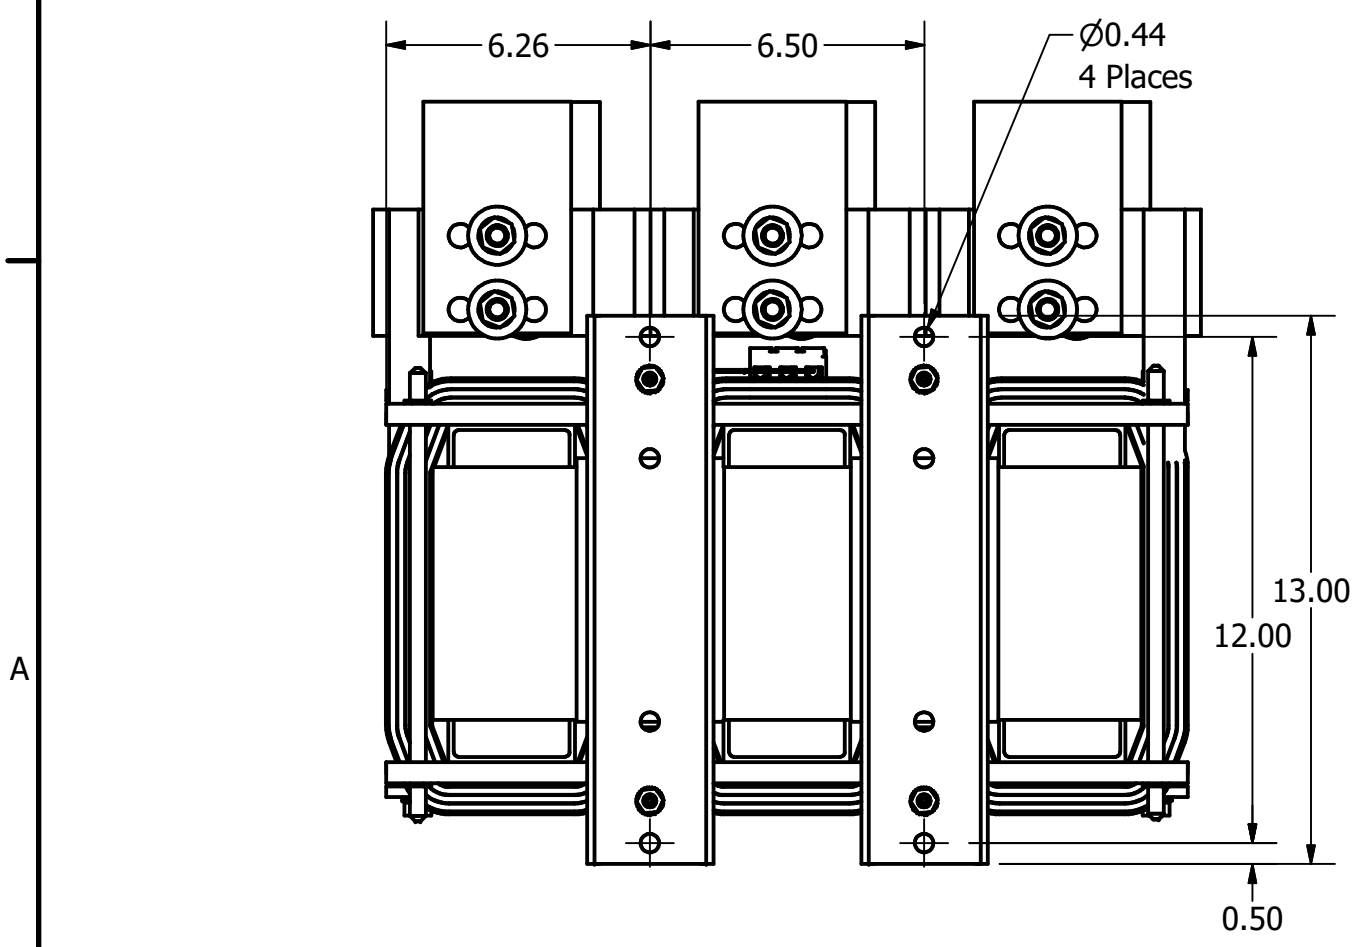
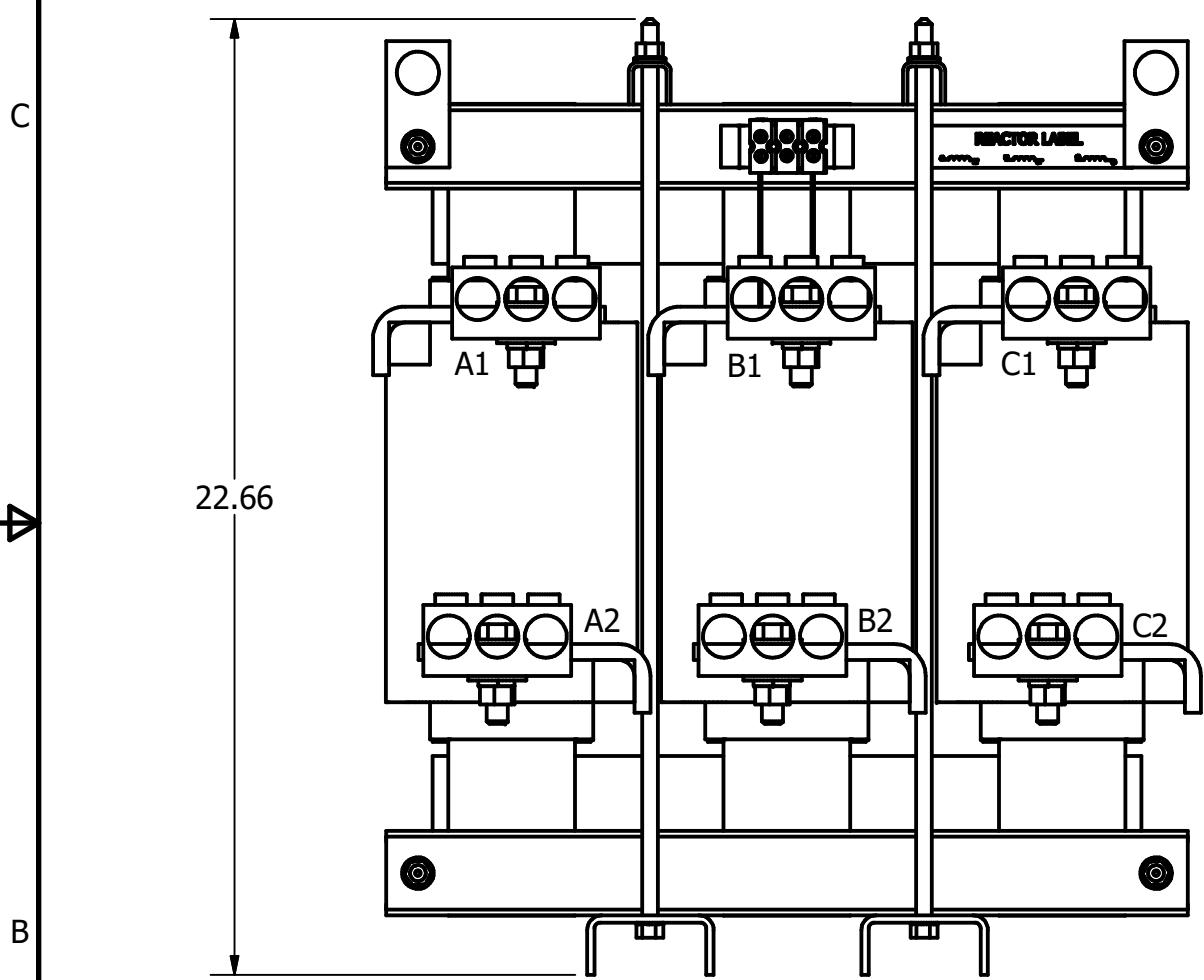


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)	Attached Lug Kit
KLRUL960APTMG	960	480	60	50	660	SLK16

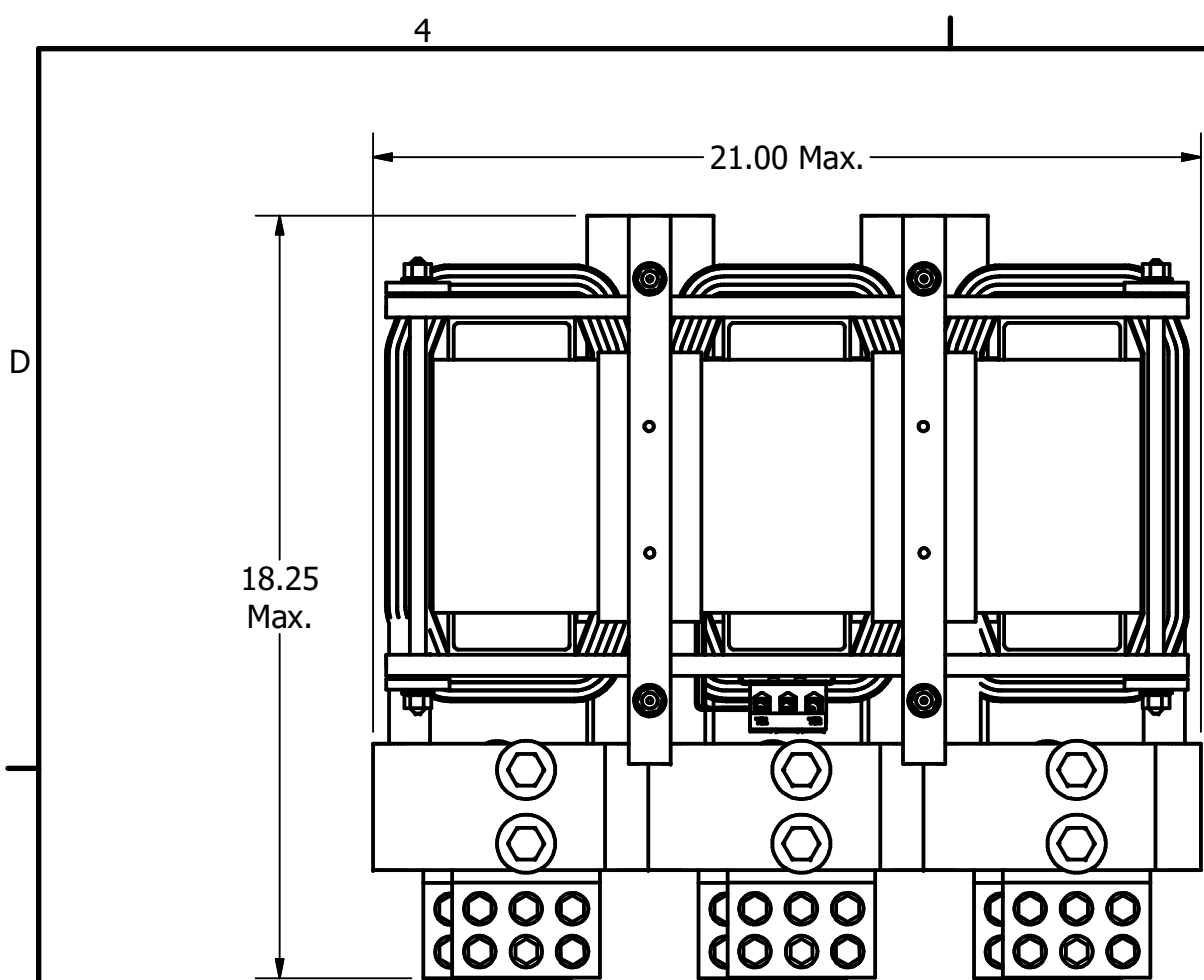

Wire Range	Tightening Torque
600MCM Thru 2 Awg	500 Lbs-In (56.5 N-m)

TCI (800) 824-8282 transcoil.com

TCI, LLC
 Germantown, WI, USA
transcoil.com
 800-824-8282

KLRUL Reactor
 KLRUL Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS
 40C Amb Max, RoHS
 Use 75C CU conductors only, Term Torque —lb-in

UL LISTED
 2ND COM. SQ. 3346

DATE CODE A1 B1 C1 A2 B2 C2

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. Material(s) Shall be RoHS Compliant
 4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 KLRUL Reactor, UL Listed KLRUL960APTMG, 480V	
A	As Designed	02/28/20	JRN	DRN BY JRN	DATE 02/28/20	108482DG	SIZE C
NO	REVISION	DATE	BY	SCALE 1/4	APRVD:	SIZE C	SHT. 1 OF 1