
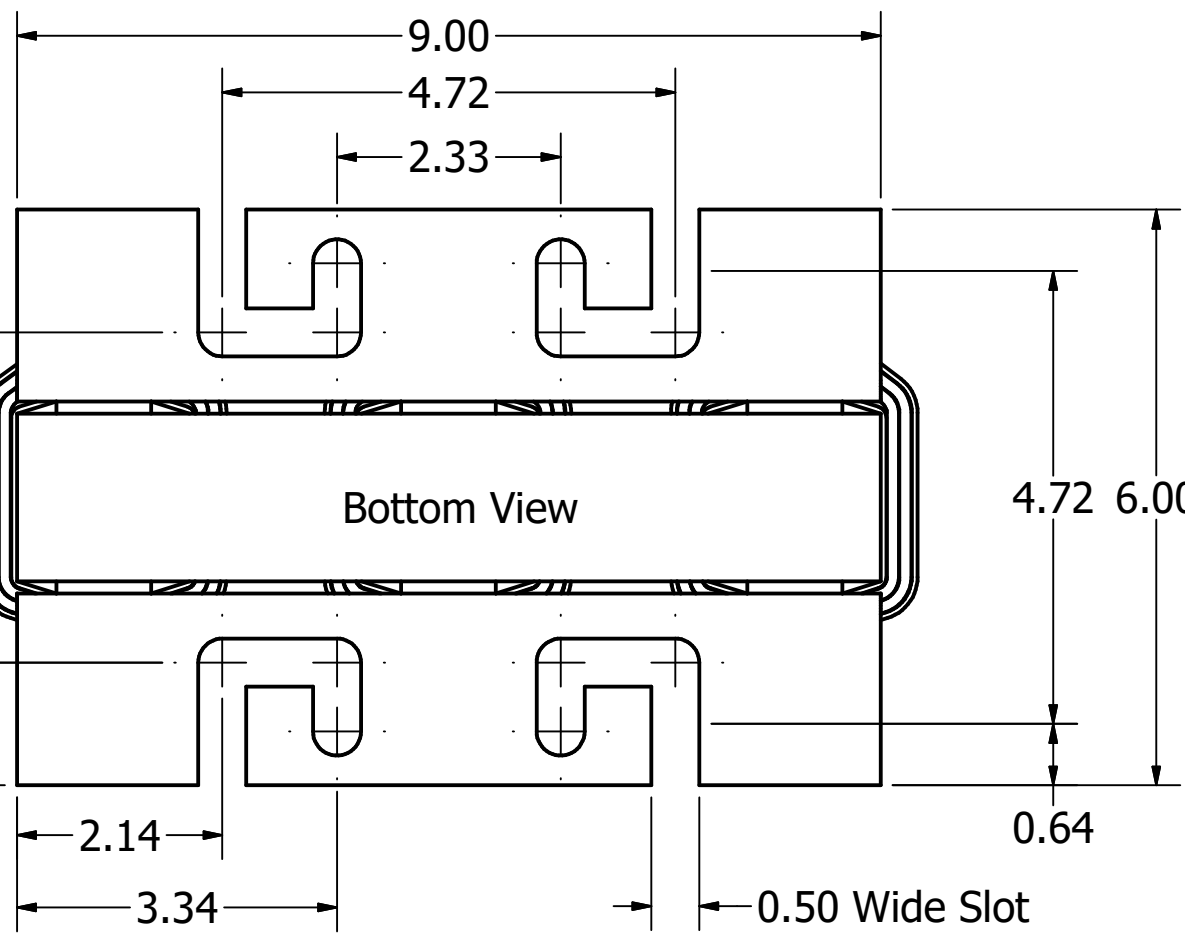
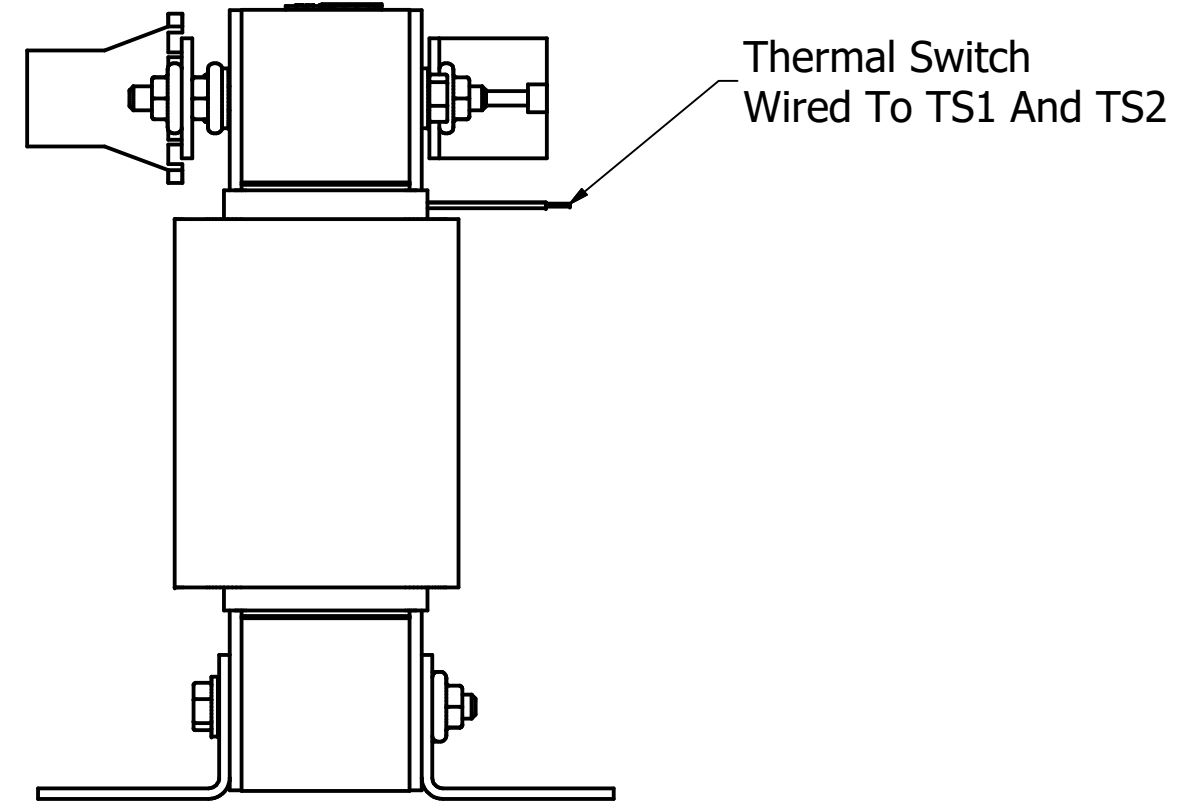


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KLRUL28CTBMG	28	600	60	2130	40

(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 1- 4 AWG. Torque : 35 LBS-IN (3.95 Nm)
 6- 14 AWG. Torque : 30 LBS-IN (3.39 Nm)
 16- 20 AWG. Torque : 25 LBS-IN (2.28 Nm)
 22 AWG. Torque : 20 LBS-IN (2.26 Nm)

Front View

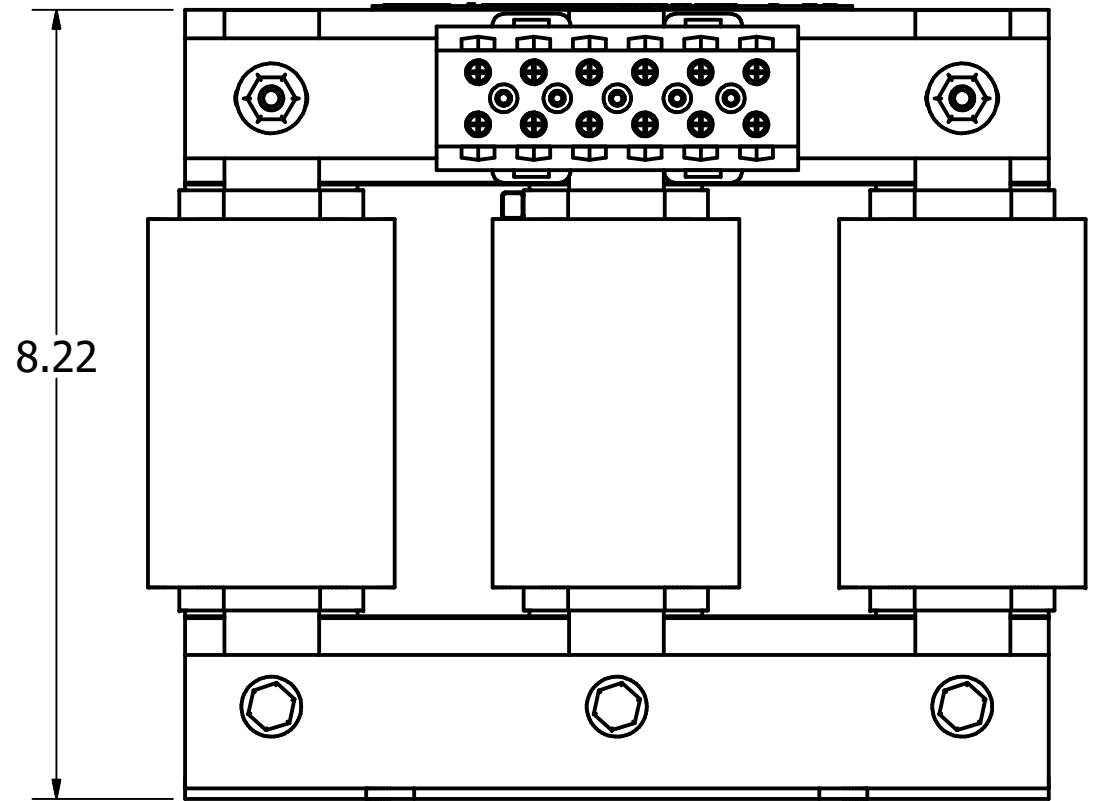

TCI (800) 824-8282 transcoll.com

TCI, LLC
 Germantown, WI, USA.
transcoll.com
 800-824-8282

KLRUL Reactor
 KLRUL— Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS
 40C Amb Max
 Use 75C CU conductors only, Term Torque—lb-in

UL LISTED CE
 2ND CONT. EQ. MARK

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. Material(s) Shall be RoHS Compliant
 4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL	TCI W132 N10611 Grant Drive Germantown, WI 53022
				.XX ± .25 .XXX ± .10	
				FRACTIONAL ± 1/16	KLRUL, 28A, 600V, Terminal Block Reactor Drawing
				ANGULAR ± 1°	
	As Designed	03/27/20	JRN	DRN BY JRN DATE 03/27/20 108524DG	
	REVISION	DATE	BY	SCALE: 1/2 APRVD: SIZE C SHT. 1 OF 1	