


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)	Attached Lug Kit
KLRUL500CPTMG	500	600	60	120	500	SLK14
KLRUL600ACTMG	600	600	60	100	500	SLK14





Thermal Switch Terminal Block

Wire Range: 18 AWG To 4 AWG.
Torque: 20 LB-IN (2.3 Nm)

Switch Opens on Temperature Rise
Contact Rating: 6A @ 120 VAC

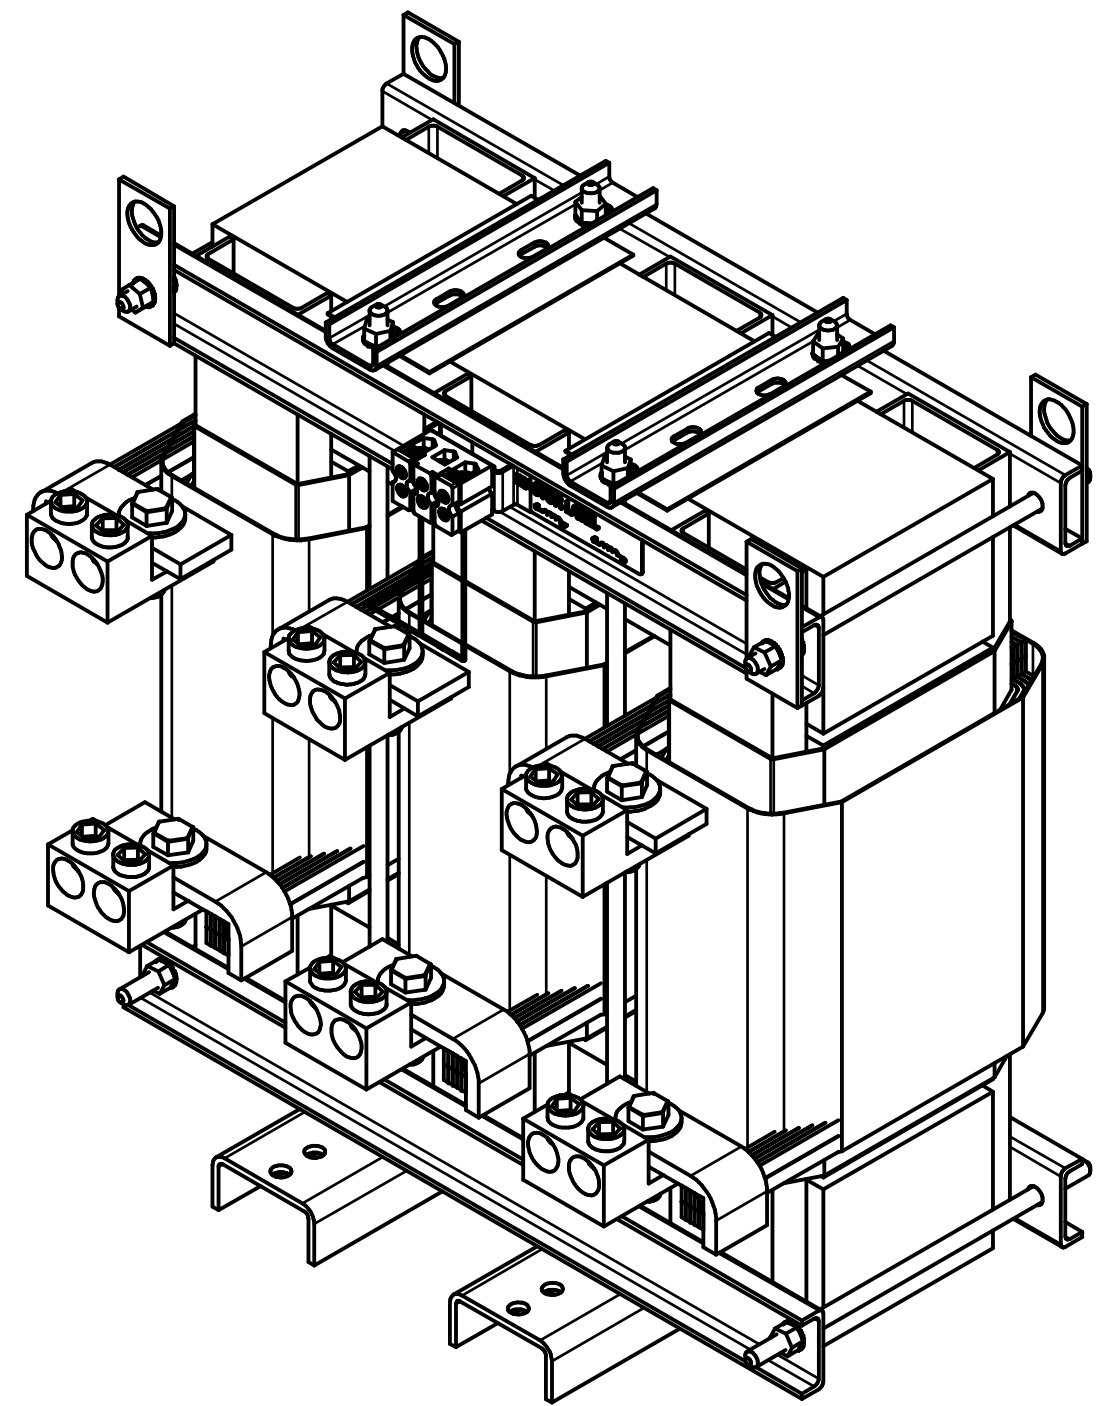

Wire Range	Tightening Torque
600MCM Thru 4 Awg	500 Lbs-In (56.5 N-m)

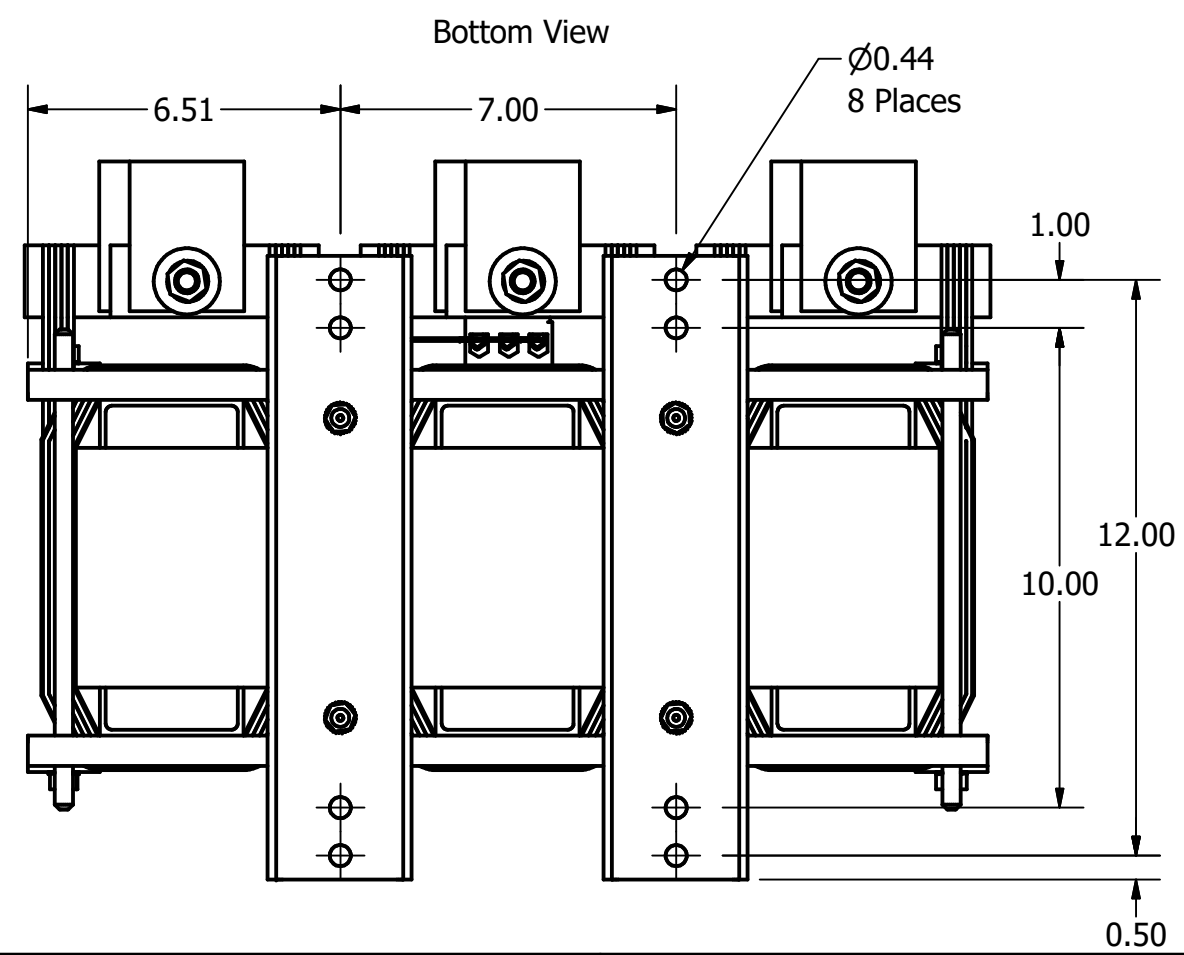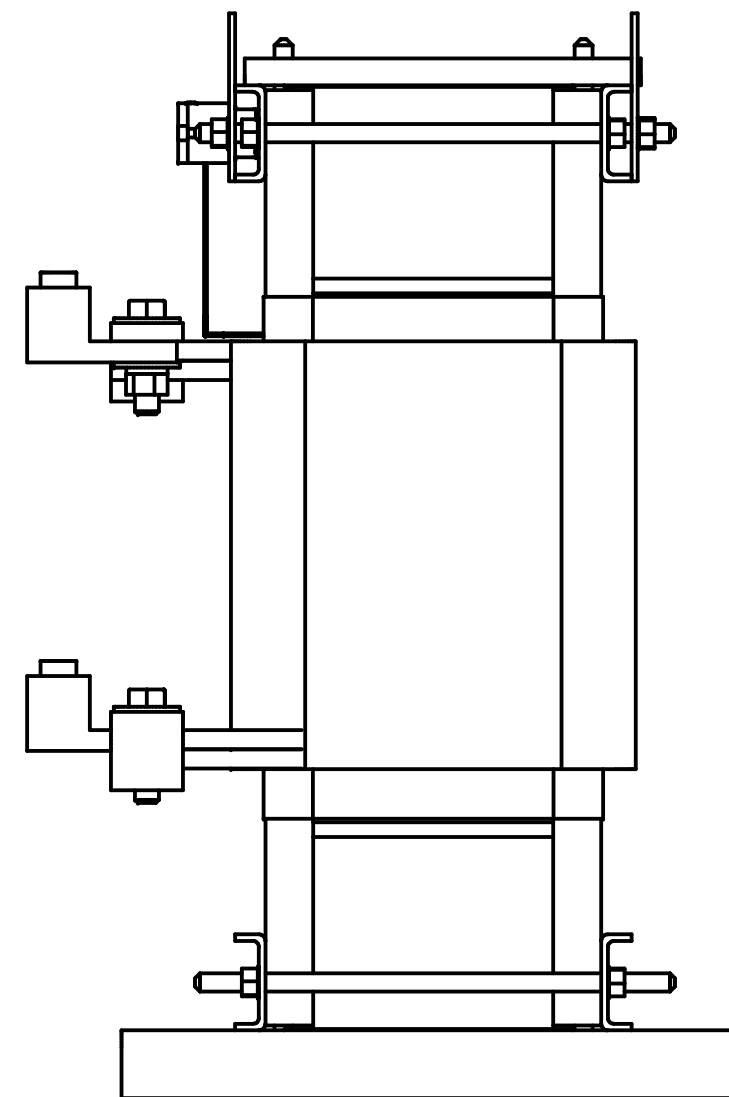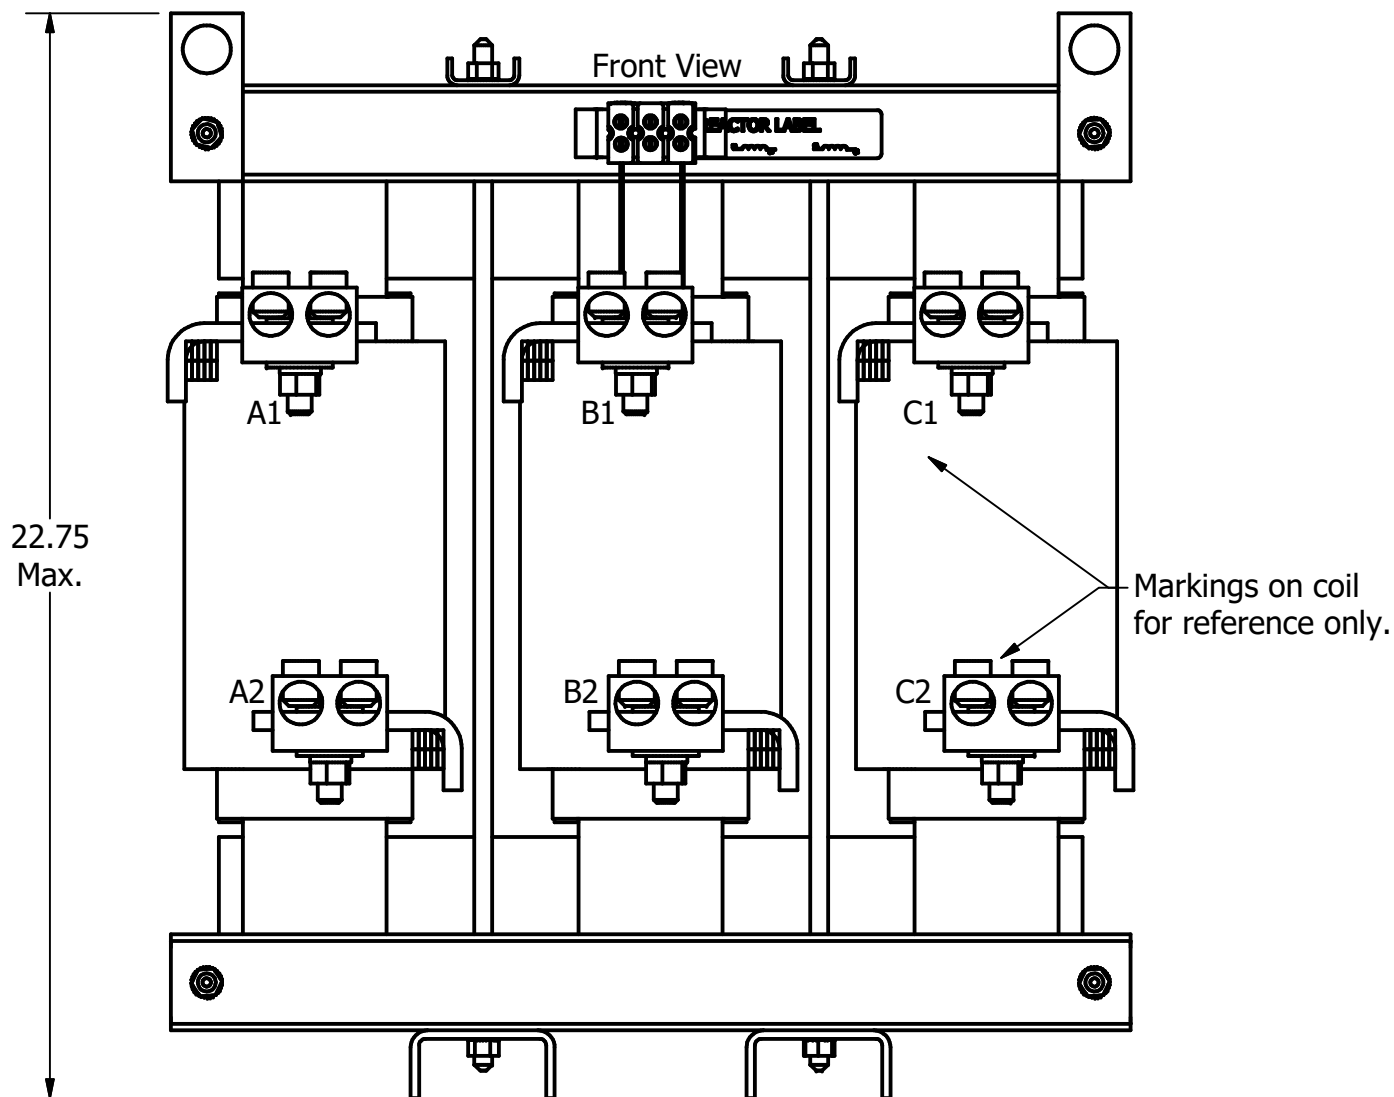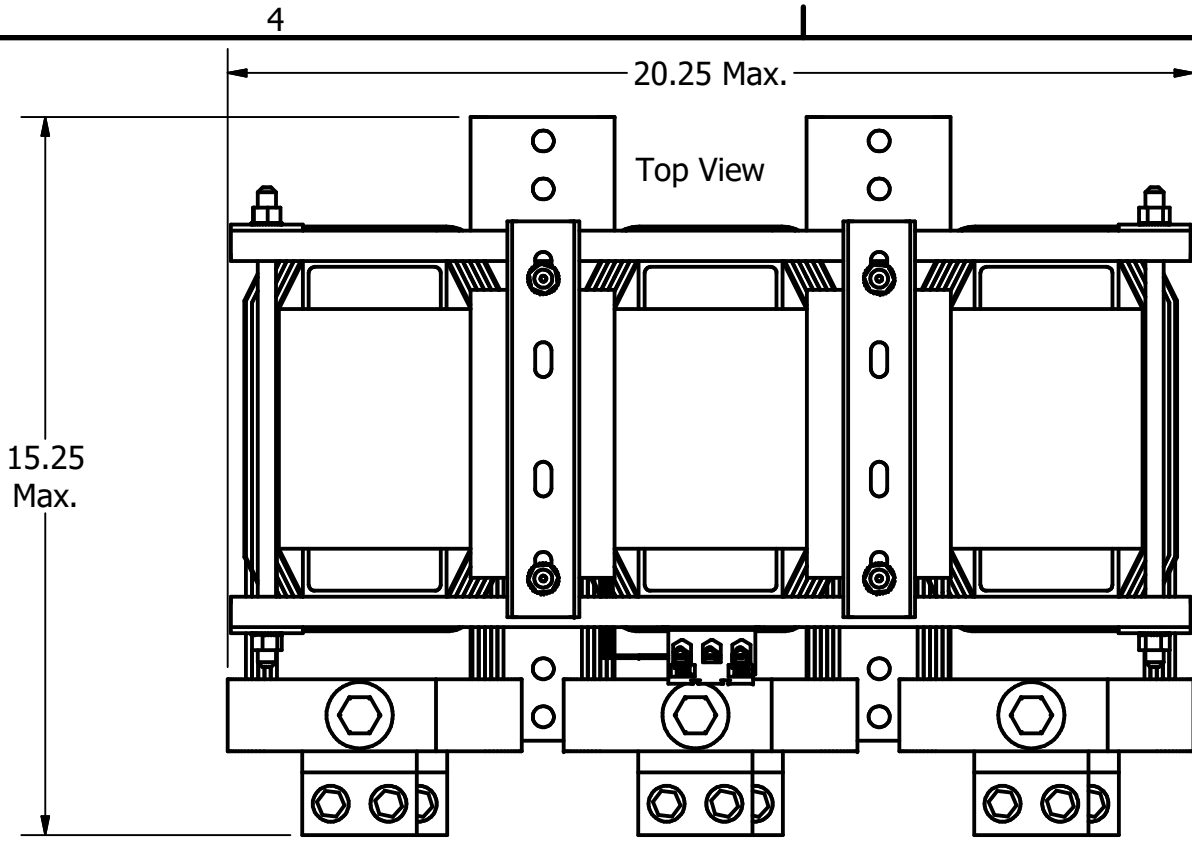

(800) 824-8282 transcoil.com

TCI, LLC
Germantown, WI, USA.
transcoil.com
800-824-8282

UL US LISTED
3RD CONT. SQ. 3346

CE

KLRUL Reactor
KLRUL— Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max, RoHS
40C Amb Max
Use 75C CU conductors only, Term Torque—lb-in

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. UL file number: cULus Listed File E116124.
 2. KLR Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. Material(s) Shall be RoHS Compliant
 4. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 KLRUL Y Frame, Power Terminal Reactor Drawing, UL Listed DRN BY JRN DATE 03/17/20 108528DG SCALE 1/4 APRVD: SIZE C SHT.1 OF 1	
A	As Designed	03/17/20	JRN				
NO	REVISION	DATE	BY				