
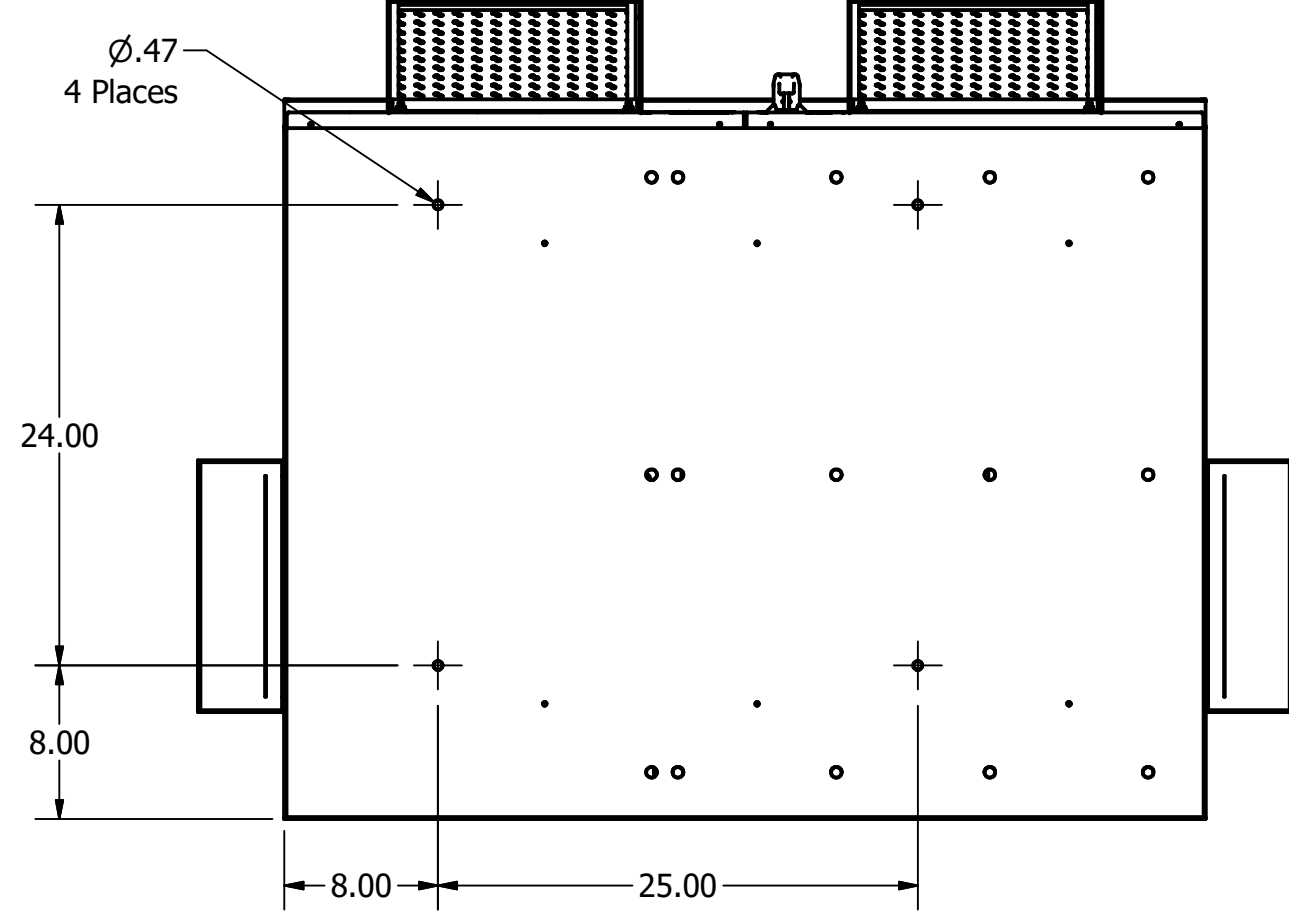
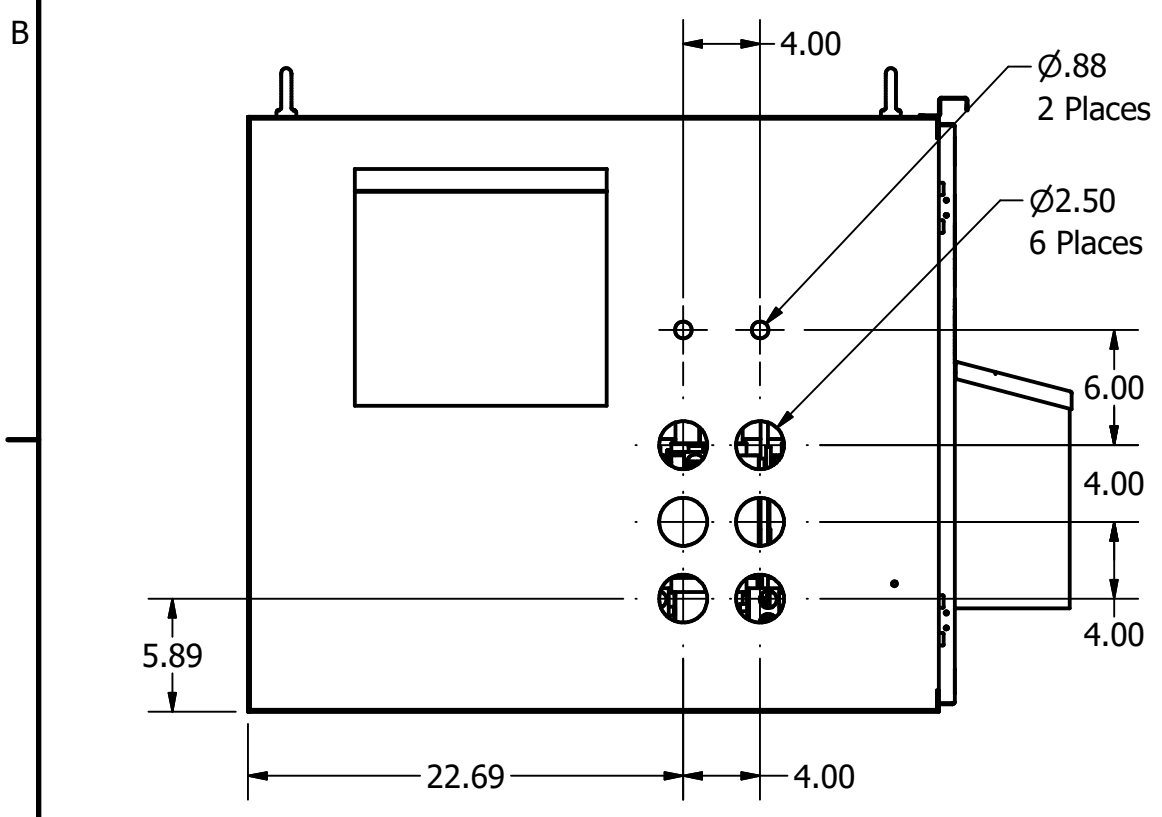
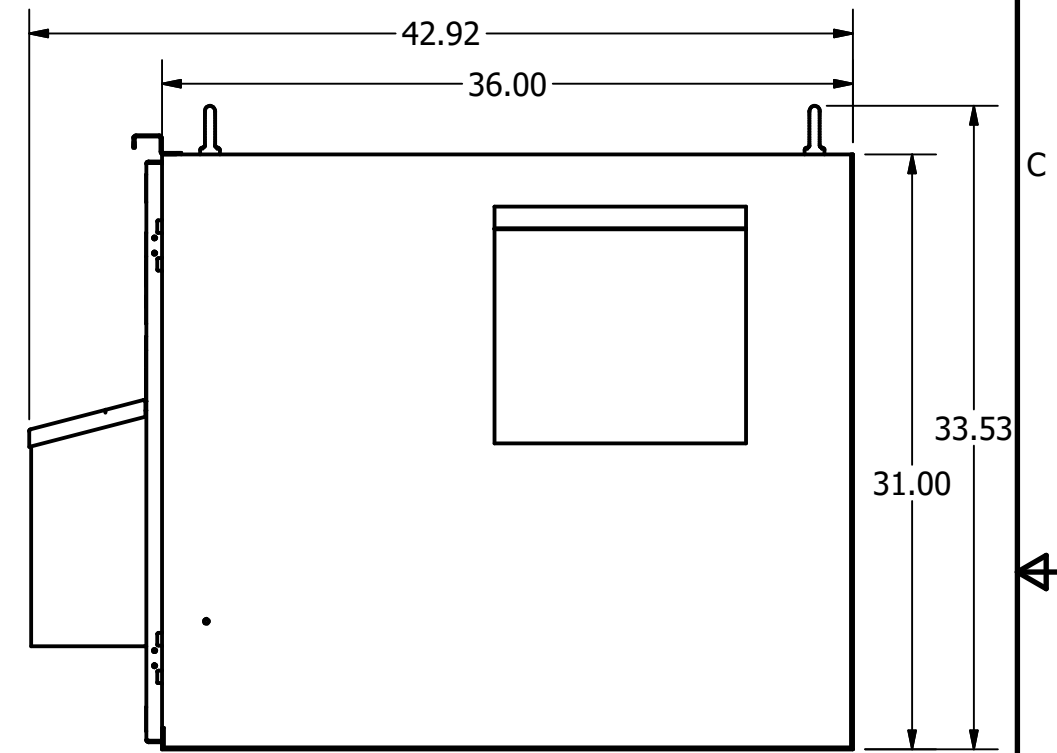
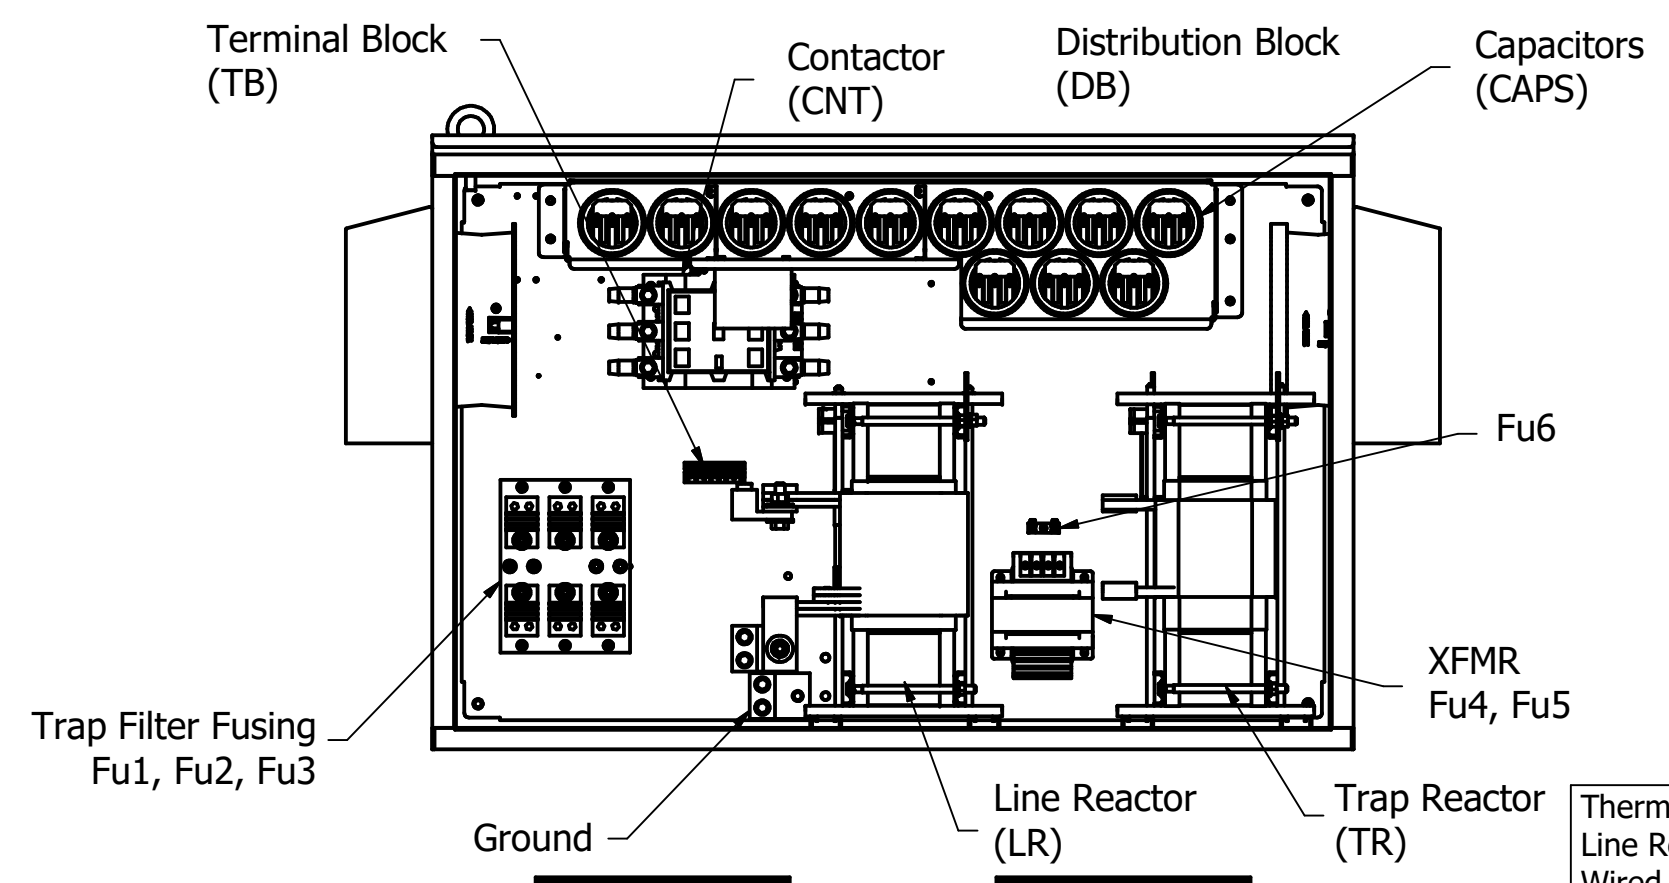
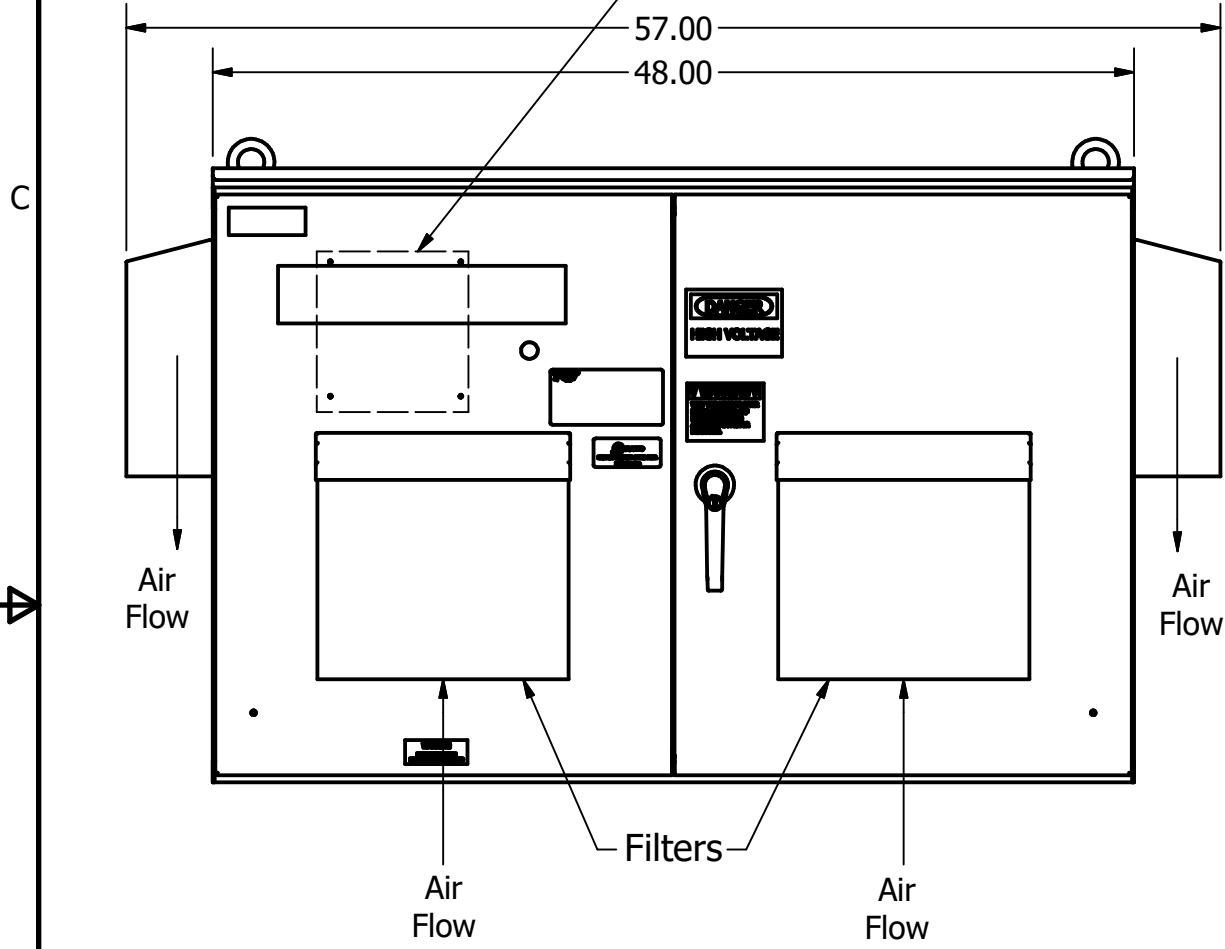
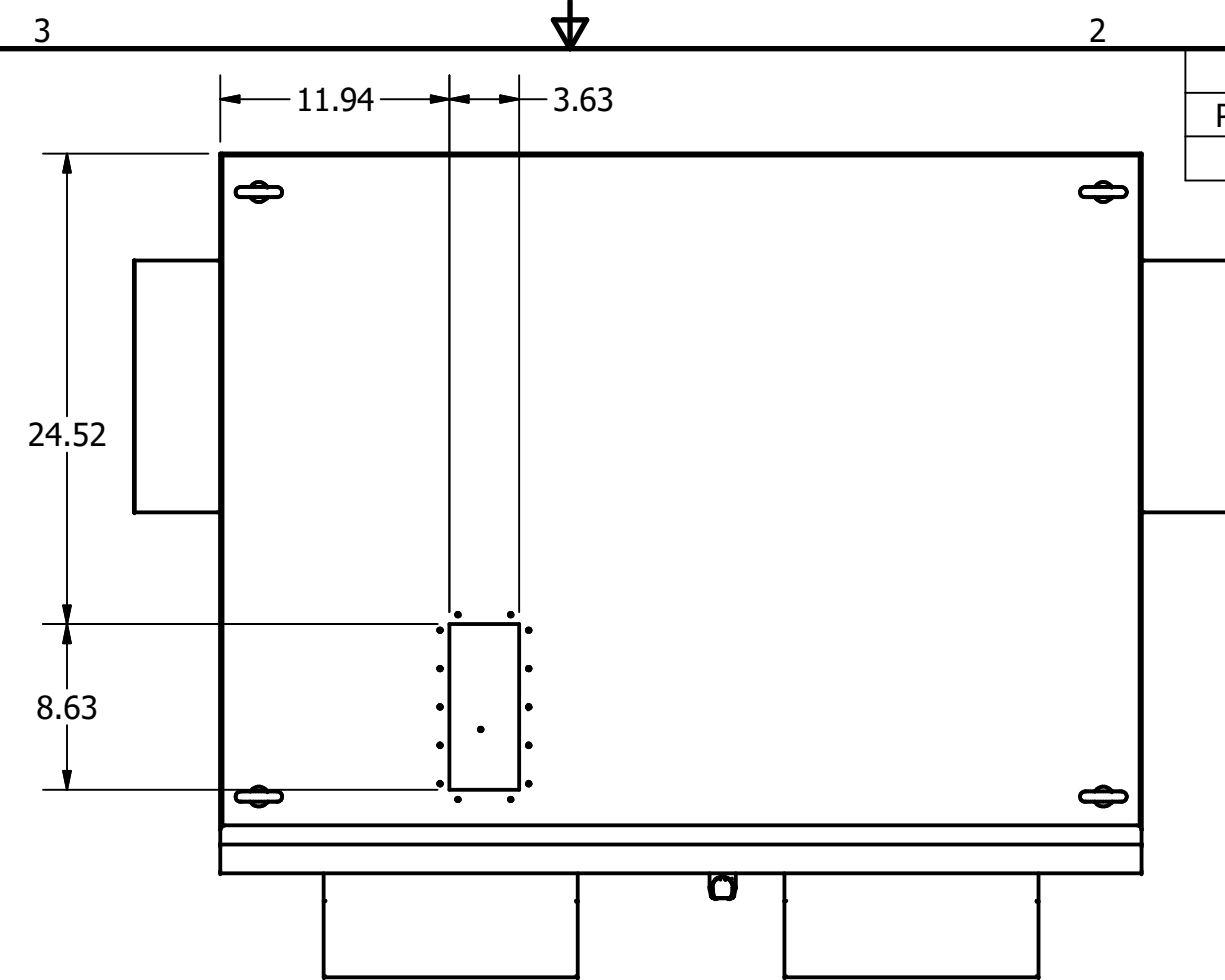


UNIT SPECIFICATIONS							
Part Number	kW	KVAR	Max Amps	HARMONIC	VOLT	Hz	PHASE
108643-01	355	139	640	5TH	380-415	50	3

SCHMATIC : 31582

- Notes:
1. Customer is responsible for installation to meet all national and local electrical codes.
  2. Use only hubs or fittings that comply with UL514B for type 3R enclosures.
  3. cULus Listed UL 508A File E140832
  4. Enclosure Color: RAL 7006 Beige Grey
  5. Approx. WT LBS : 1200

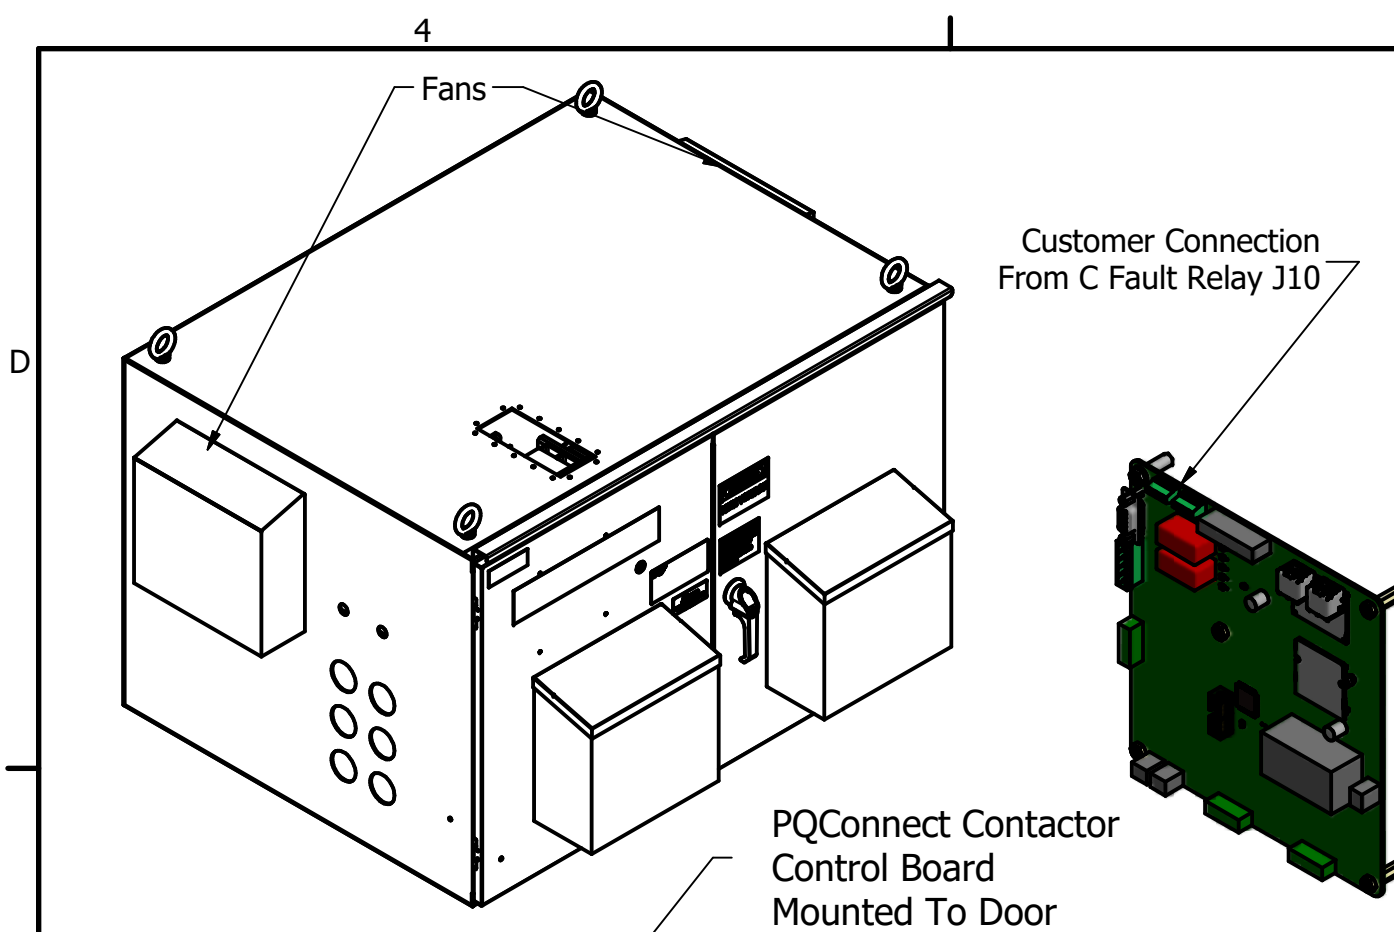

Thermal Switches Installed In Line Reactor And Tuning Reactor Wired To PQconnect For Monitoring

GROUND LUG:  
WIRE RANGE - TWO 600MCM-2  
TIGHTENING TORQUE 500 LB-IN.

L1 L2 L3 T1 T2 T3  
CUSTOMER CONNECTIONS:  
WIRE RANGE - TWO 600MCM-2  
TIGHTENING TORQUE 500 LB-IN.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 HarmonicGuard Passive 355kW, 380-415/3/50, Type 3R, JCI, PQconnect, 377-67728-001
				DECIMAL	
				.XX ± .25 .XXX ± .10	
	B	5464 Added .88 Holes	12/04/20	JRN	
				ANGULAR ± 1°	DRN BY JRN DATE 11/10/20
					SCALE 1/10 APRVD: 108643-01DG
	NO REVISION	DATE	BY		SIZE C SHT 1 OF 1