

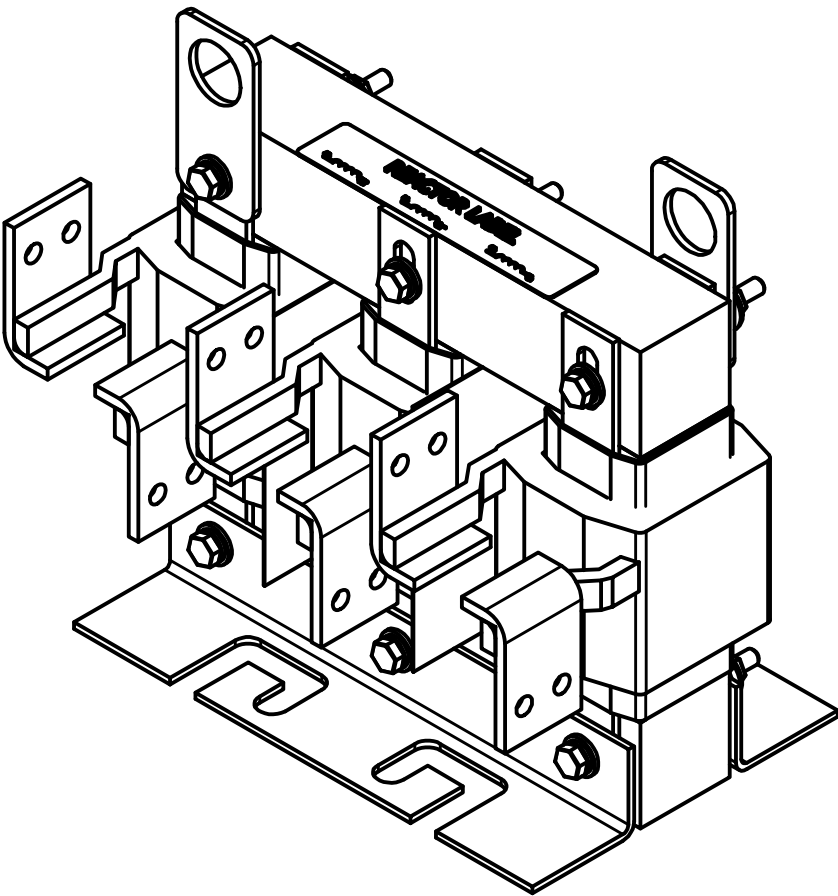
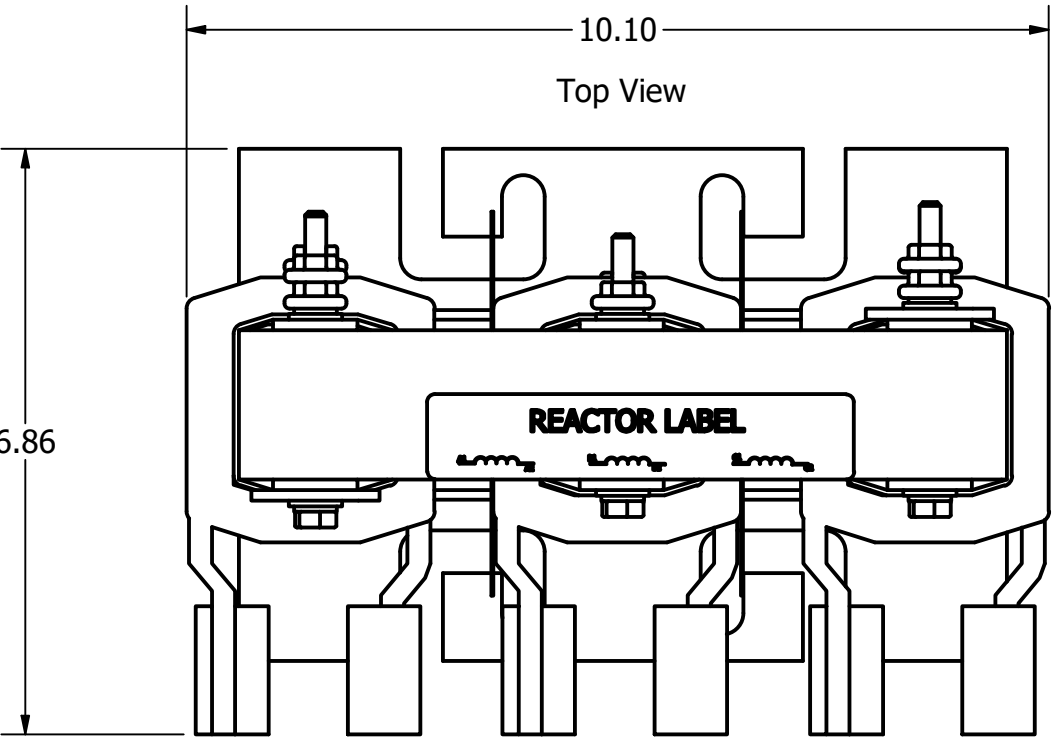
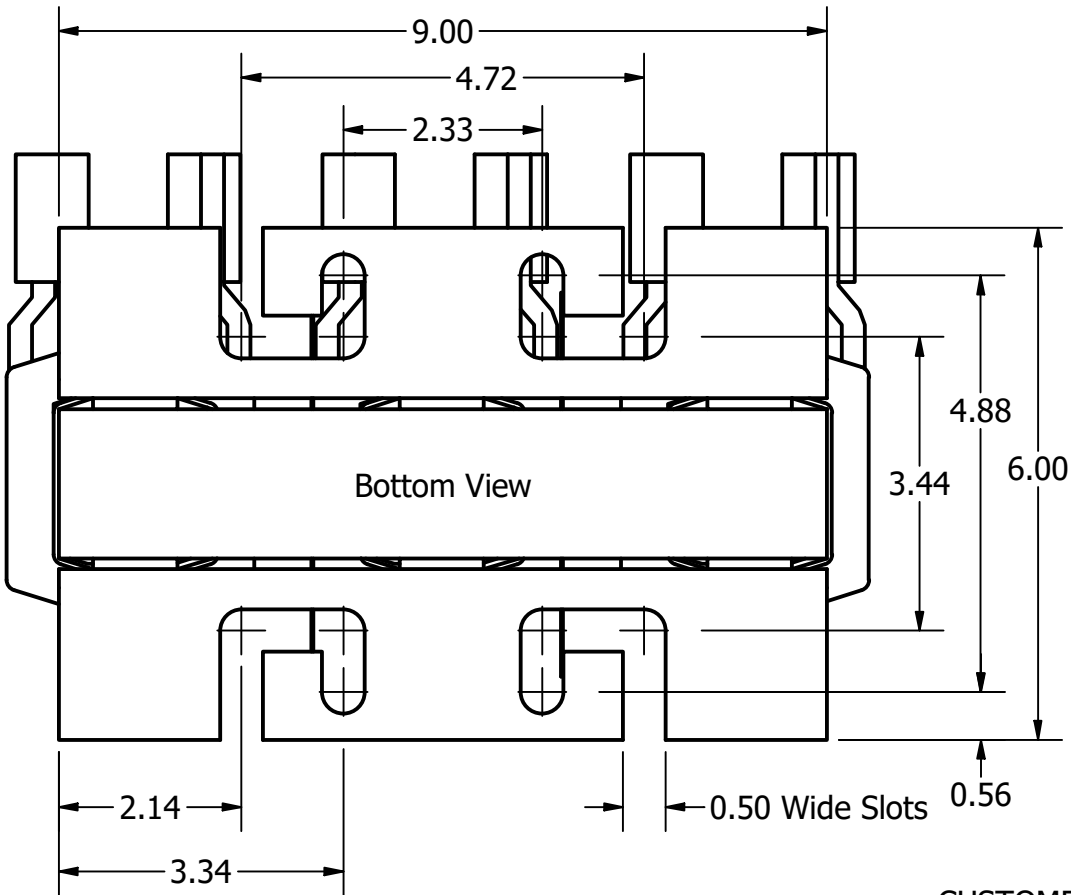


TCI Part#	Motor Amps (A)	Maximum Amps (A)	Total Loss (W)	--mH±10%	Weight (LBS)	Terminal Hole Size (Inches)	Available Lug Kit
KDRI2Q	160	160	86	0.036	55	0.31	SLK21
KDRI3Q	200	200	113	0.036	55	0.31	SLK22
KDRI4Q	250	250	185	0.036	55	0.31	SLK22


- Notes: 1. UL file number: cULus Listed File E116124.
2. V1K Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. V1K IOM Manual Part Number 25316
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

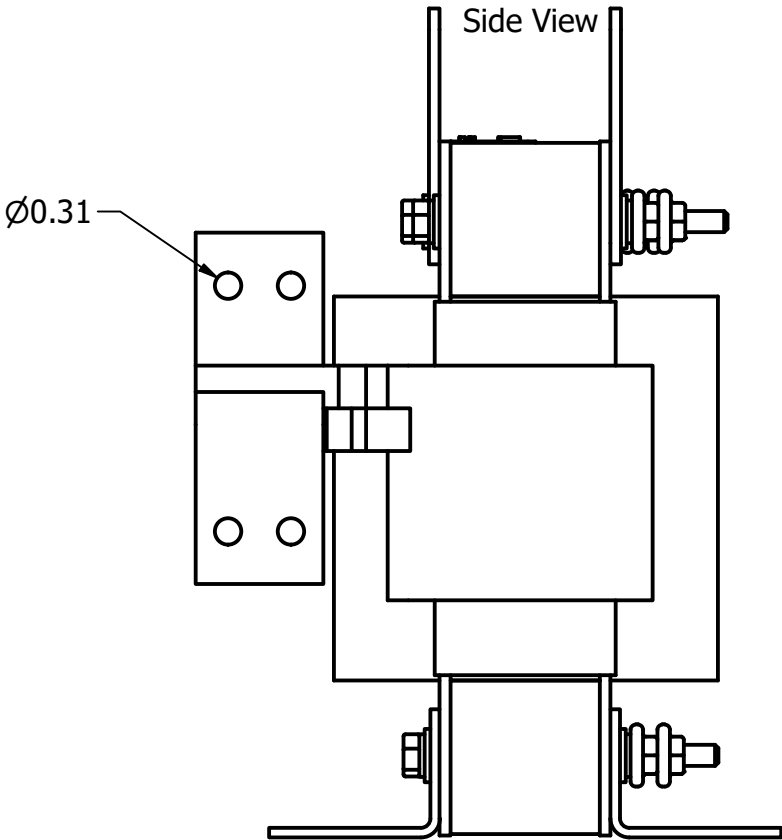


Front View

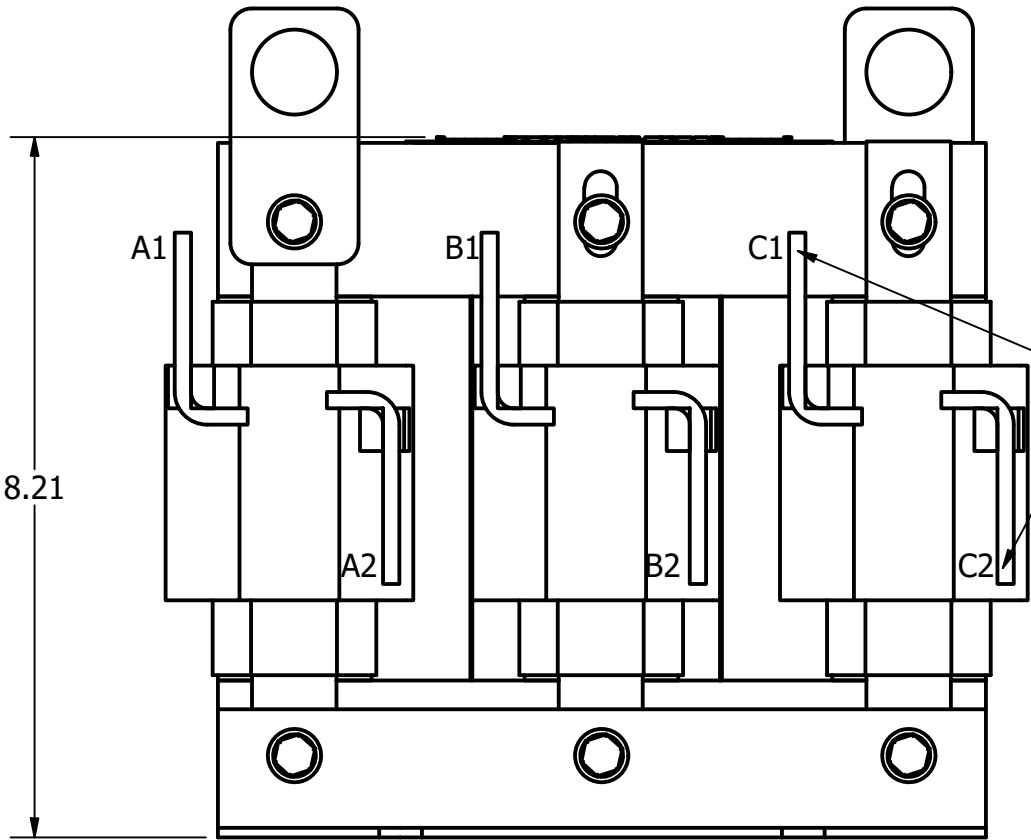

V1K SCHEMATIC

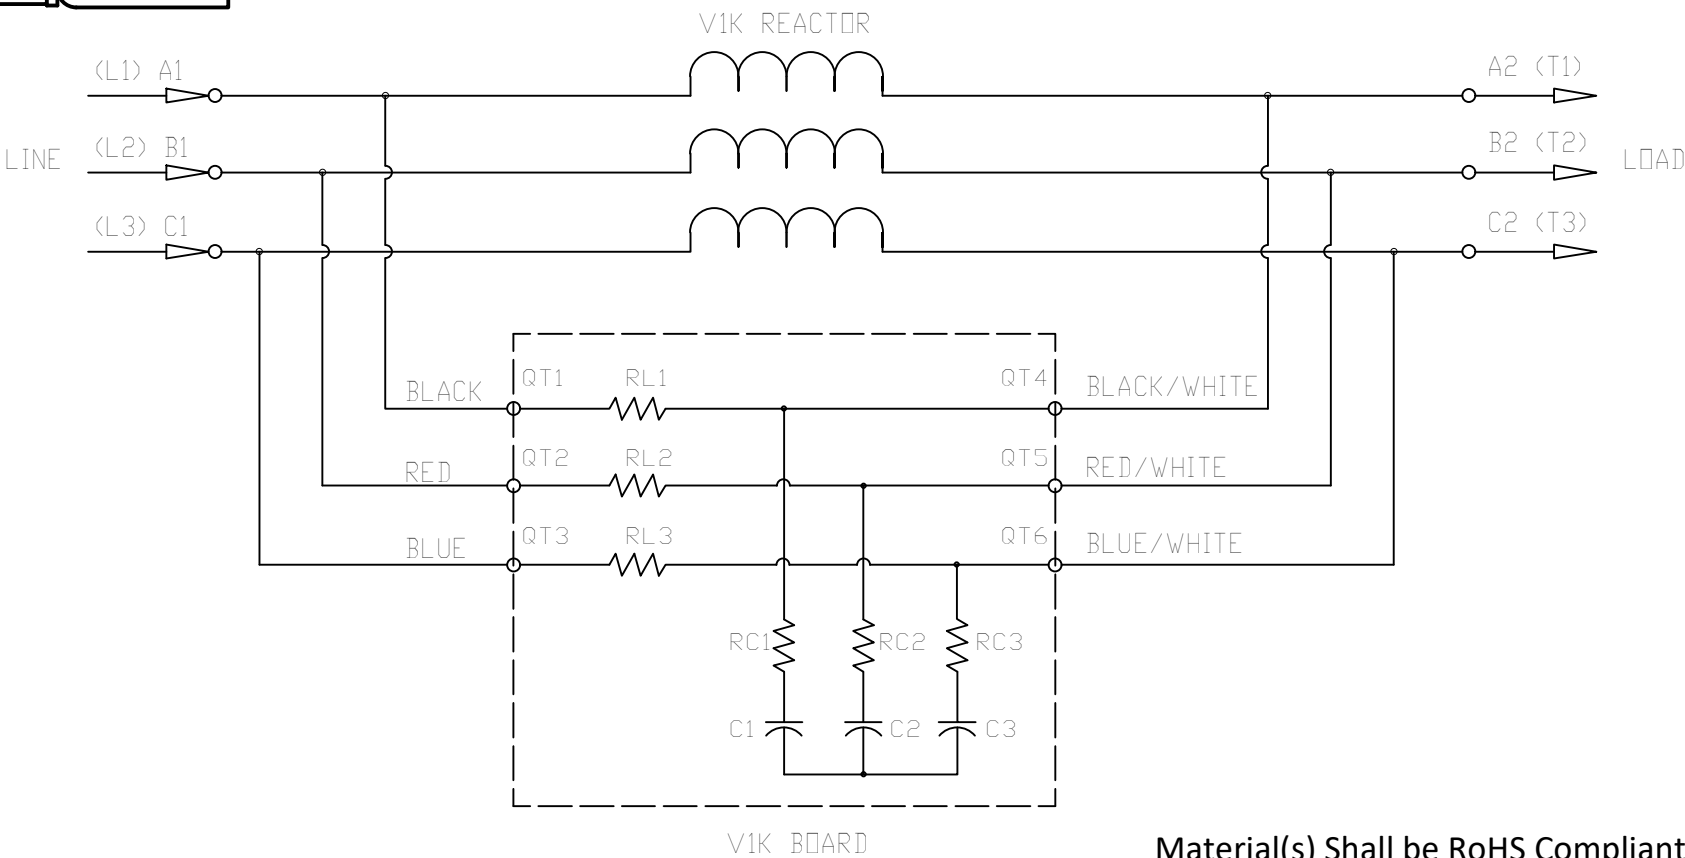

Material(s) Shall be RoHS Compliant

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.					TOLERANCES (EXCEPT AS NOTED)	 W132N10611 Grant Drive Germantown, WI 53022 © 2022 TCI, LLC
					DECIMAL	
					.XX ± .25 .XXX ± .10	
					FRACTIONAL ± 1/32	
					ANGULAR ± 1°	
A	As Designed	06/21/2022	GJS		DRN. BY: GJS SCALE: 1:2	DATE: 06/21/2022 APRVD: SIZE: C
NO	REVISION	DATE	BY			109187
						SHT. 1 OF 1

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.