
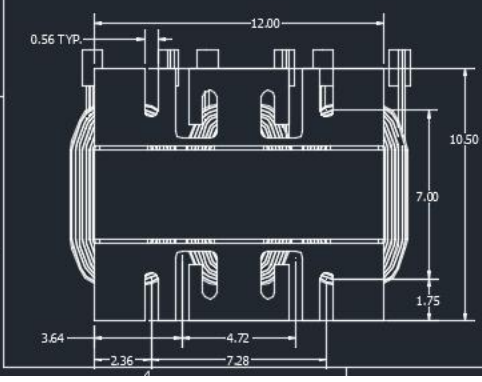
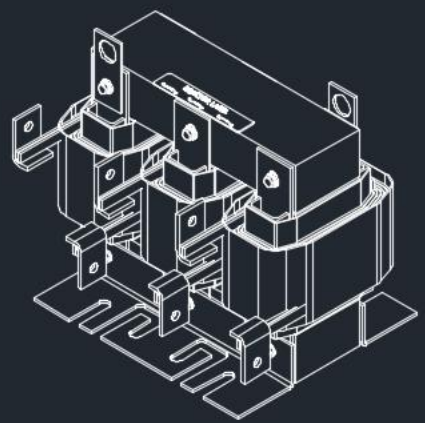
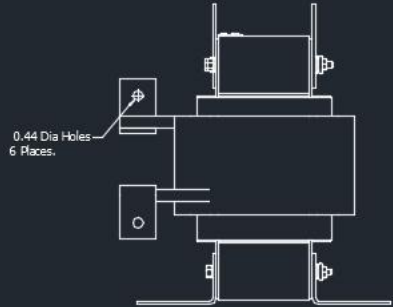
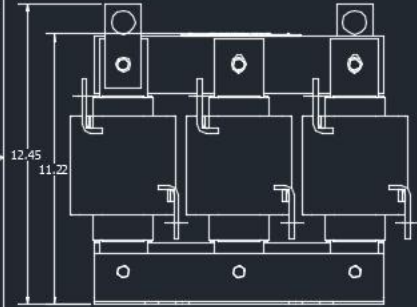


TCI PART#	RATED AMPS (A)	--mH ^{+8%} _{-2%}	APPROX WT-LBS
KTR60A65HL	152	0.429	150

System Voltage 480v, 292Hz.

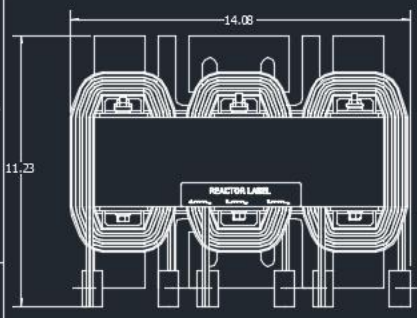

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THERE IN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY	QTY
A	AS DESIGNED	3/27/17	DSW	1

	W132 N11061 Grant Drive Germantown, VM 53022						
	KTR TUNING REACTOR (400HP) KTR60A65HL, 152 AMPS 480 VOLTS						
<table border="1"> <tr> <td>DATE</td> <td>BY</td> <td>QTY</td> </tr> <tr> <td>3/27/17</td> <td>DSW</td> <td>1</td> </tr> </table>	DATE	BY	QTY	3/27/17	DSW	1	106192DG SHEET 1 OF 1
DATE	BY	QTY					
3/27/17	DSW	1					