

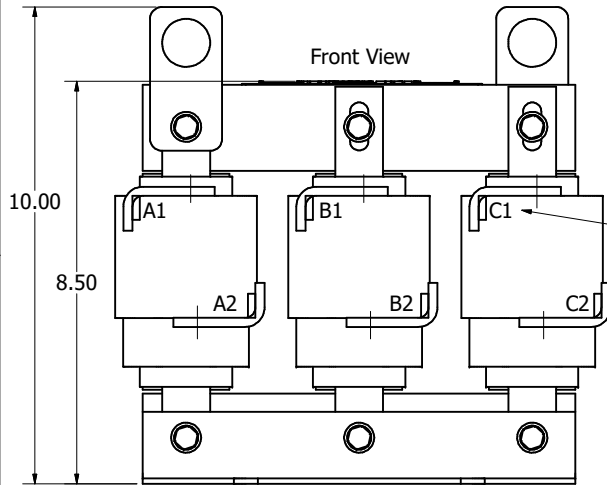
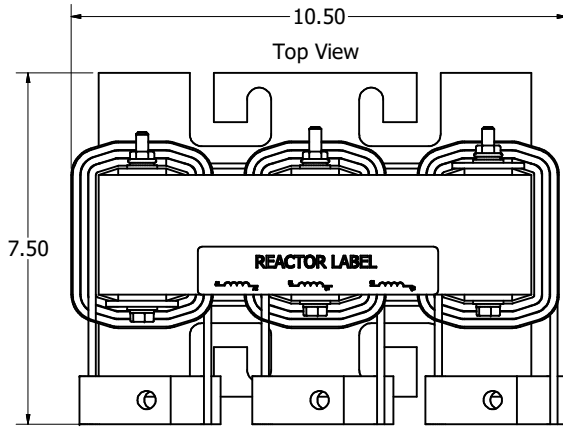
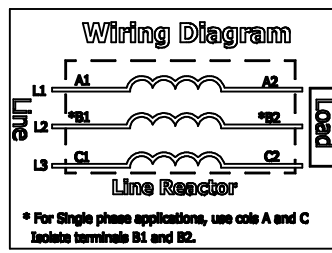
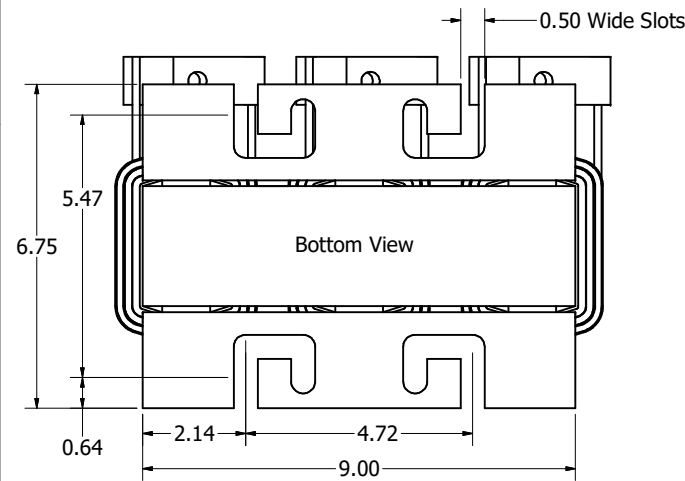


Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG45HV	150	144	155	326	400	65	SLK11	0.44

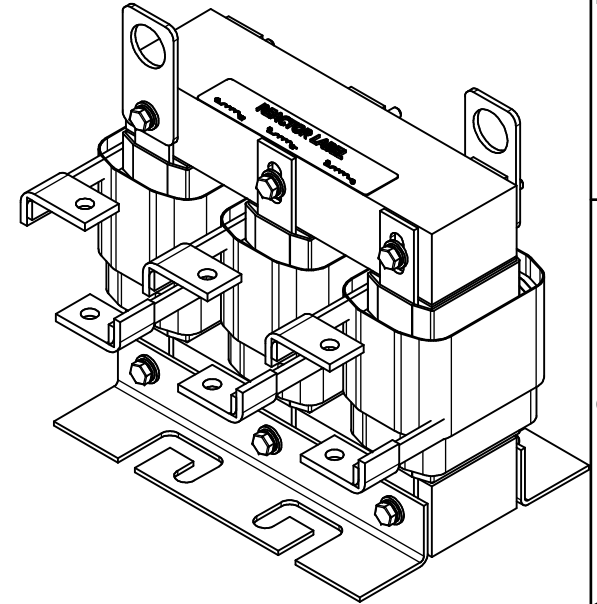

(Customer Connections) Markings On Coils For Reference Only.

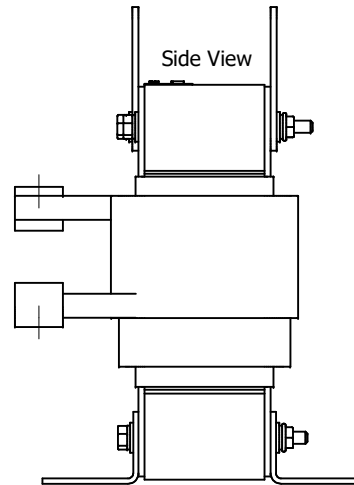

TCI (800) 824-8282 transcoll.com

TCI, LLC
Germantown, WI, USA
transcoll.com
800-824-8282

KDR/L Drive Reactor
KDR - Motor Amps ---
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max
40C Amb Max, 155C Max, RoHS
Manual #30895 LUG KIT #SLK---

UL LISTED CE
cULus LISTED

DATE CODE A1 A2 B1 C1 C2

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		TCI An Official Motors Company KDR G Frame, 690V Reactor Drawing	
				DECIMAL	.XX ± .25 .XXX ± .10	W132N10611 (Rev 13 Feb 2024) Germantown, WI 53022 © 2024 TCI, LLC	
B	6708, Update Views	6/24/2024	DSW	FRACTIONAL	± 1/32	DRN BY: DSW	DATE: 02/05/2007
A	4472 Add Lift Rings	8/22/2018	DSW	ANGULAR	± 1°	SCALE: 1/2	103100DG
NO	REVISION	DATE	BY				