

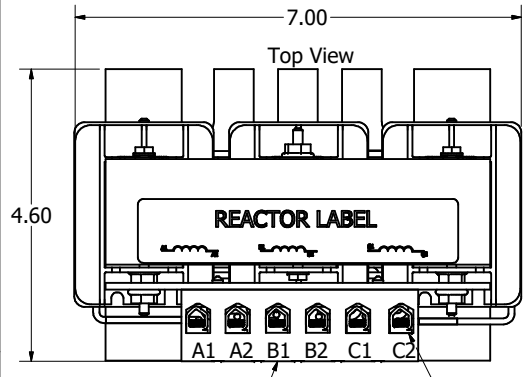
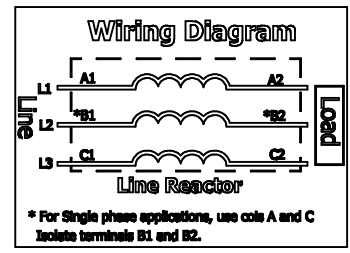
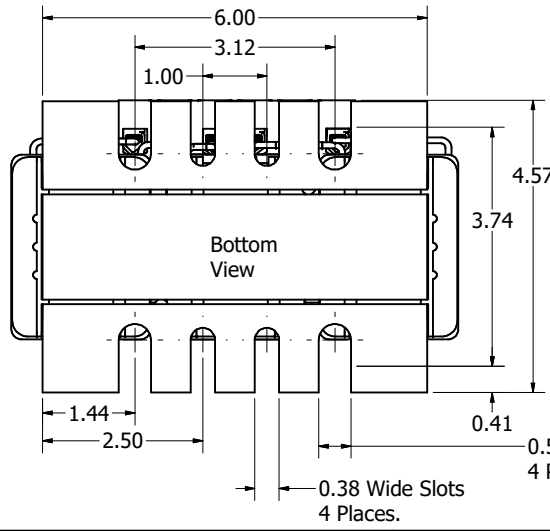
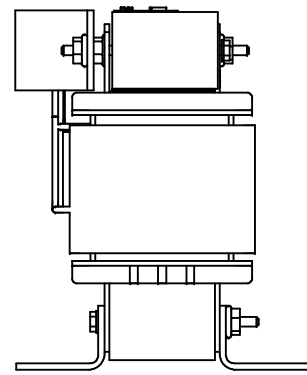


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.					
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)
KDRE42H	30	32	32	1430	16

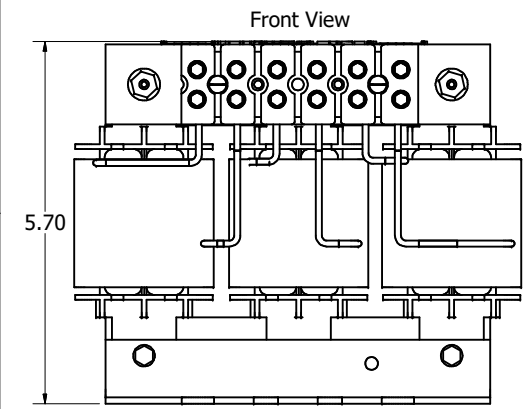

(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 4-18 AWG.  
Torque : 20 IN-LBS (2.3 Nm)

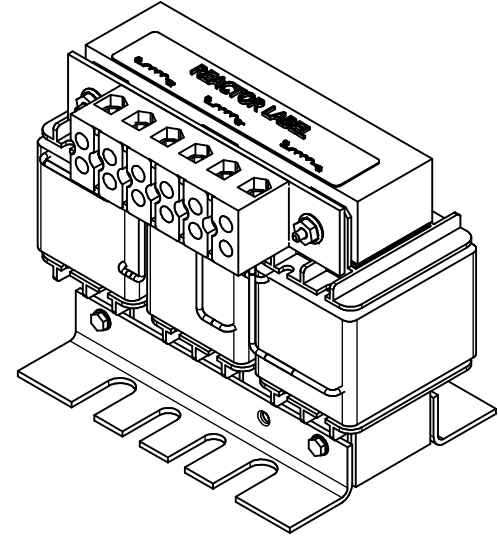

**TCL** (800) 824-8282 [transcoll.com](http://transcoll.com)

KDR/L Drive Reactor  
KDR- Motor Amps —  
30/4 50/60/72 —V Rated, 600V Max, -A Max, RoHS  
40C Amb Max, 135C Rise  
Manual #30895

UL LISTED CE  
cULus LISTED  
E116124

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
- UL file number: cULus Listed File E116124.
  - KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  - KDR IOM Manual Part Number 30895
  - Material(s) Shall be RoHS Compliant
  - Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	SCALE
D	6812, Match Revisions	9/24/2024	DSW	DECIMAL .XX ± .25 .XXX ± .10
B	4686, TB, Screws chng. to 1/8 Hex.	5/09/19	DSW	FRACTIONAL ± 1/32
A	Combined Drawings	1/22/18	DSW	ANGULAR ± 1°

**TCL** W132N10611 (Rev 13 Feb 2024)  
Germanstown, WI 53022  
© 2024 TCL, LLC

An Official Motors Company

KDR E Frame, Terminal Block  
Reactor Drawing

DRN BY: DSW DATE: DSW 107514-1DG  
SCALE: 1:1.5 DRAWN BY: CJC SHEET 1 OF 1