
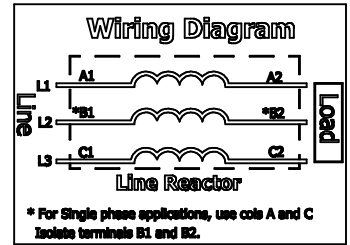
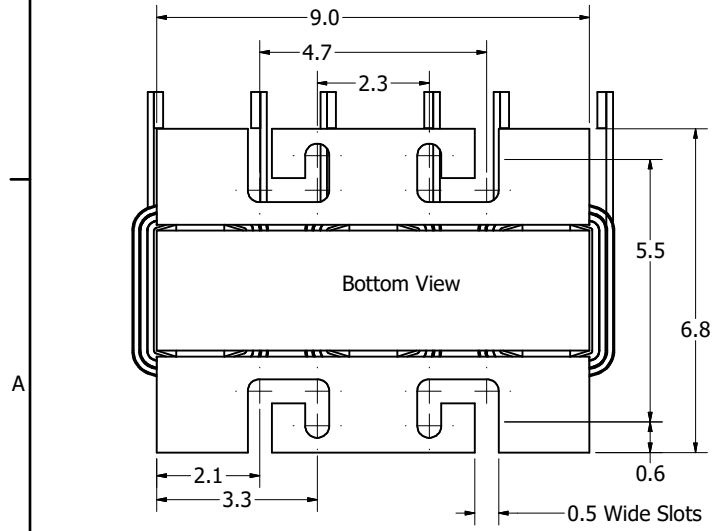
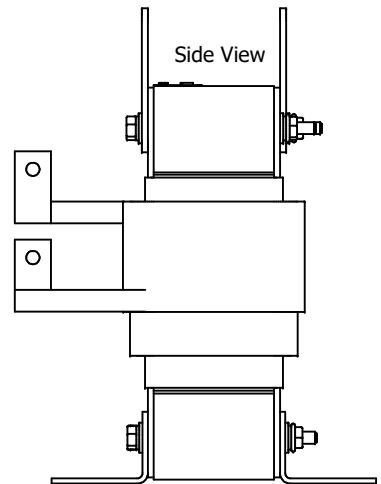
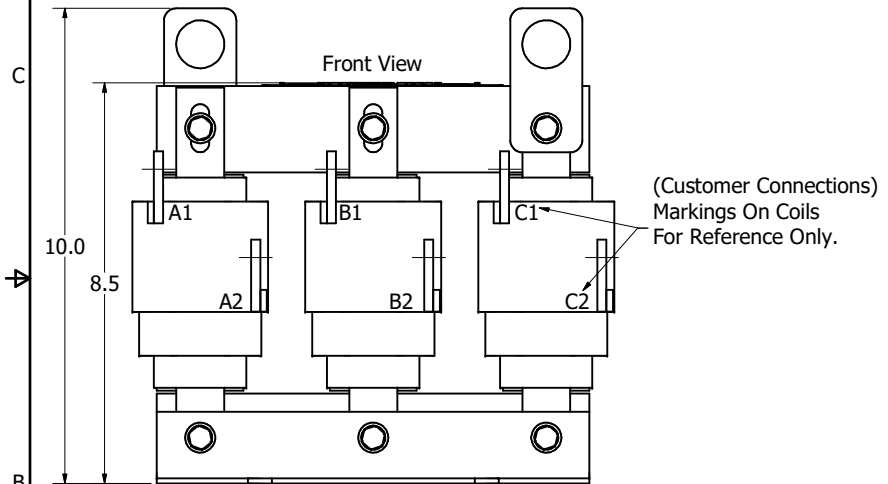


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG44H	125	125	130	371	381	51	SLK10	0.28

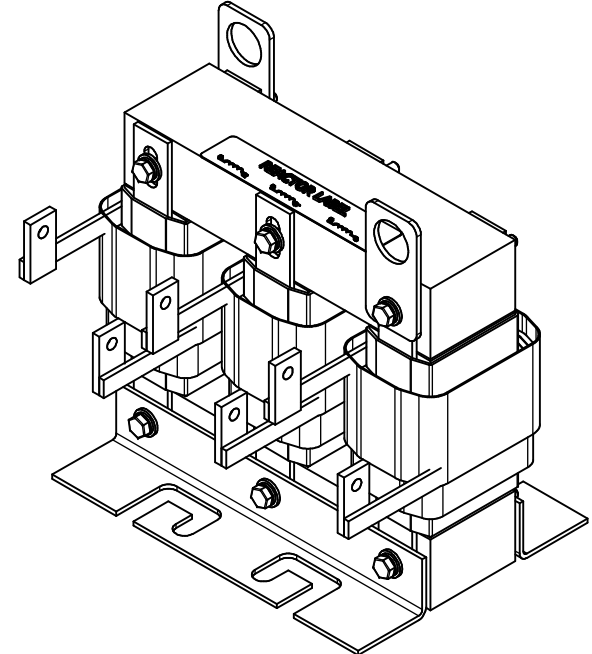

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germanstown, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR- Motor Amps ---
3PH, 3Ø/60Hz, ---Y Rated, 600V Max, -A Max
40C Amb Max, 150C Rise, RoHS
Manual #30895 LUG KIT #SLK---

DATE CODE

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. UL file number: cULus Listed File E116124.
 3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 4. KDR IOM Manual Part Number 30895
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev 11/16) Germanstown, WI 53022 © 2024 TCI, LLC KDR G Frame, Flag Reactor Drawing 107533-1DG	
C	6575, Term change to Flag	2/23/2024	DSW					DRN BY	DATE
B	6400, Remove KDRG3H	9/1/2023	DSW					SCALE	1/2
A	Combined drawings	3/15/18	DSW					DATE	3/15/18
NO	REVISION	DATE	BY					SCALE	1/2