
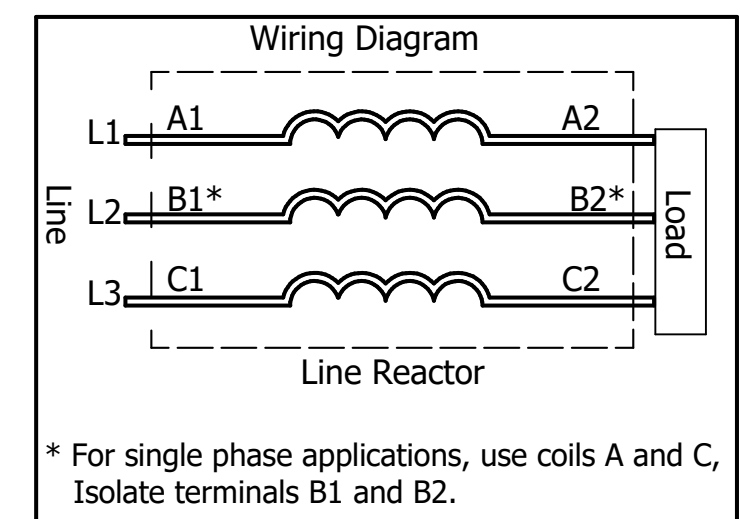
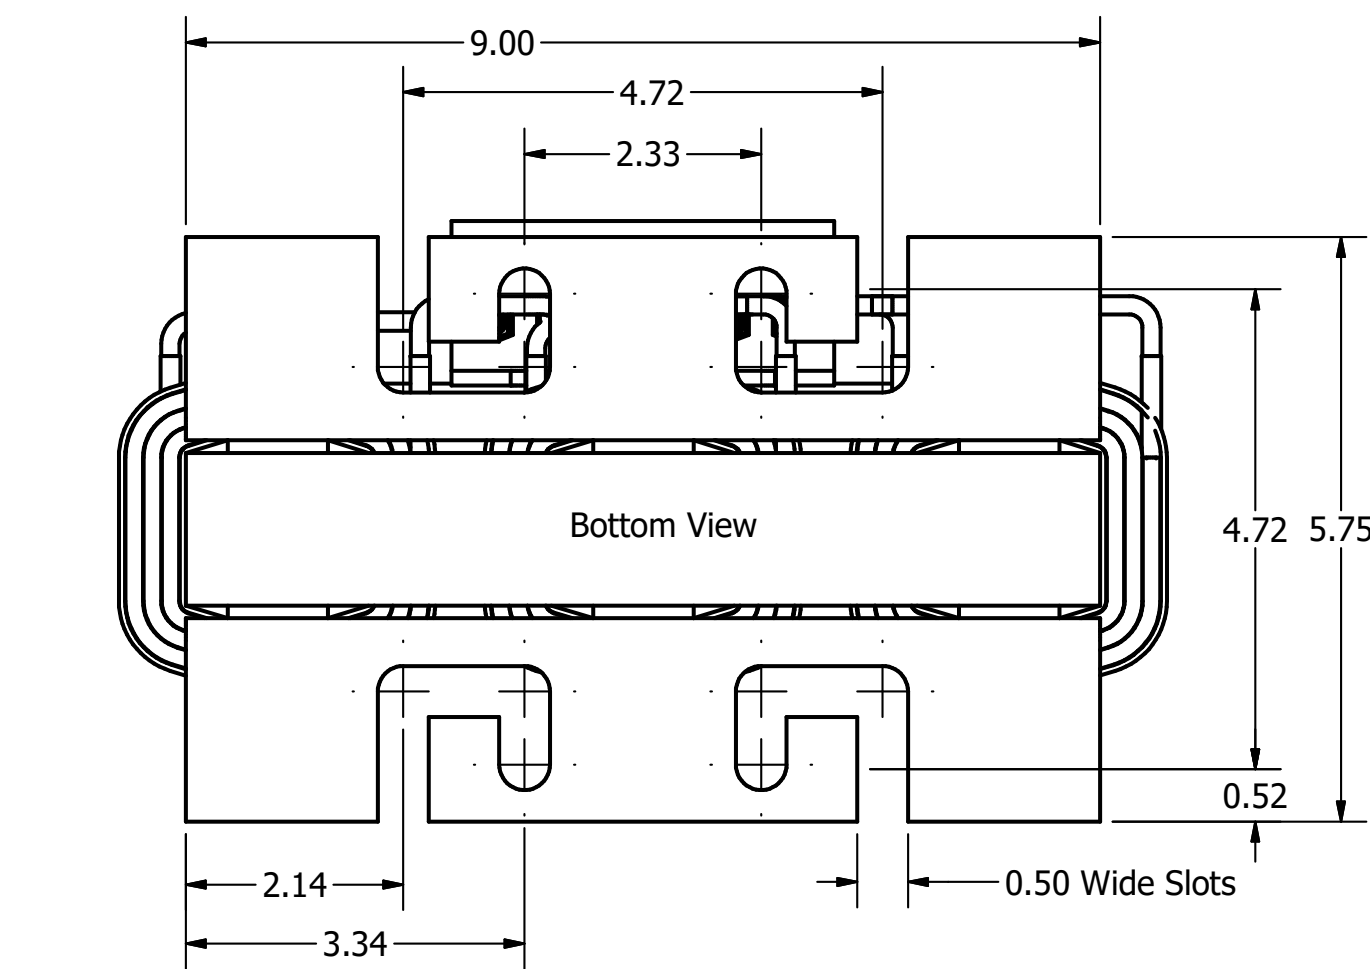
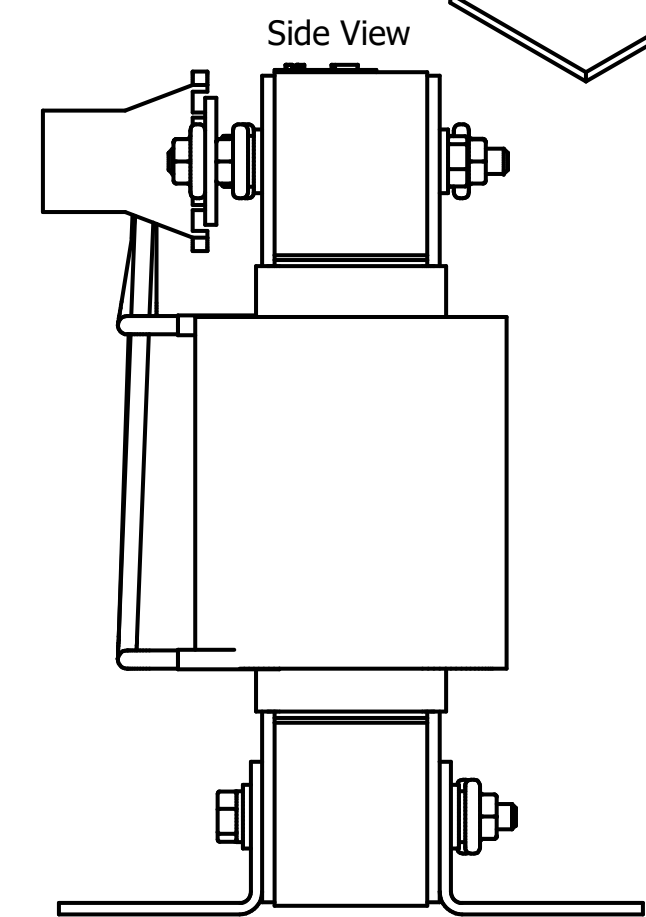
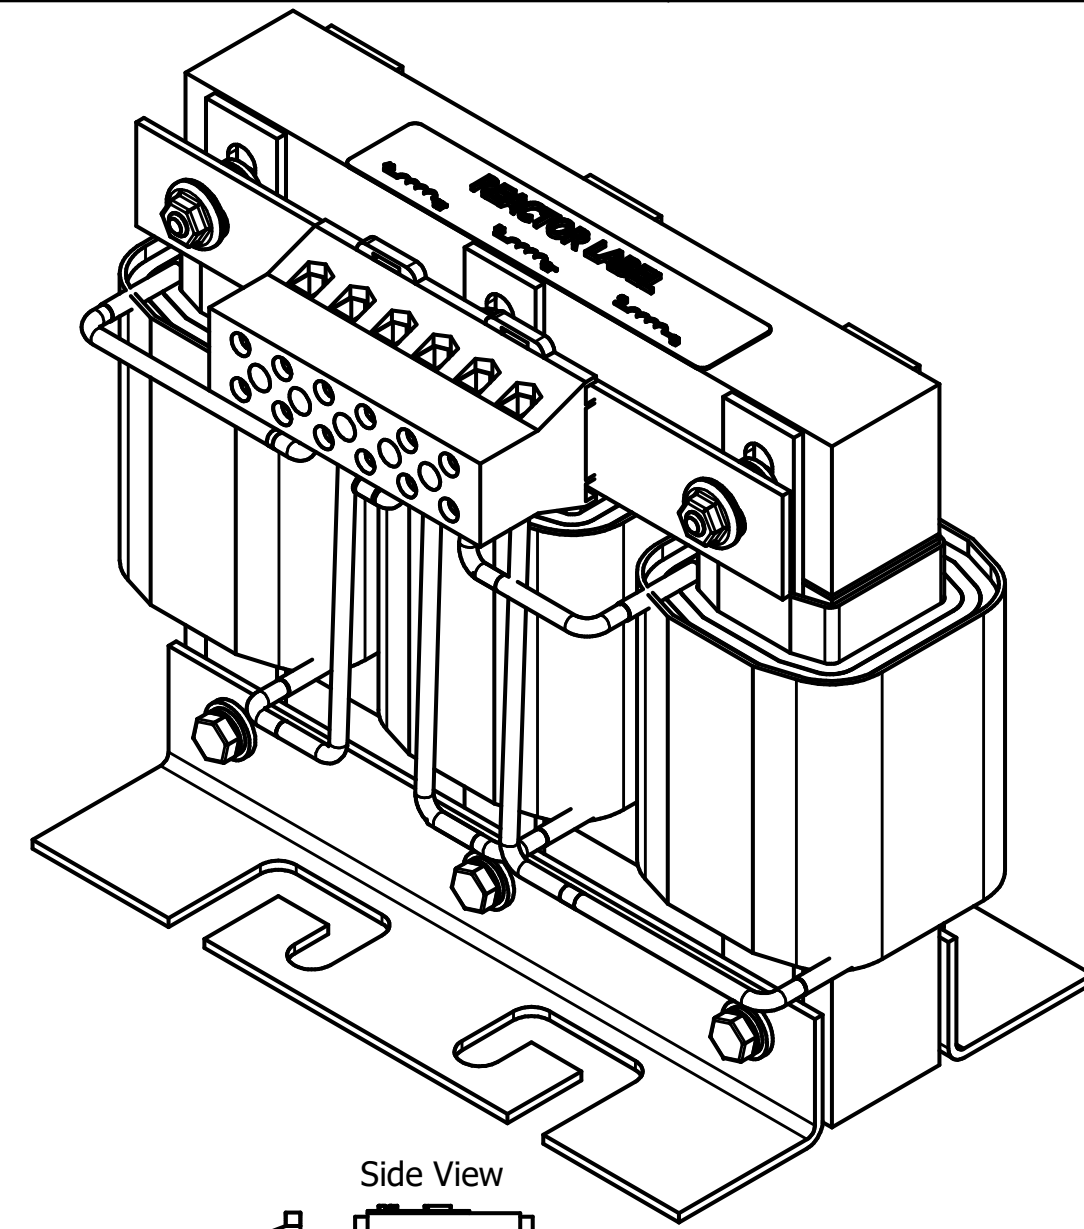


(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 1- 4 AWG. Torque : 35 IN-LBS (3.95 Nm)
 6- 14 AWG. Torque : 30 IN-LBS (3.39 Nm)
 16- 20 AWG. Torque : 25 IN-LBS (2.28 Nm)
 22 AWG. Torque : 20 IN-LBS (2.26 Nm)

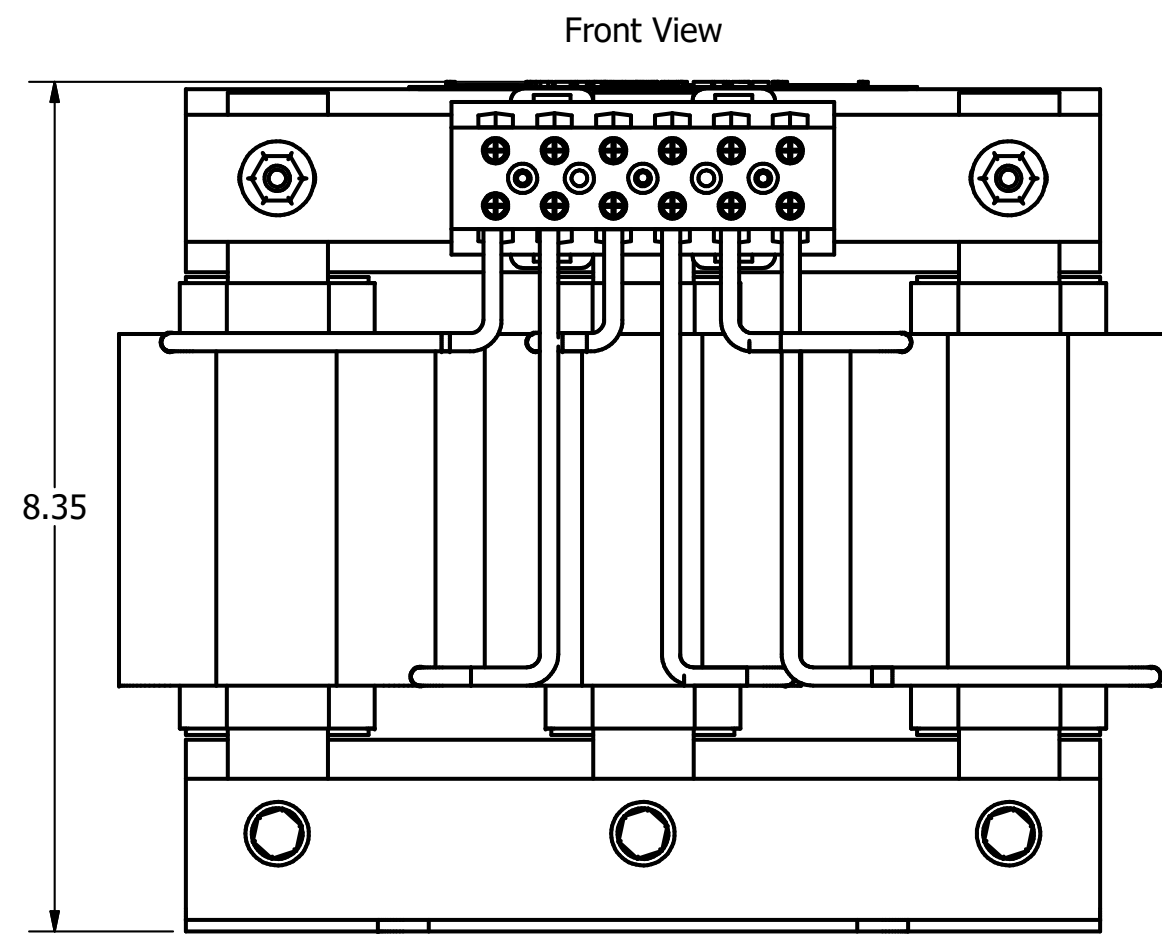

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.						
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)
KDRULH43H	60	62	62	750	45	205
KDRULH42H	75	77	82	597	45	251

TGI (800) 824-8282 transcoil.com

TGI, LLC
 Germantown, WI USA.
transcoil.com
 800-824-8282

KDRUL Drive Reactor
 KDRUL— Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max
 40C Amb Max, 135C Rise, RoHS
 Term Torque—B-In

UL LISTED CE
 2ND CONT. IMP. MARK

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
- UL file number: cULus Listed File E116124.
 - KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 - KDR IOM Manual Part Number 30895
 - Material(s) Shall be RoHS Compliant
 - Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TGI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TGI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TGI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		TGI W132 N10611 Grant Drive Germantown, WI 53022	
KDRUL H Frame, Terminal Block Reactor Drawing				DRN BY DSW	DATE 2/26/18	107534DG	
A Combined Drawings		2/26/18	DSW	SCALE 1/2	APRVD	SIZE C	SHT.2 OF 2
NO REVISION		DATE	BY				