

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULJ41H	200	192	192	250	71	466	SLK11

(Customer Connections) Markings On Pressure Terminals For Reference Only.


TGI (800) 824-8282 transcoll.com

TGI, LLC
 Germantown, WI, USA.
transcoll.com
 800-824-8282

KDRUL Drive Reactor
 KDRUL — Motor Amps —
 3PH, 50/60Hz, — V Rated, 600V Max, —A Max
 40C Amb Max, 155C Rise, RoHS
 Term Torque — lb-in

UL LISTED CE
 500 CONT. IQ, 5000

DATE CODE A1 A2 B1 B2 C1 C2

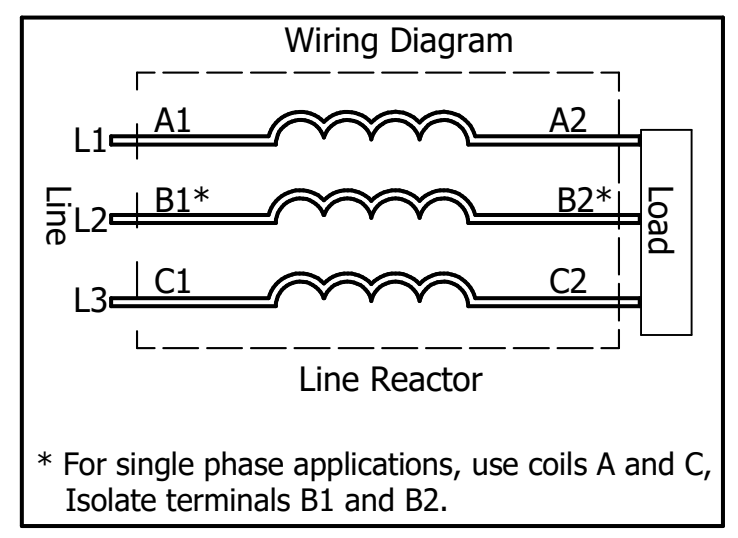

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TGI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TGI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TGI.

NO.	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)
 DECIMAL
 XX ± .25
 .XXX ± .10
 FRACTIONAL
 ± 1/16
 ANGULAR
 ± 1°

TGI W132 N10611 Grant Drive
 Germantown, WI 53022

KDRUL J Frame, Copper Bus
 Reactor Drawing

DRN BY: DSW DATE: 2/28/18 107536DG
 SCALE: 1/2.2 APRVD: SIZE C SHT.4 OF 8