

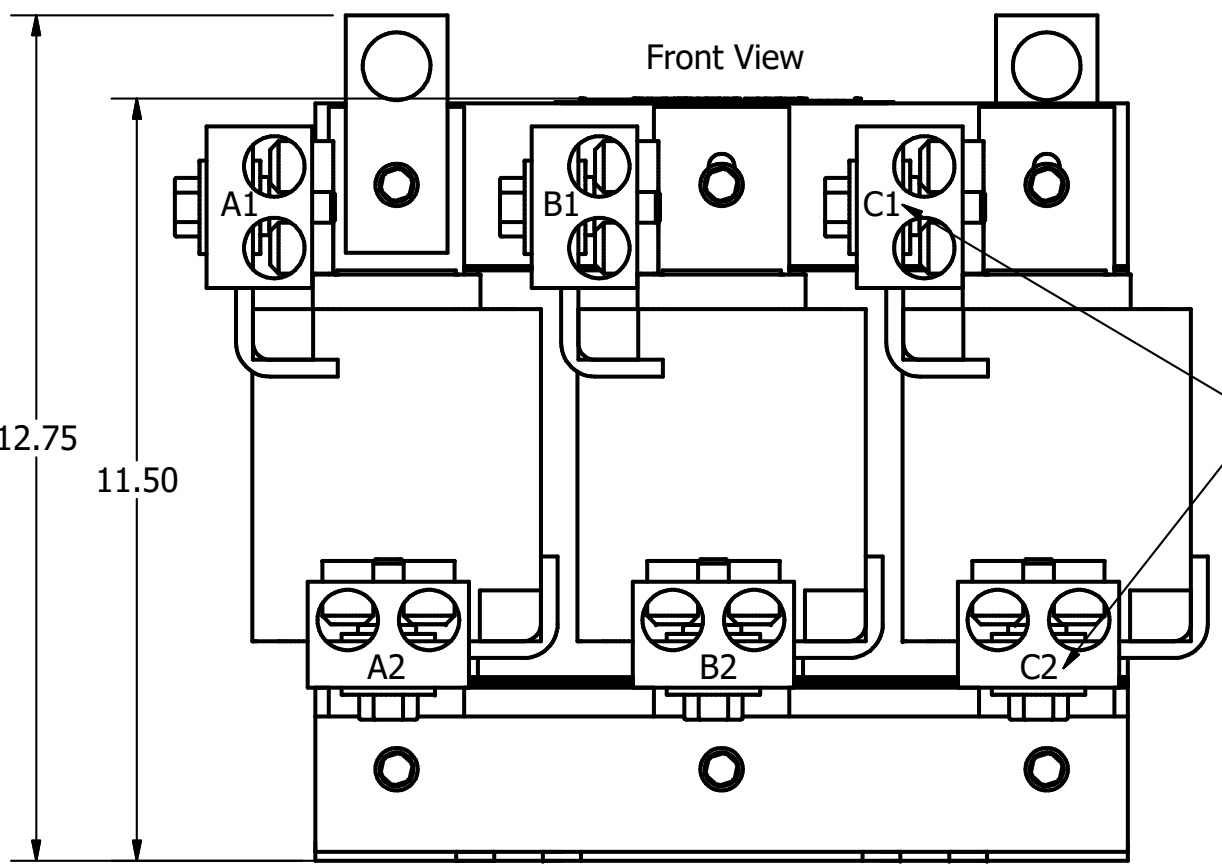
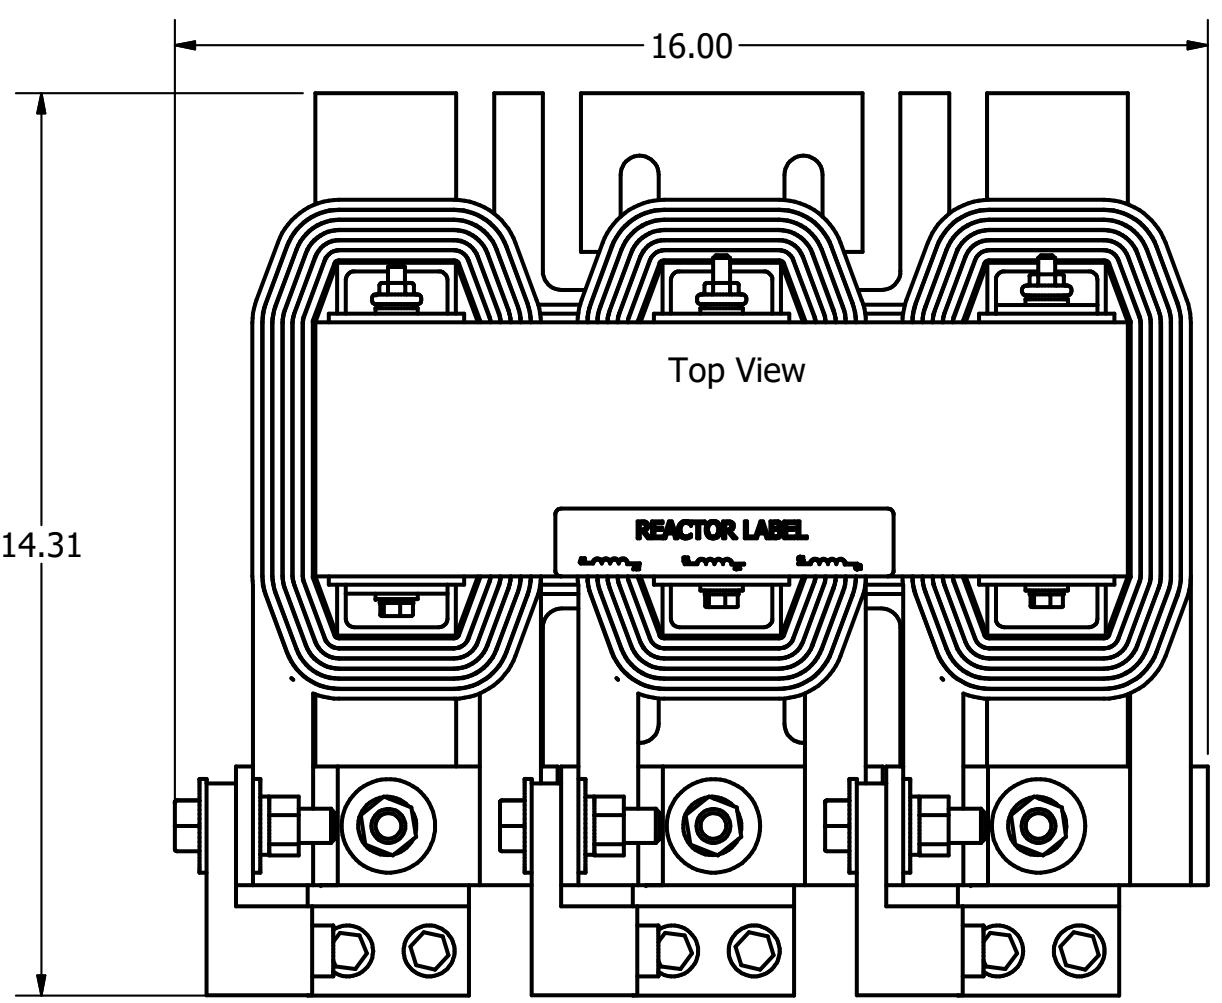
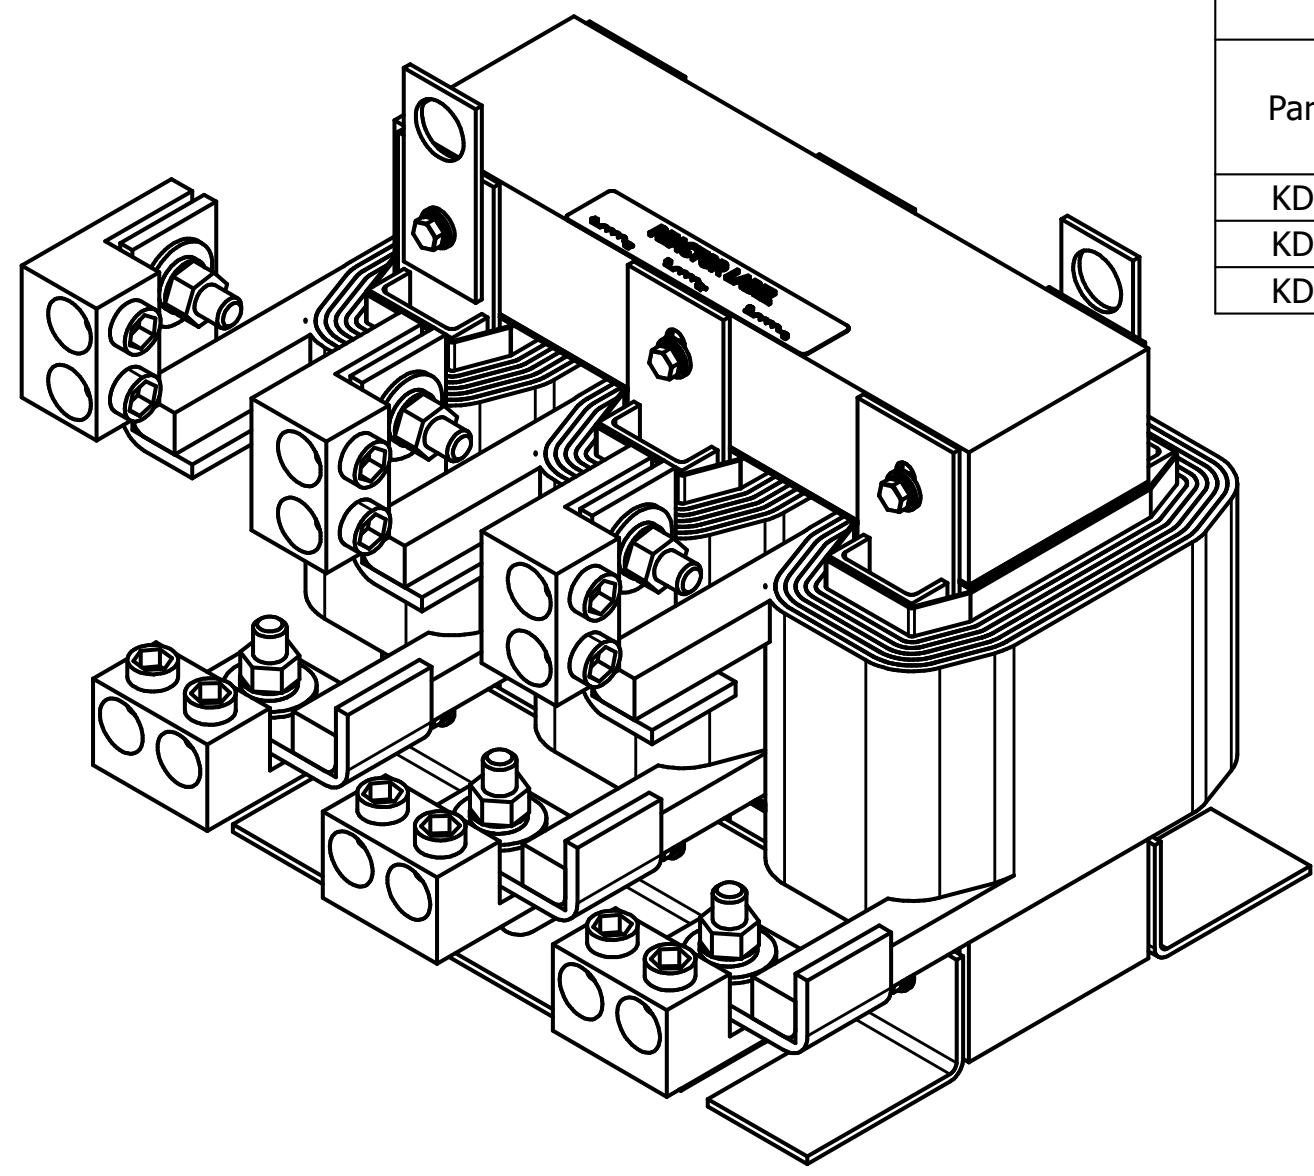
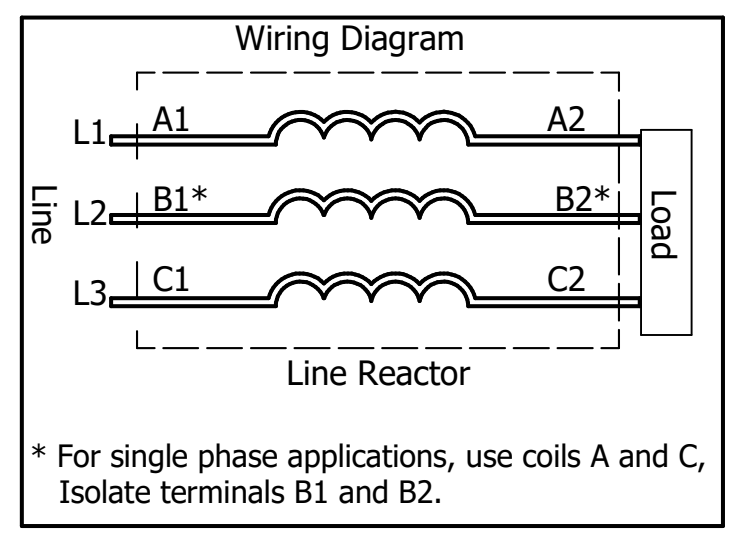


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULS47H	450	412	440	112	154	521	SLK13
KDRULS46H	500	472	500	95.4	154	661	SLK14
KDRULS49H	600	576	576	66.4	180	1194	SLK14

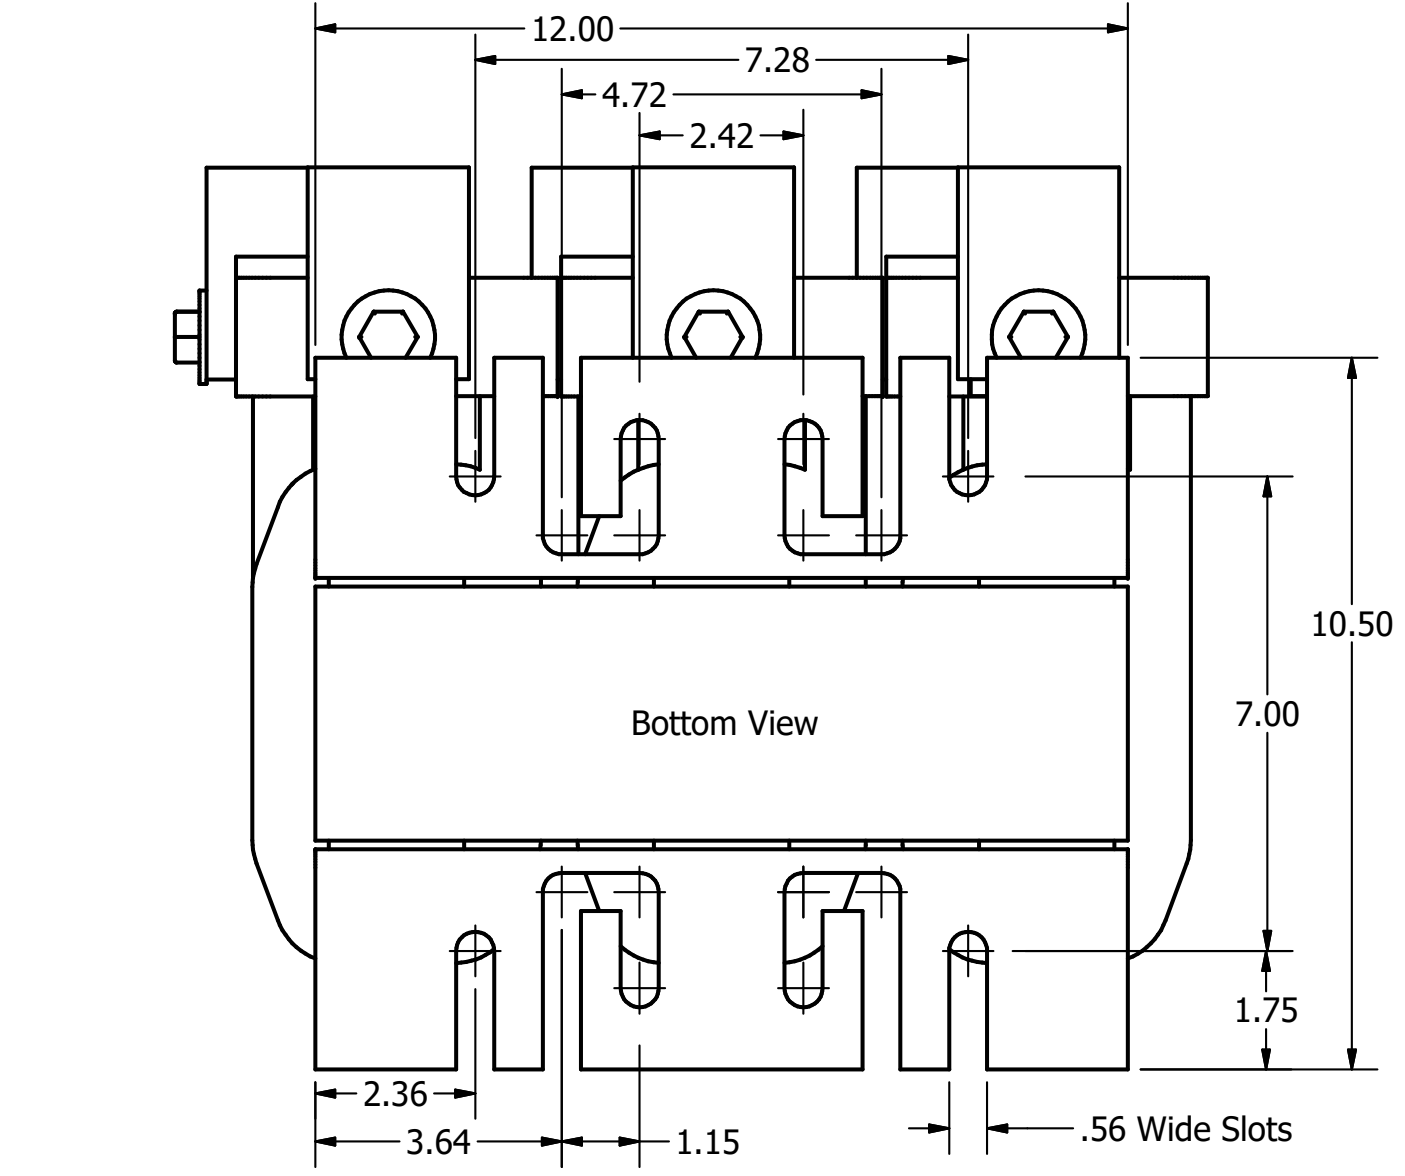

(Customer Connections) Markings On Pressure Terminals For Reference Only.

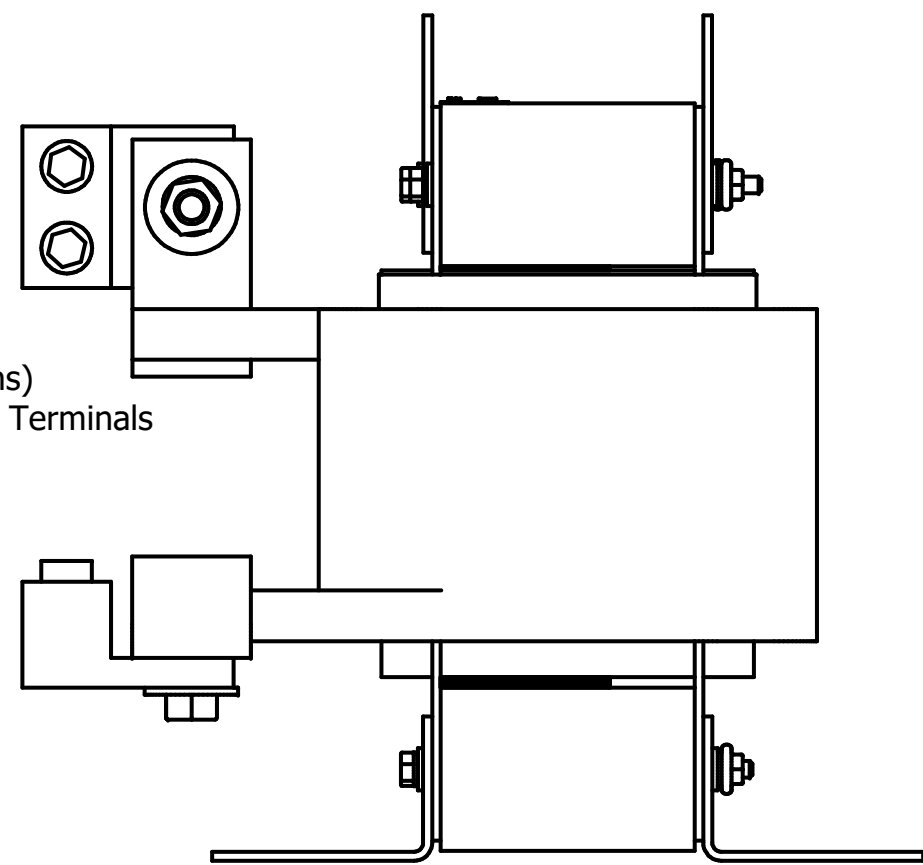

TCI (800) 824-8282 transcoil.com
 TCI, LLC Germantown, WI USA. transcoil.com 800-824-8282
 KDRUL Drive Reactor
 KDRUL— Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max
 40C Amb Max, 155C Rise, RoHS
 Term Torque— lb-in

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		TCI W132 N10611 Grant Drive Germantown, WI 53022	
KDRUL S Frame, Copper Bus Reactor Drawing				DRN BY: DSW	DATE: 3/2/18	107538DG	
NO REVISION				SCALE: 1/3	APRVD:	SIZE: C	SHT.2 OF 8