
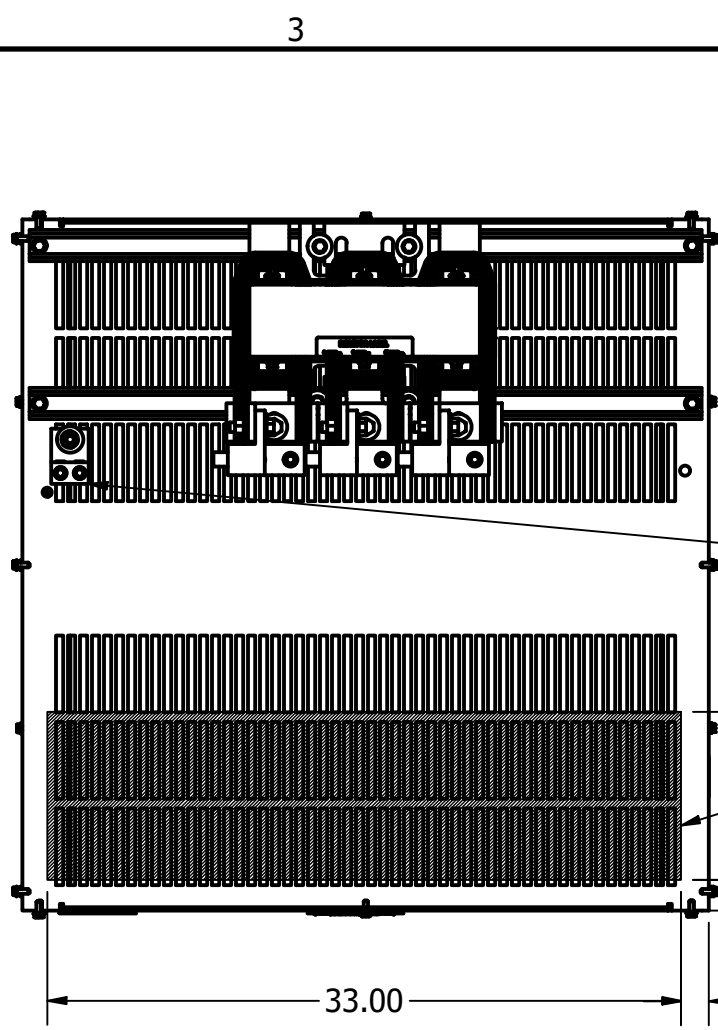






480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULS1HE01	600	720	750	43.4	588	1246	SLK15

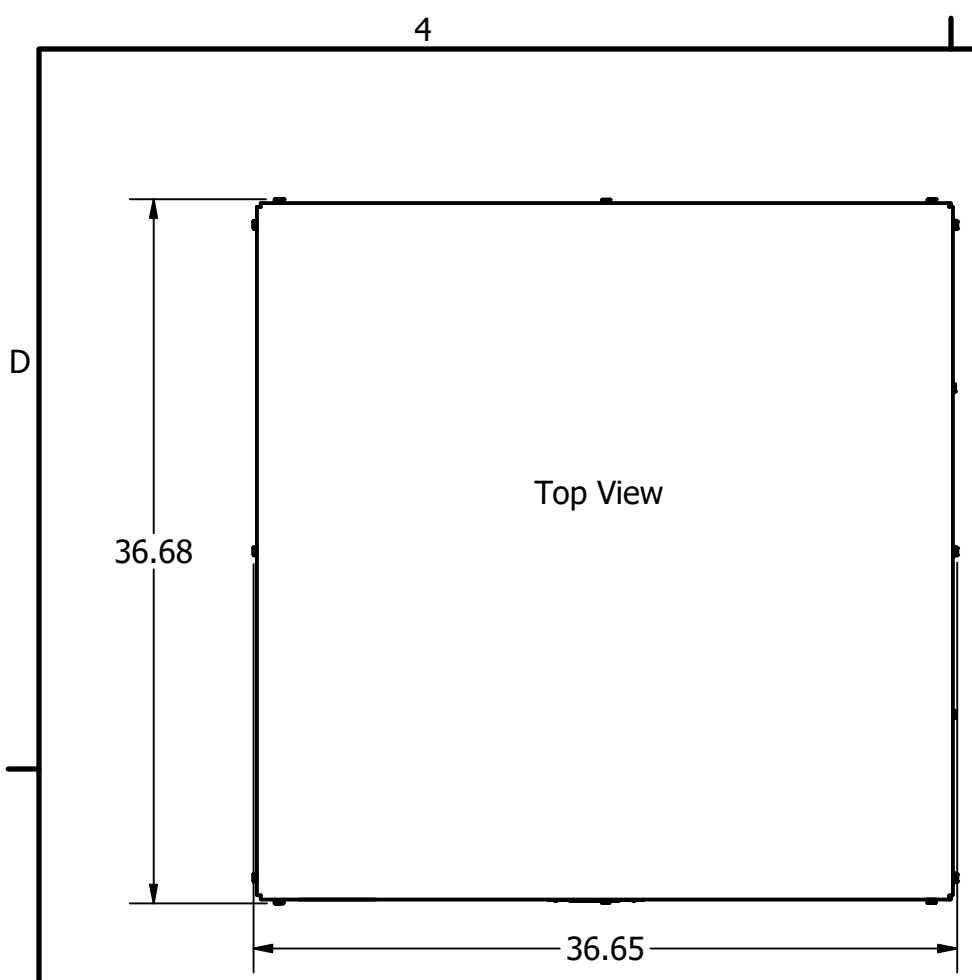

Ground Lug.
See IOM Manual, Part# 30895
Table 2S350, Wire Size And Torque.


Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 5
(Non Removeable Panel)

Suggested
Customer Entrance
Either Side Of Enclosure.
See Note: 5
(Non Removeable Panel)

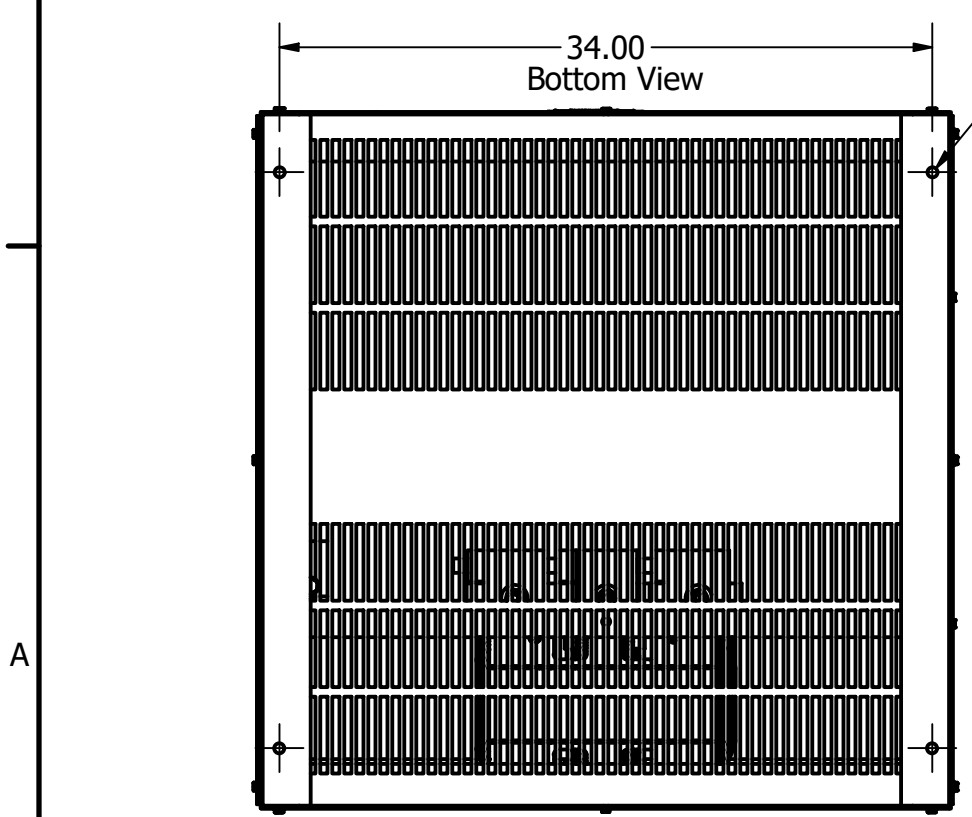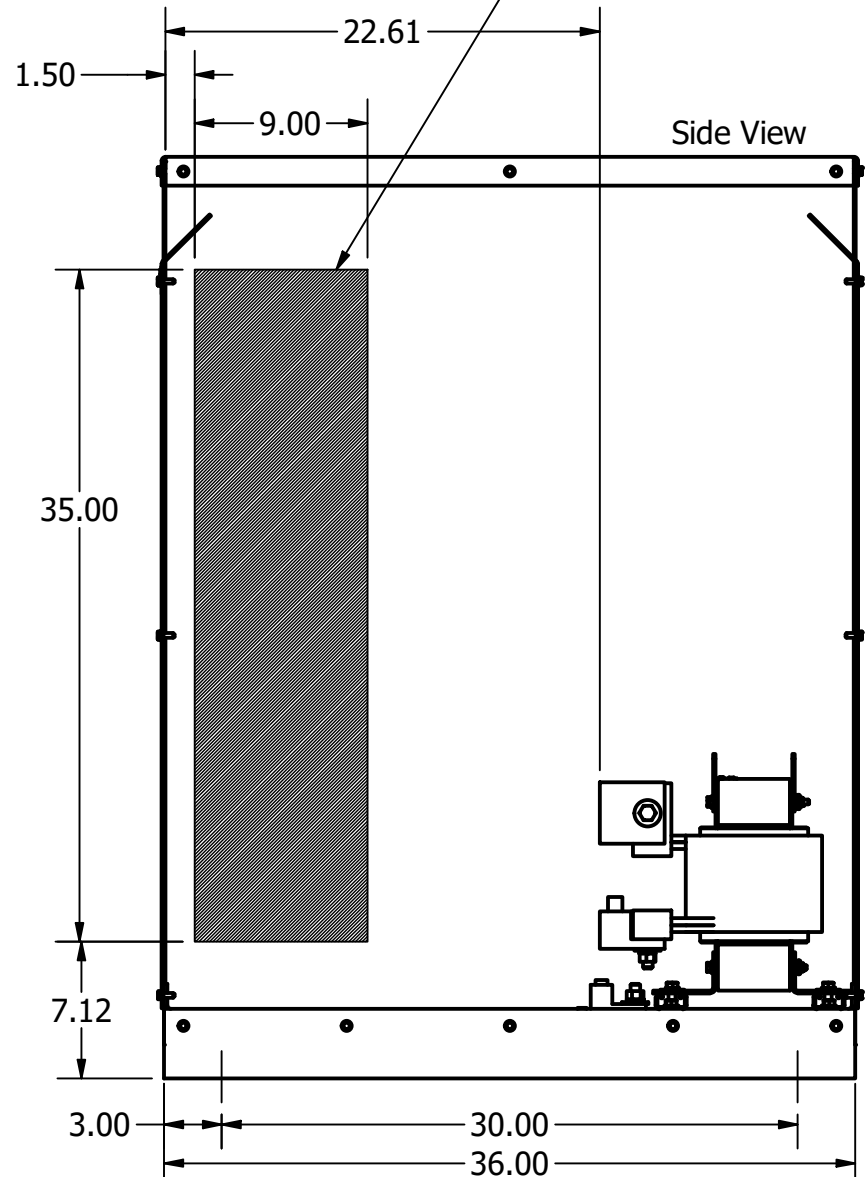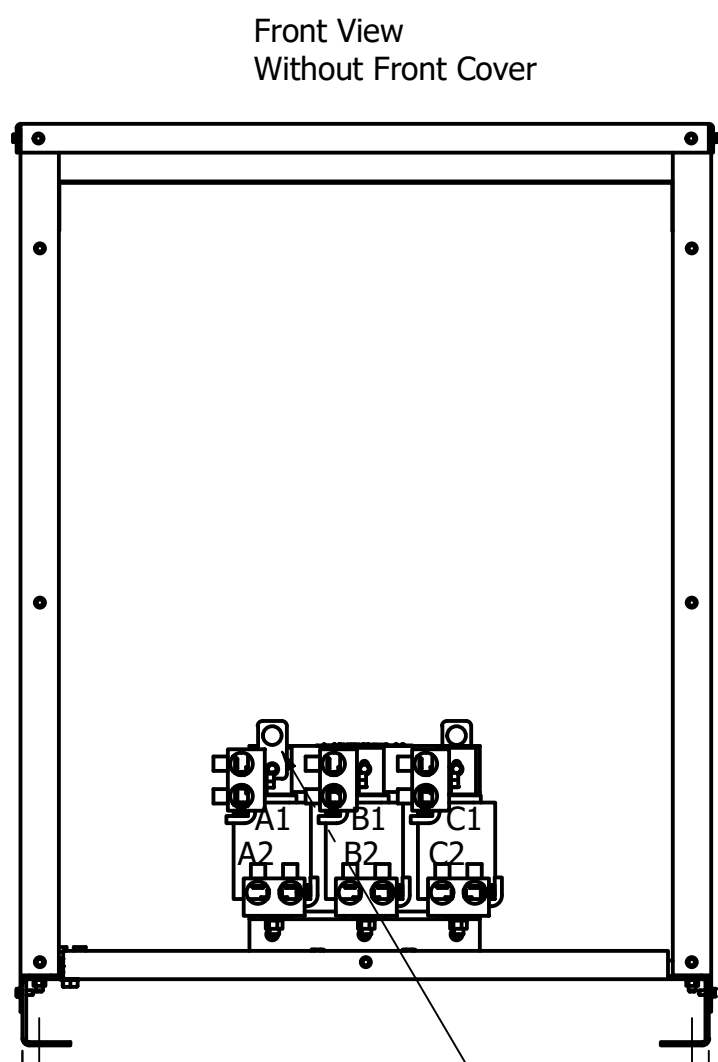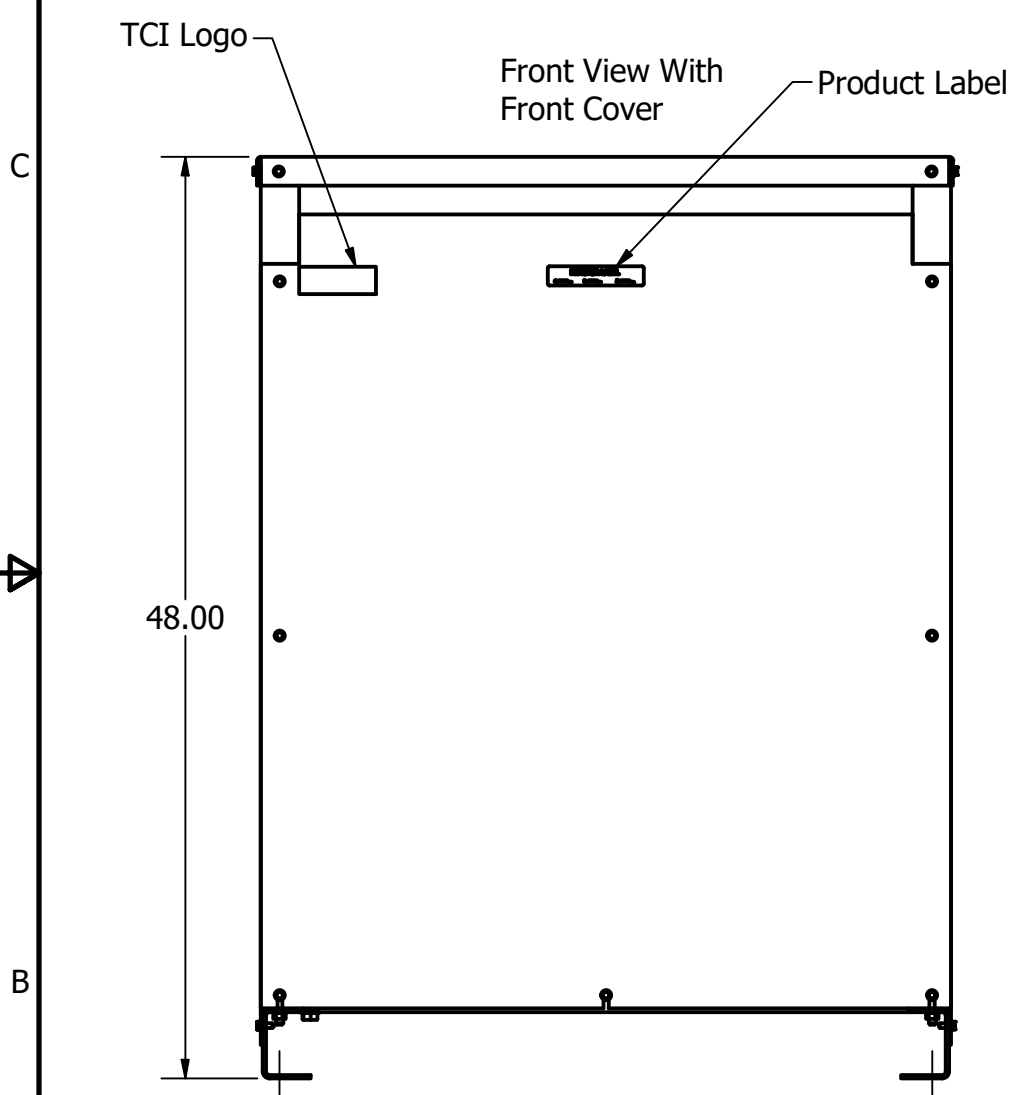

0.50 Dia Mounting Holes
4 Places.

(Customer Connections)
Markings On Coils
For Reference Only.

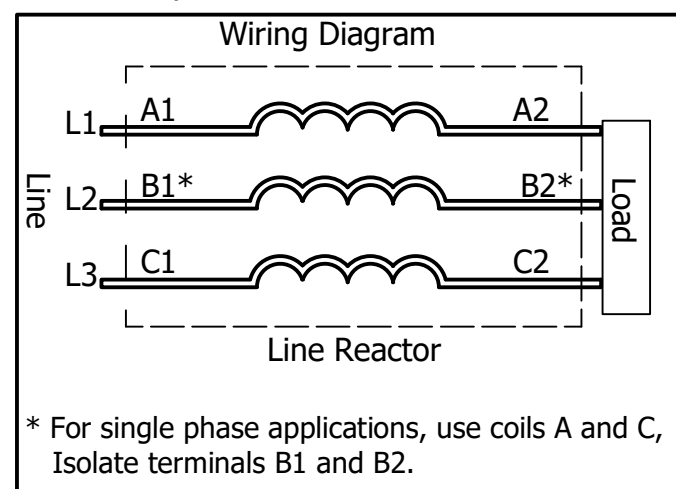

TCI (800) 824-8282 transcoil.com

TCI, LLC
Gemantown, WI, USA.
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDRUL - Motor Amps -
300, 50/60Hz, -V Rated, 600V Max, -A Max
40C Amb Max, 125C Max, Ref IS
Turn Torque - B-B

UL LISTED
cULus

DATE CODE

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. Material(s) Shall be RoHS Compliant
 5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
D	5548 Moved KDRS2HE01	04/05/21	JRN
C	5502, Update Watts	02/16/21	DSW

TCI W132N10611 Grant Drive
Gemantown, WI 53022
© 2021 TCI, LLC

An Allied Motion Company

KDR S Frame, Copper Bus, Enclosed
Type 1, Reactor Drawing

DRN: DSW DATE: 04/16/21 107615DG
SCALE: 1/10 APRVD: SIZE: C SHT 4 OF 8