


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX2H	800	960	965	32.5	315	1661	SLK16



480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX2L	800	960	965	19.5	290	997	SLK16

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX44H	800	768	864	49.8	320	1100	SLK16


575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX41L	900	864	900	26.6	290	1075	SLK16
KDRULX42L	1000	960	1000	23.9	290	1194	SLK16

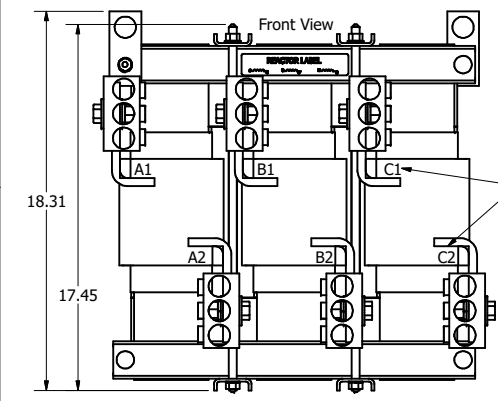

(Customer Connections) Markings On Coils For Reference Only.

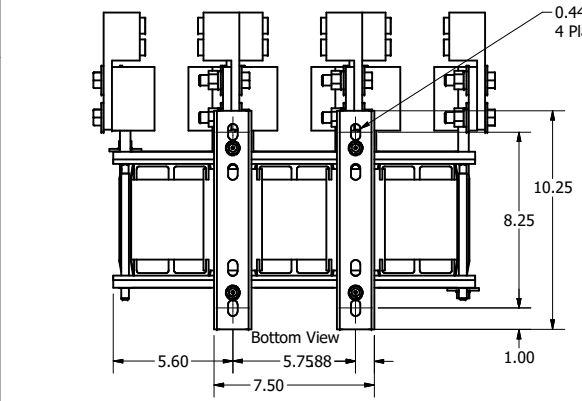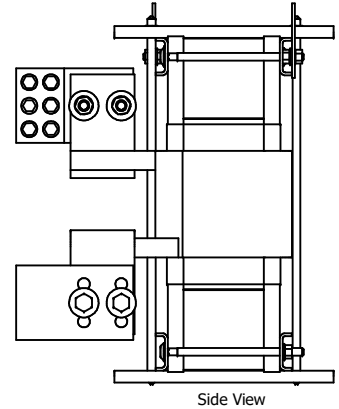

0.44 x 0.75 Slots  
4 Places.

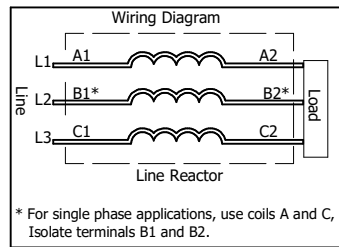

\* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

**TCL** (800) 824-8282 [transcoll.com](http://transcoll.com)

TCL, LLC  
Germanstown, WI, USA  
[transcoll.com](http://transcoll.com)  
800-824-8282

KDRUL Drive Reactor  
KDRUL — Motor Amps —  
3PH, 50/60Hz, —V Rated, 600V Max, —A Max  
40C Amb Max, 155C Rise, RoHS  
Turn Torque — 15-in

UL LISTED  
E116124

DATE CODE

- Note:
1. UL file number: cULus Listed File E116124.
  2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
  4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
  5. Material(s) Shall be RoHS Compliant
  6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
.XX	± .25		
.XXX	± .10		
FRACTIONAL			
± 1/16			
ANGULAR			
± 1°			
A	Combined Drawings	3/5/18	DSW
NO	REVISION	DATE	BY

**TCL** W132 N10611 Grant Drive  
Germanstown, WI 53022

KDRUL X Frame, Copper Bus  
Reactor Drawing

DRN BY DATE 107539DG  
DSW 3/5/18

SCALE: 1/4.5 DRN BY DATE  
1/4.5 3/5

SHT 2 OF 6