





575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULX45H	700	672	760	57	284	1393	SLK15

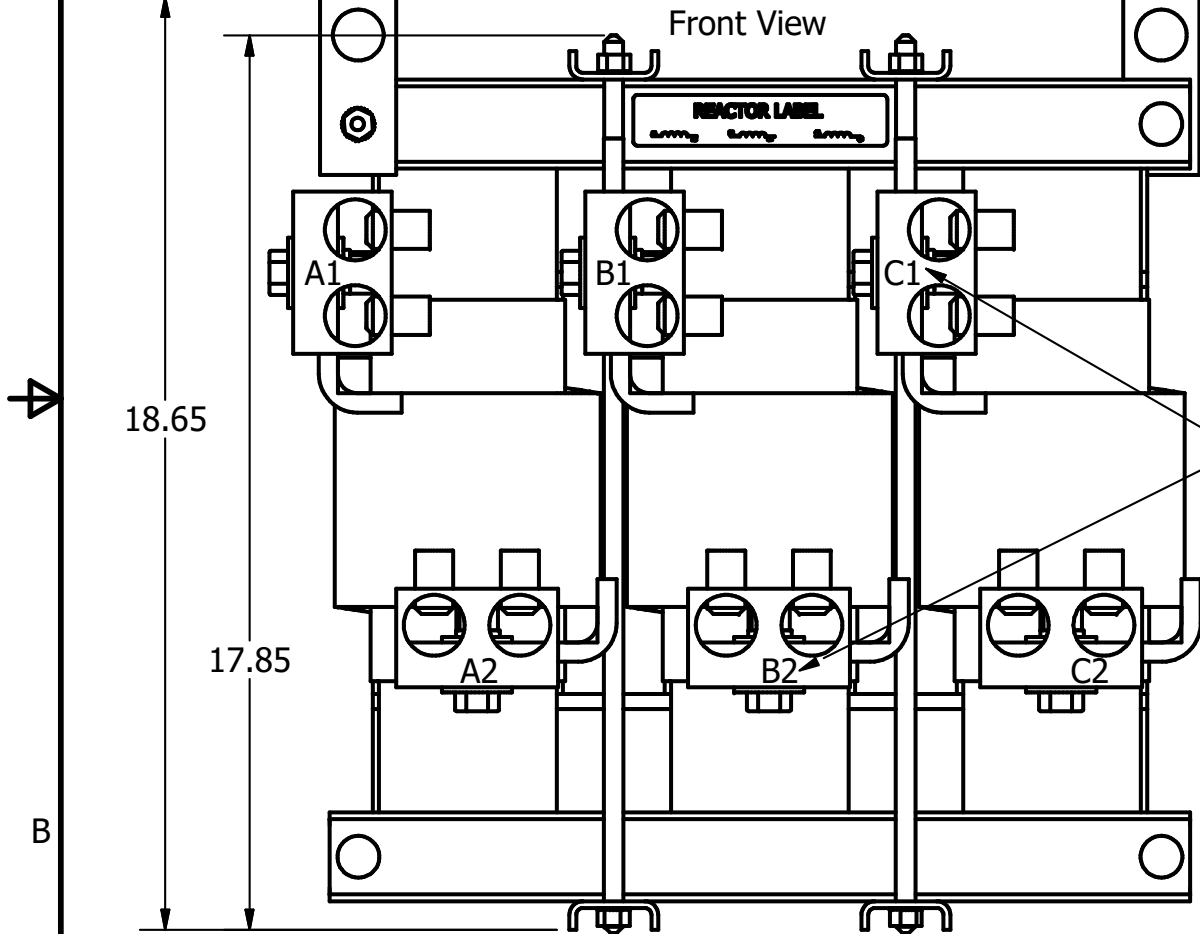

(Customer Connections) Markings On Pressure Terminals For Reference Only.

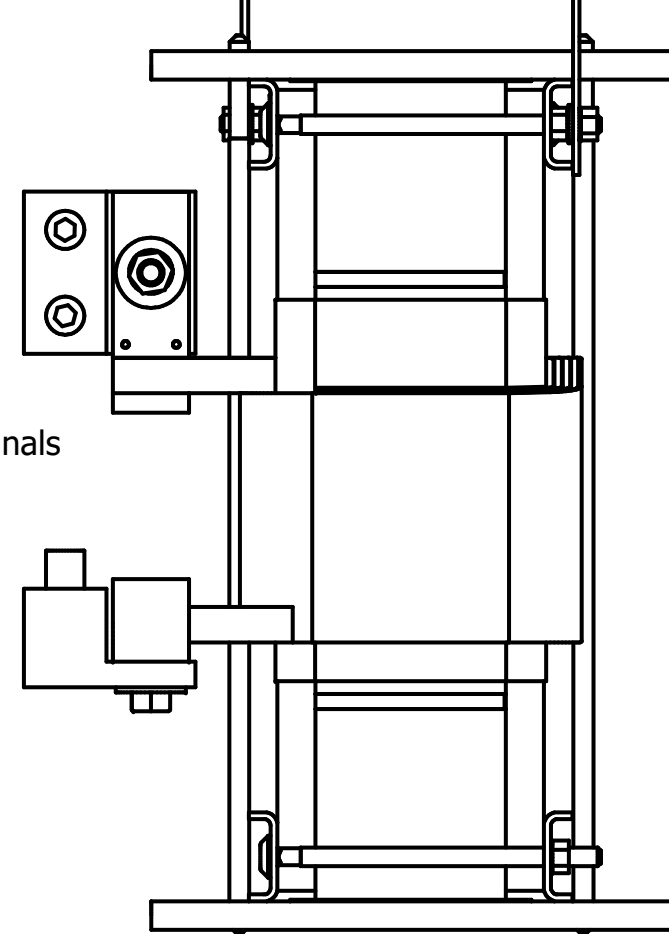

Side View

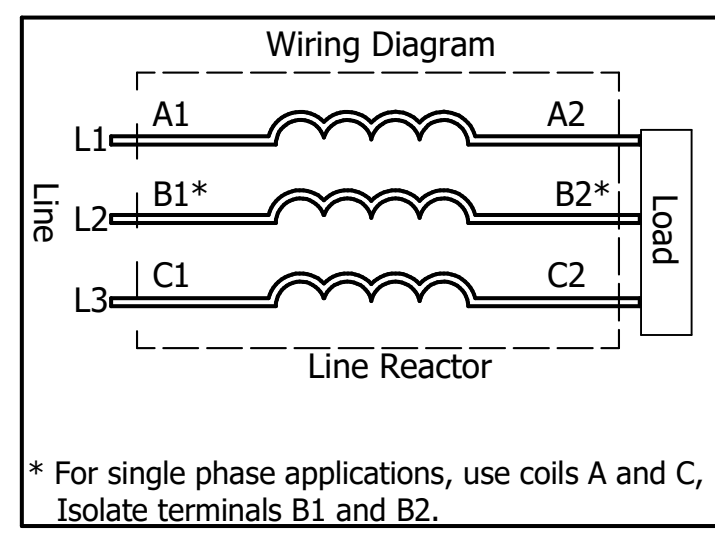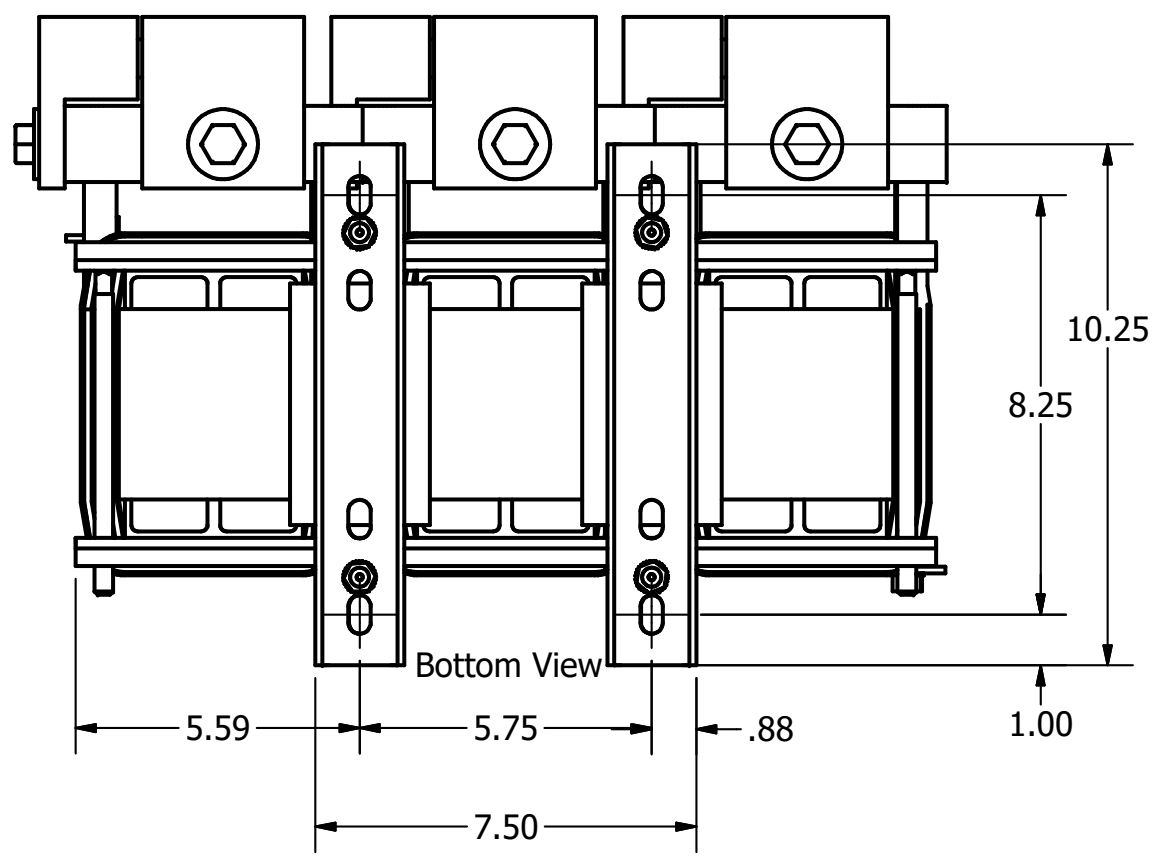

* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

TCI
TCI, LLC
Germantown, WI, USA.
transcoll.com
800-824-8282

(800) 824-8282 transcoll.com

KDRUL Drive Reactor
KDRUL— Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Term Torque— lb-in

UL LISTED **CE**
2ND CONT. EQ. 1996

DATE CODE

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

<p>TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.</p>				TOLERANCES (EXCEPT AS NOTED)		<p>TCI W132 N10611 Grant Drive Germantown, WI 53022</p>		
				DECIMAL			<p>KDRUL X Frame, Copper Bus Reactor Drawing</p>	
				<p>XX ± .25 .XXX ± .10</p>				
NO		REVISION	DATE	BY	<p>FRACTIONAL ± 1/16</p>	<p>DRN BY: DSW SCALE: 1/3.2</p>	<p>DATE: 3/5/18 APRVD:</p>	<p>107539DG SIZE C</p>
					<p>ANGULAR ± 1°</p>			<p>SHT. 6 OF 6</p>