


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULY2H	1100	1320	1350	23.7	560	2284	SLK19

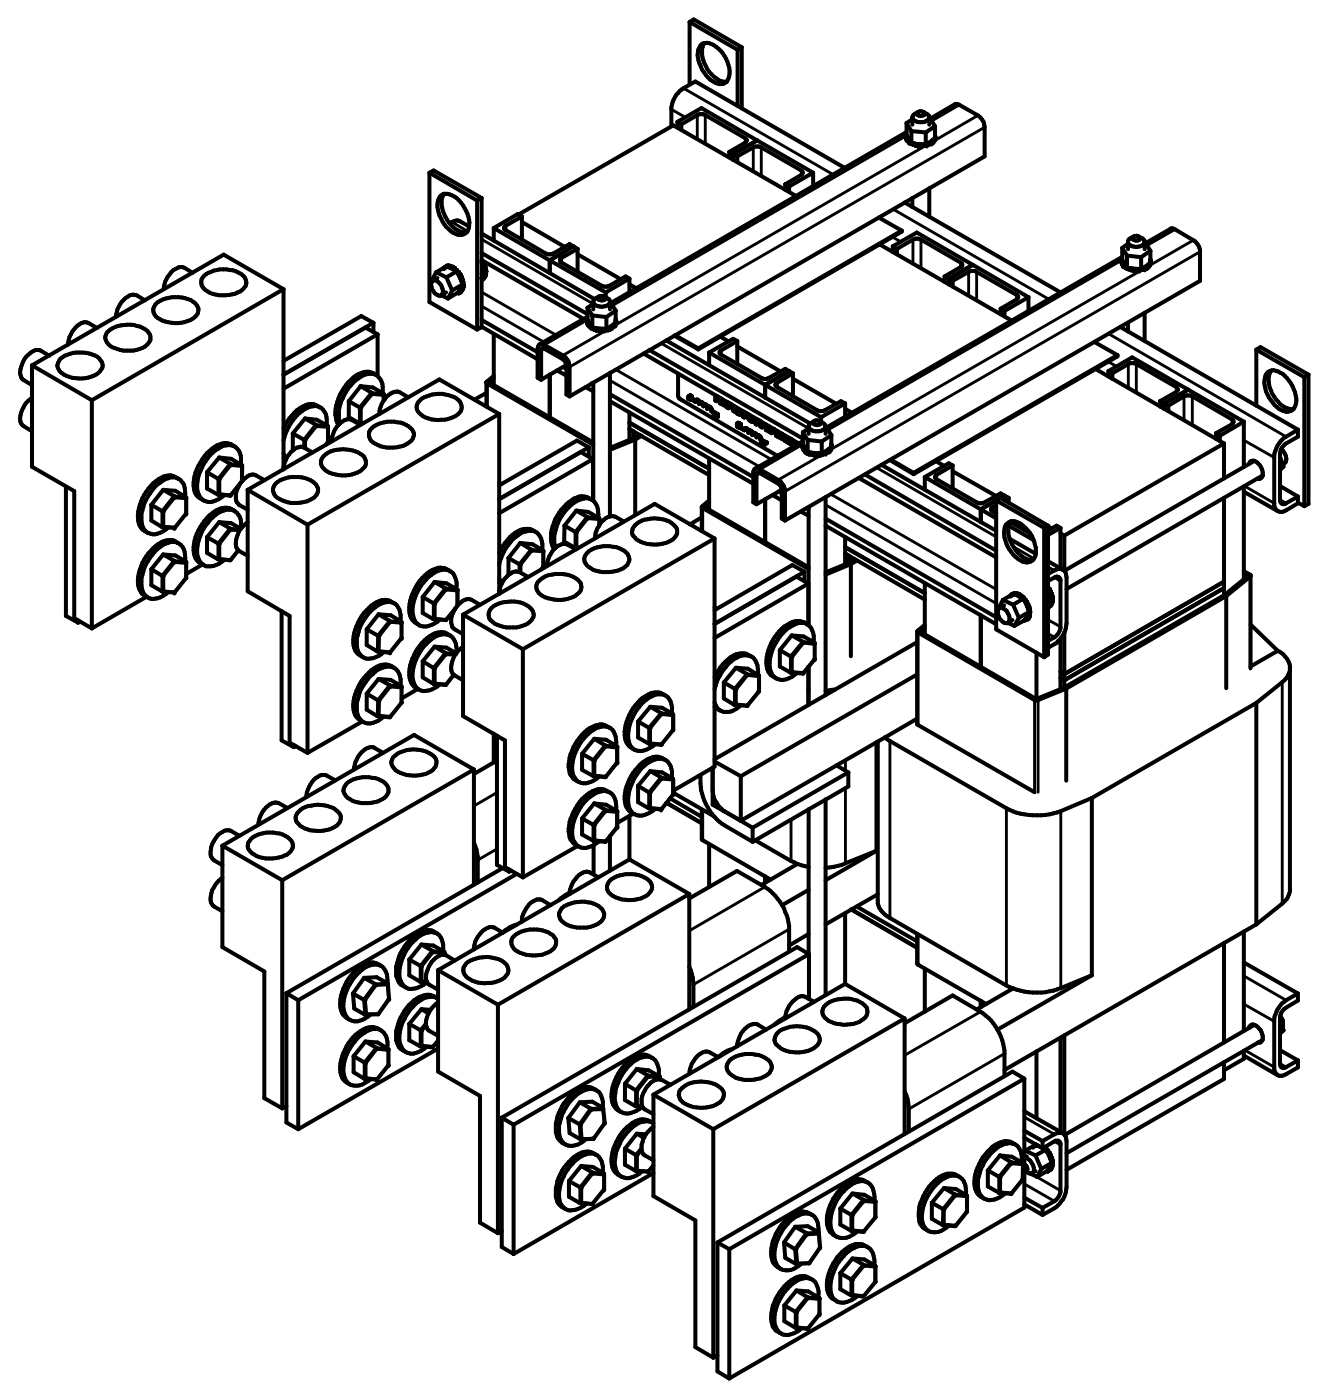

\* T4A4-800N  
 \* CSA Certified.  
 \* UL 486A/B Listed, UL File E6207  
 \* Must be mounted with a minimum of 4 bolts

Item ID	Conductor Range	Bolt/Stud Size	Hex Size	Tightening Torque
T4A4-800N	800kcmil-300kcmil	1/2	1/2	500 in-lb (56.5 N-m)


**TCI** (800) 824-8282 [transcoil.com](http://transcoil.com)

TCI, LLC  
 Germantown, WI, USA.  
[transcoil.com](http://transcoil.com)  
 800-824-8282

**KDRUL Drive Reactor**  
 KDRUL — Motor Amps —  
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max  
 40C Amb Max, 155C Rise, RoHS  
 Term Torque — lb-in

UL LISTED  
 2ND CONT. IMP. MARK

DATE CODE **A1** **A2** **B1** **B2** **C1** **C2**

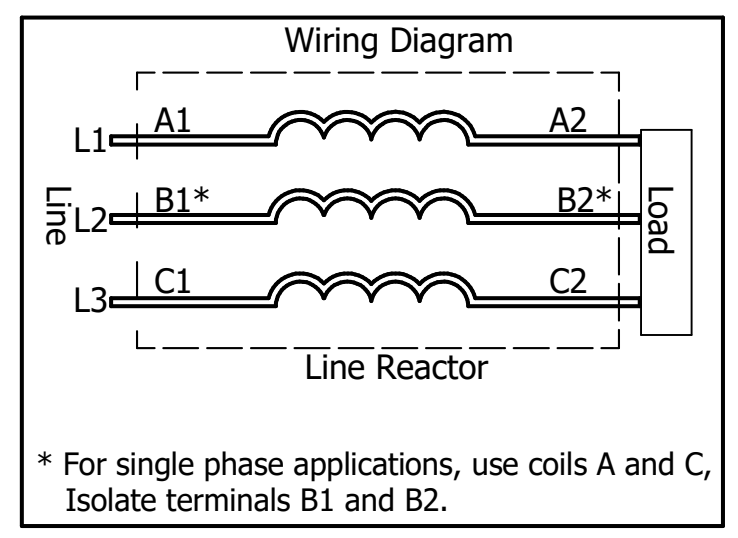

- Note:
1. UL file number: cULus Listed File E116124.
  2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
  4. Material(s) Shall be RoHS Compliant
  5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)		TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	FRACTIONAL	ANGULAR	OTHER
XX ± .25	± 1/16	± 1°	
.XXX ± .10			

**TCI** W132 N10611 Grant Drive  
 Germantown, WI 53022

KDRUL Y Frame, Copper Bus  
 Reactor Drawing

DRN BY: DSW	DATE: 3/5/18	107540DG
SCALE: 1/4.5	APRVD:	SIZE: C
NO. REVISION	DATE	BY

SHT. 6 OF 6