
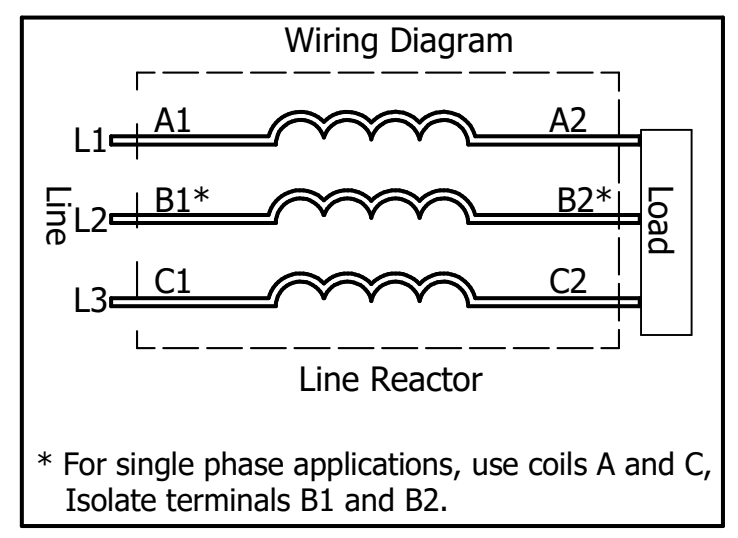
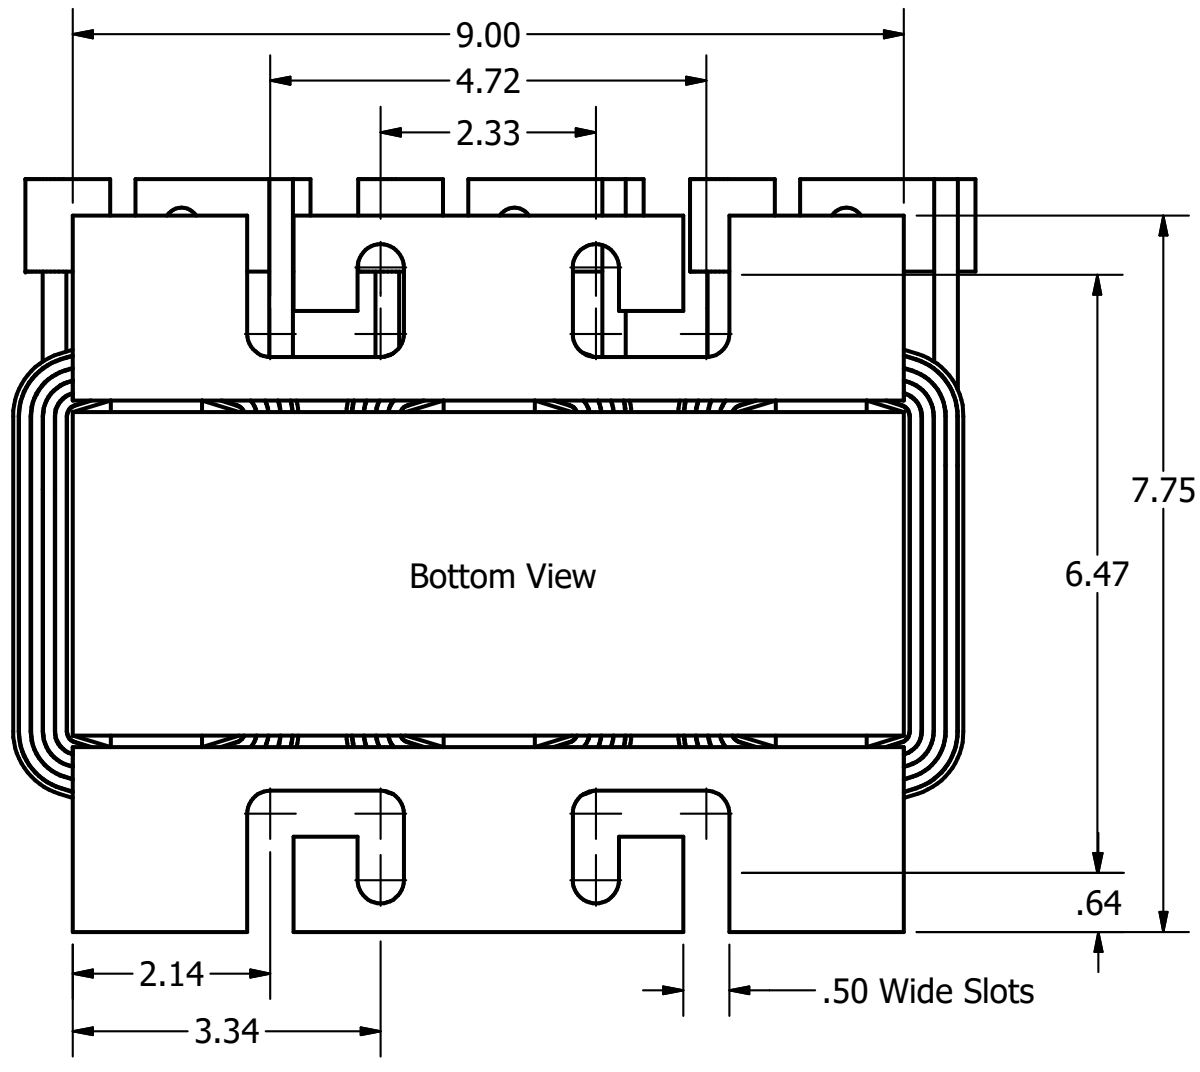
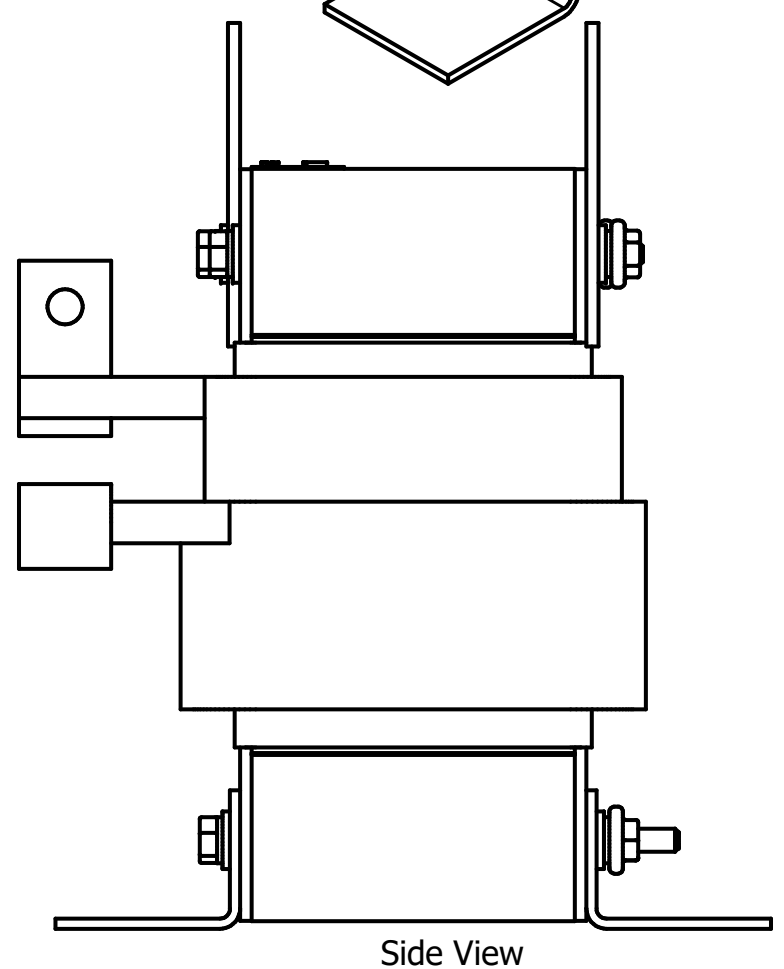
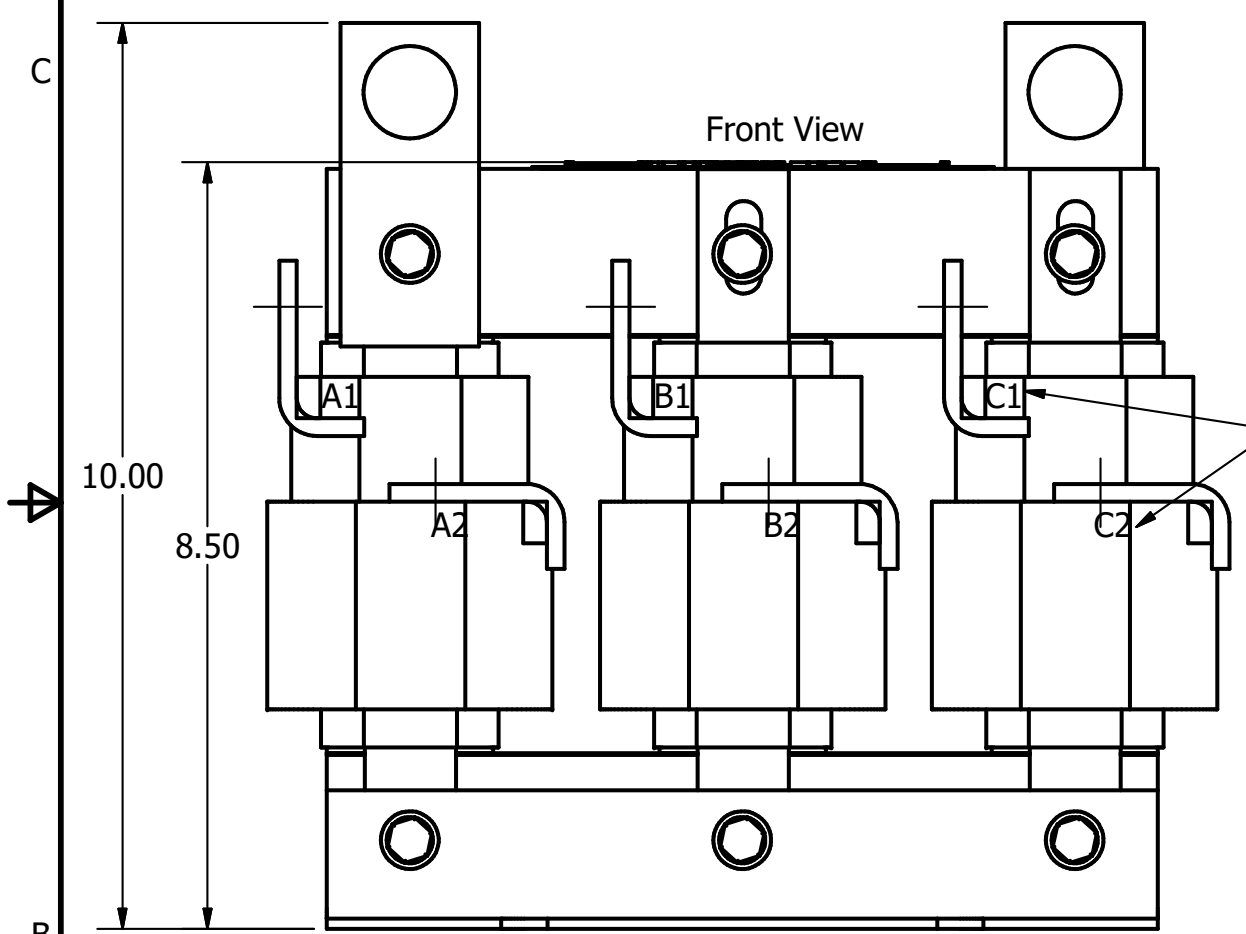
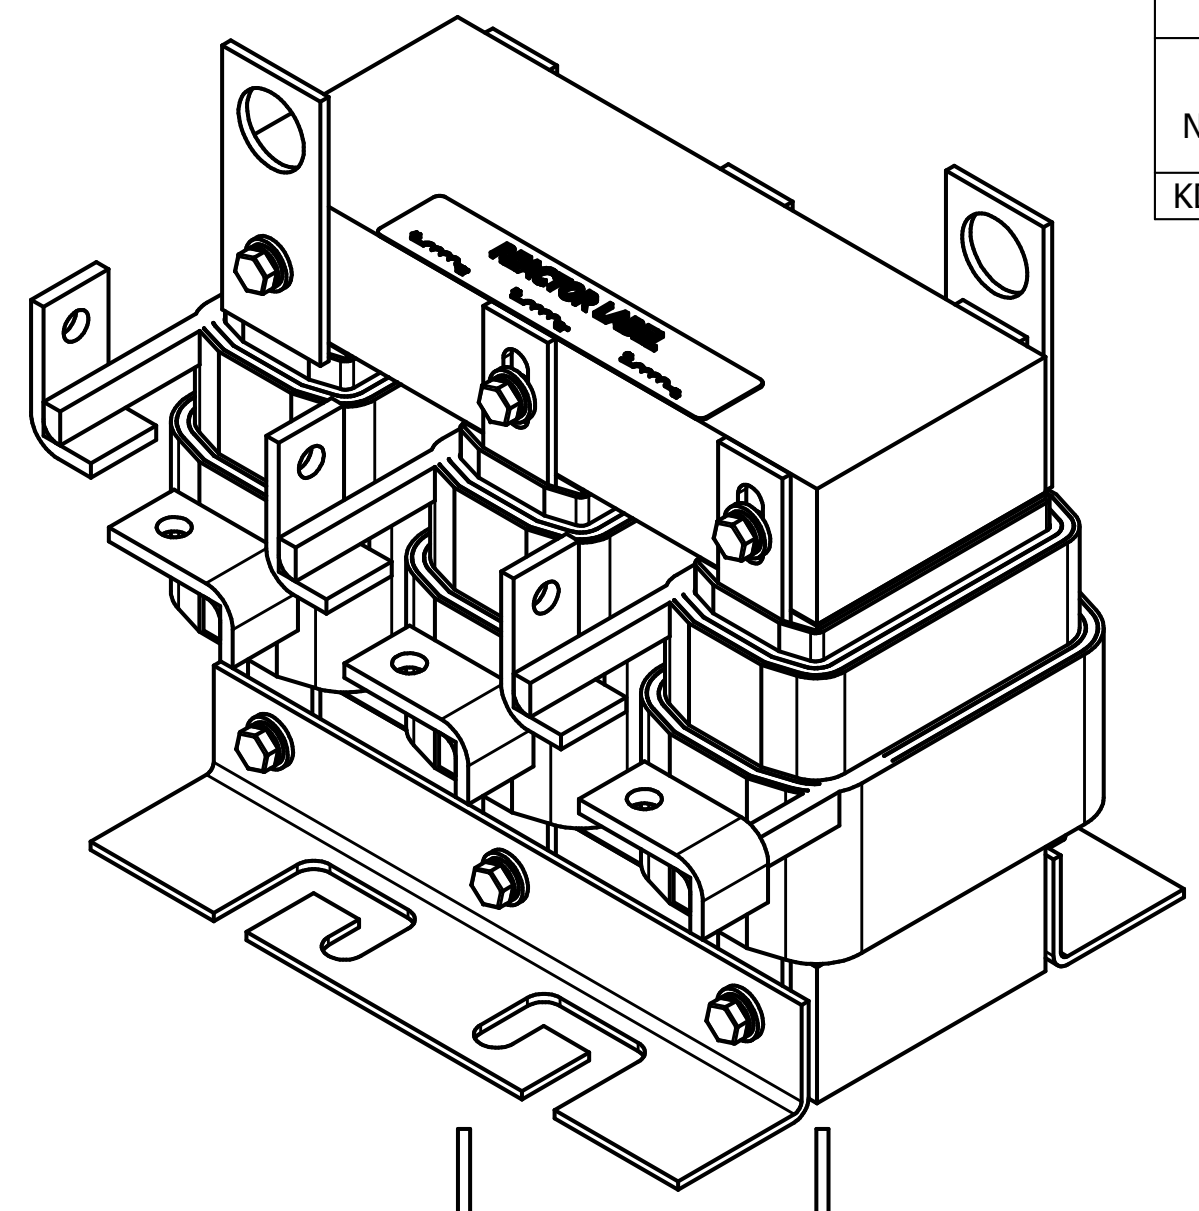


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRJ41H	200	192	192	250	70	466	SLK11	0.38

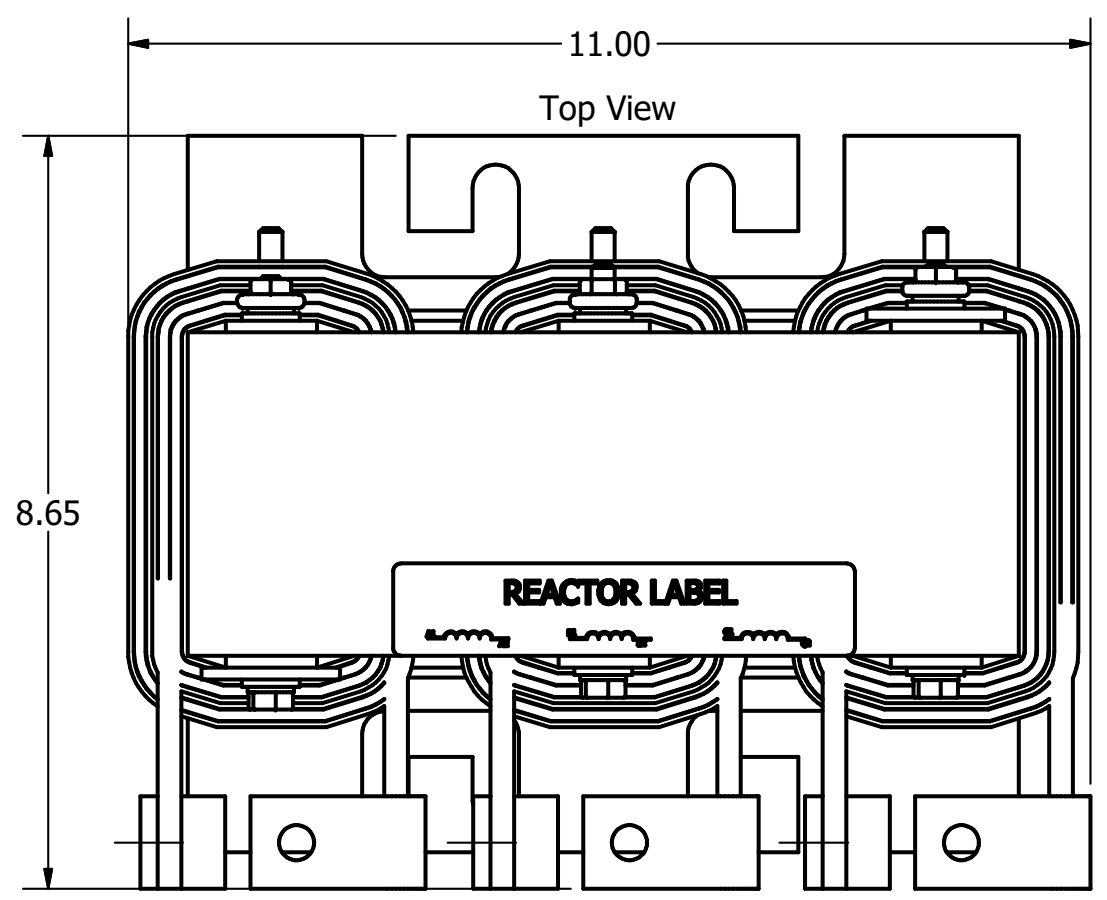

TCI (800) 824-8282 transcoil.com

KDRJL Drive Reactor
 KDR— Motor Amps —
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max
 40C Amb Max, 155C Rise, RoHS
 Manual #30895 LUG KIT #SLK—

UL LISTED CE
 3RD CONT. EQ. 1986

DATE CODE A1 A2 B1 B2 C1 C2

- Note:
1. UL file number: cULus Listed File E116124.
 2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
 4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)		TCI W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL		KDR J Frame, Copper Bus Reactor Drawing	
				XX ± .25		DRN BY DSW DATE: 2/28/18 107536DG	
				.XXX ± .10		SCALE: 1/2.2 APRVD: SIZE C SHT.3 OF 8	
				FRACTIONAL ± 1/16			
				ANGULAR ± 1°			
NO	REVISION	DATE	BY				