


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULL5H	450	515	540	59.7	138	774	SLK14
KDRULL6H	500	590	590	52.5	138	697	SLK14

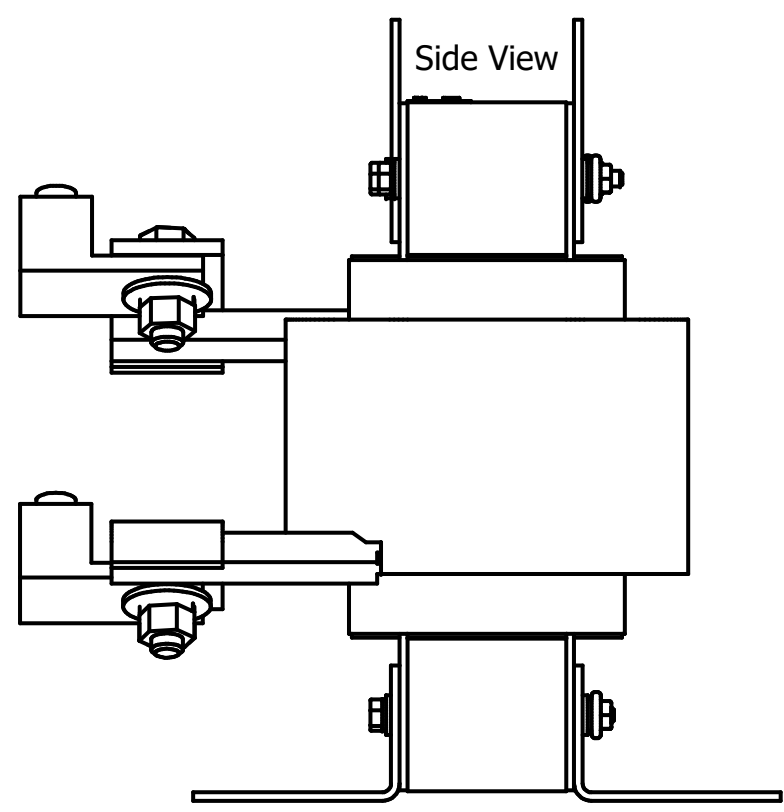

(Customer Connections) Markings On Coil For Reference Only.


**TGI** (800) 824-8282 transcoll.com

TGI, LLC  
 Germantown, WI, USA  
 transcoll.com  
 800-824-8282

KDRUL Drive Reactor  
 KDRUL— Motor Amps —  
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max  
 40C Amb Max, 155C Rise, RoHS  
 Term Torque— lb-in

UL LISTED  
 2ND CONF. NO. 15000

DATE CODE A1 A2 B1 B2 C1 C2

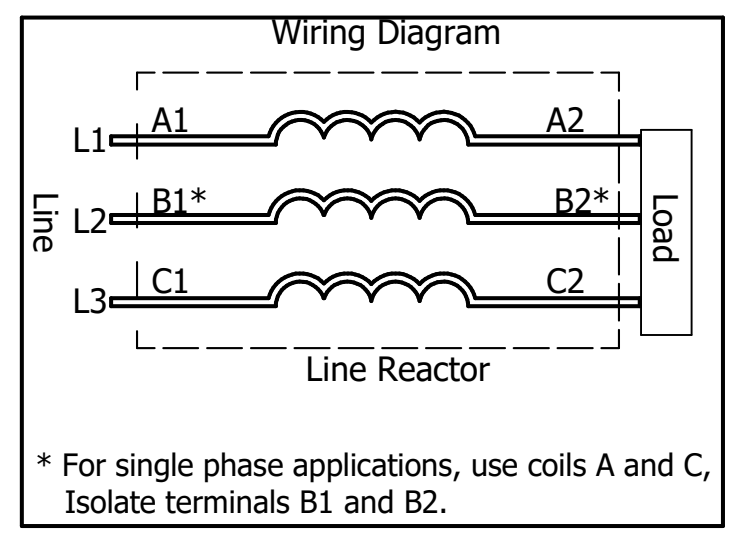

- Note:
1. UL file number: cULus Listed File E116124.
  2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
  4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
  5. Material(s) Shall be RoHS Compliant
  6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TGI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TGI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TGI.

A Combine Drawings		3/23/18	DSW	TOLERANCES (EXCEPT AS NOTED)		<b>TGI</b> W132 N10611 Grant Drive Germantown, WI 53022
NO REVISION		DATE	BY	DECIMAL	XX ± .25 .XXX ± .10	
				FRACTIONAL	± 1/16	KDRUL L Frame, Copper Bus Reactor Drawing
				ANGULAR	± 1°	

DRN BY: DSW DATE: 3/23/18 107537DG  
 SCALE: 1/3.2 APRVD: SIZE: C SHT.10 OF 10