

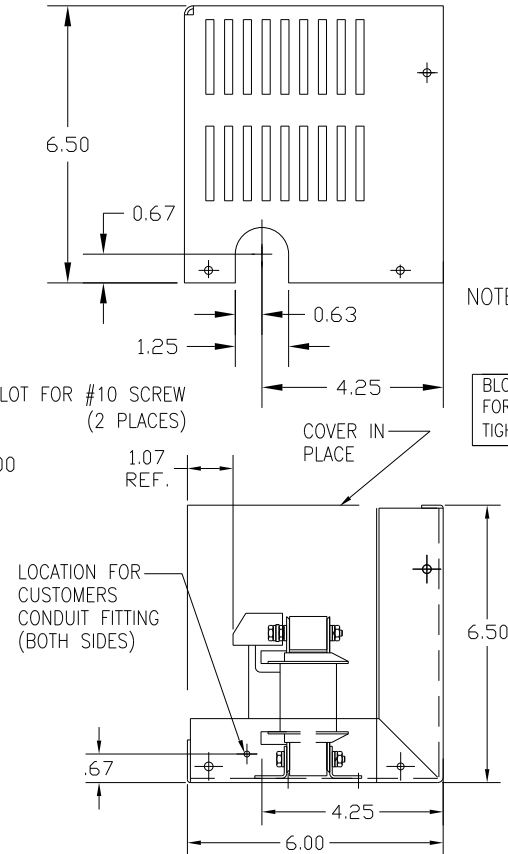
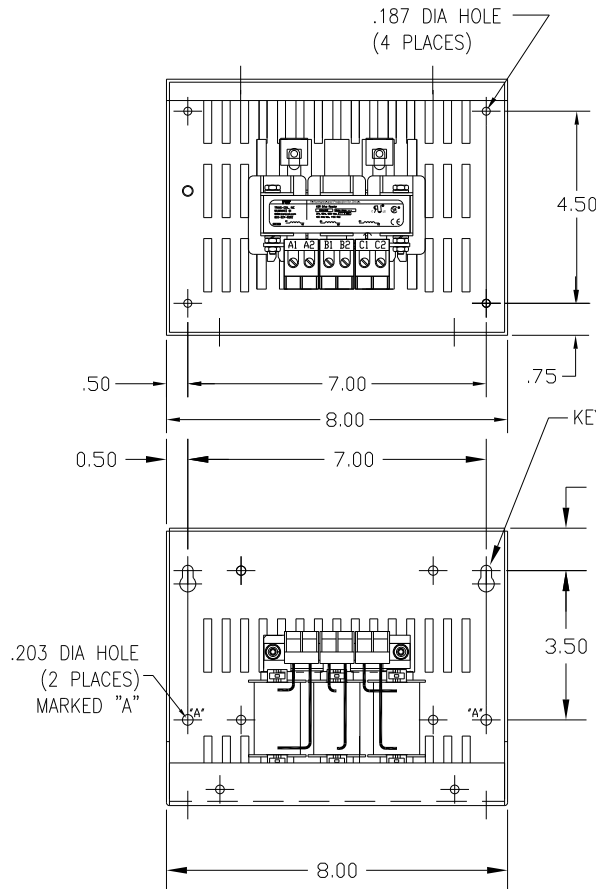
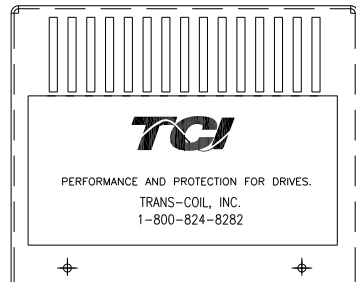


CATALOG NO	VOLTAGE	NEC MOTOR HP	NEC MOTOR CURRENT	WATTS LOSS	APPROX WT-LBS	TORQUE (LB-IN)
KDRA4LC1	480	7.5	11.0	40.0	8	10

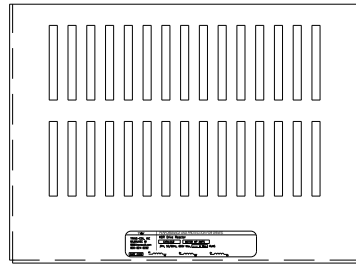

NOTE: A1, A2, B1, B2, C1, C2, MARKINGS ON TERMINAL BLOCK FOR REFERENCE ONLY.

BLOCK WIRE RANGE #12-#18 AWG FOR REACTOR AND TIGHTENING TORQUE. 10 LB-IN

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	DECIMAL	XX ± .03	.XXX ± .01	FRACTIONAL	± 1/32	ANGULAR	± 1/2°

7878 N. 86th STREET
MILWAUKEE, WI 53224

KDR DRIVE REACTOR
480V LOW Z, FRAME A

DRN. BY **DSW** DATE **1/25/12** DWG. NO. **KDRA4LC1DG**
SCALE APPRV. **B** SHT. 1 OF 1