
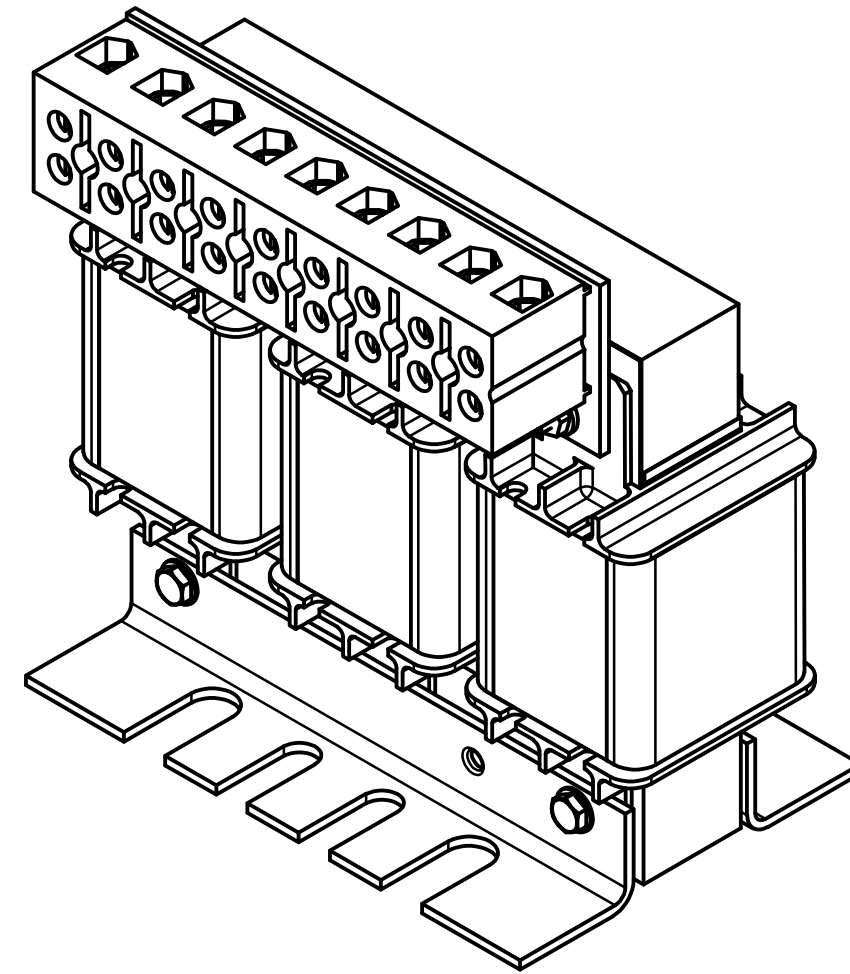


CATALOG NO	RATED AMPS(A)	MAX. AMPS(A)	APPROX WT-LBS
KDRC2TT	3.16	4.8	13

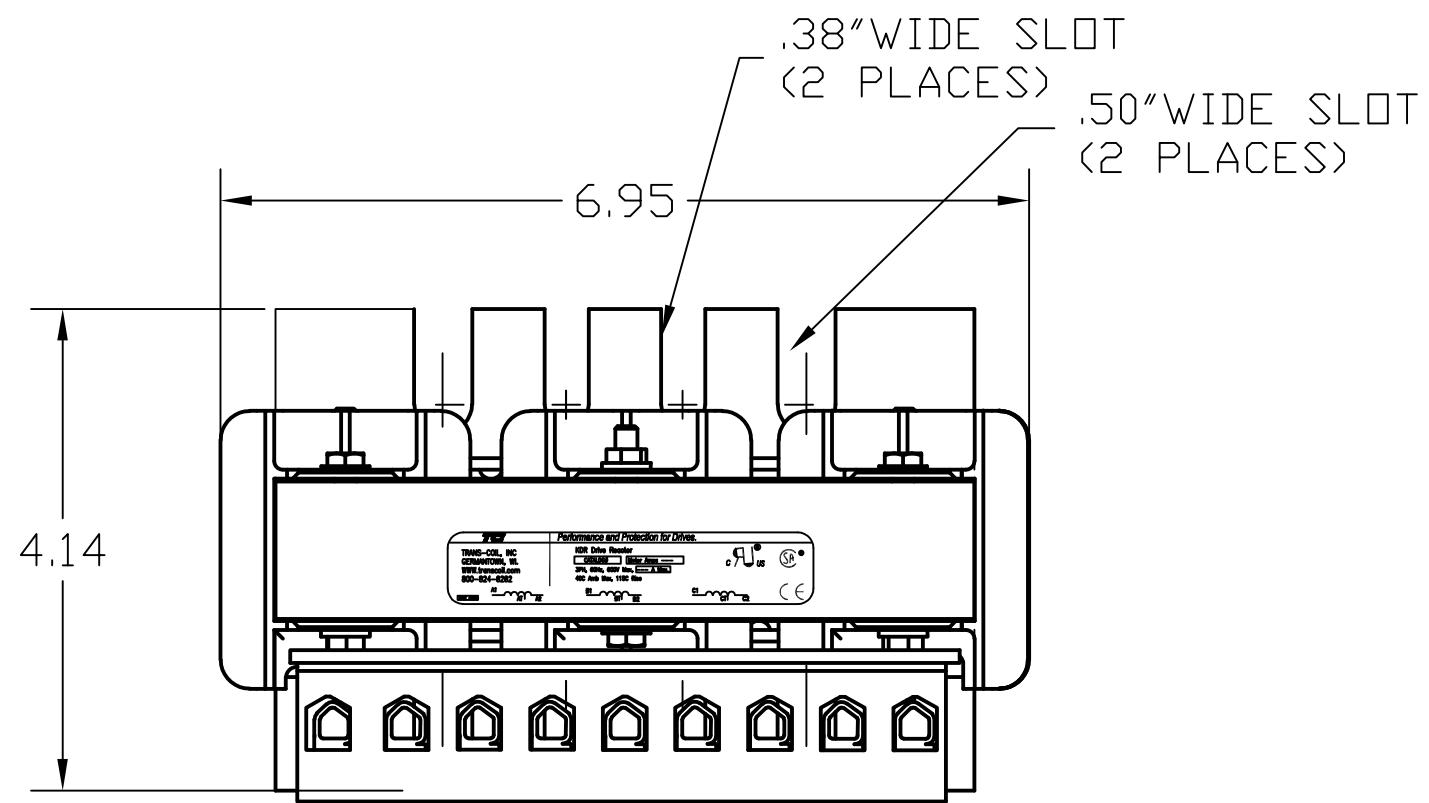

TCI Performance and Protection for Drives.

TRANS-COIL, INC
GERMANTOWN, WI.
WWW.transcoil.com
800-824-8282



KDR Drive Reactor
CATALOG Motor Amps ---
3PH, 60Hz, 600V Max, --- A Max.
40C Amb Max, 115C Rise

ISO 9000

A1 AT A2 B1 BT B2 C1 CT C2


UL US SF CE

A1 AT A2 B1 BT B2 C1 CT C2

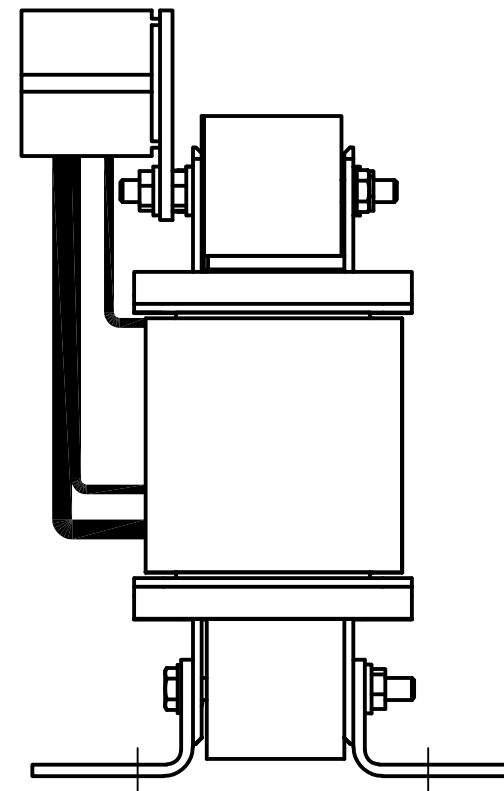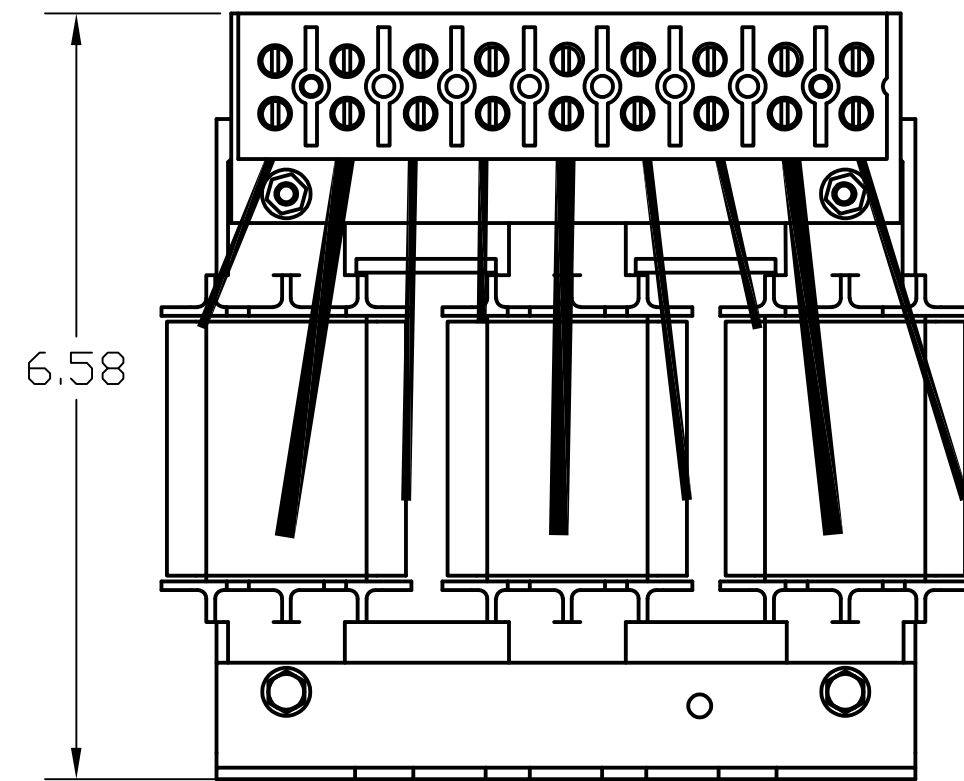


MARKINGS ON BLOCK FOR REF.

A1 AT A2 B1 BT B2 C1 CT C2

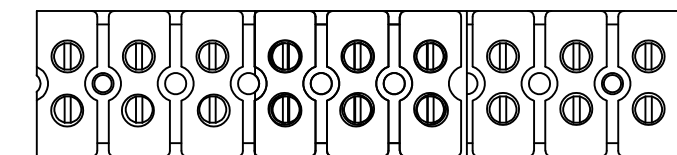

TERMINAL BLOCK
TORQUE
(LB-IN)

20

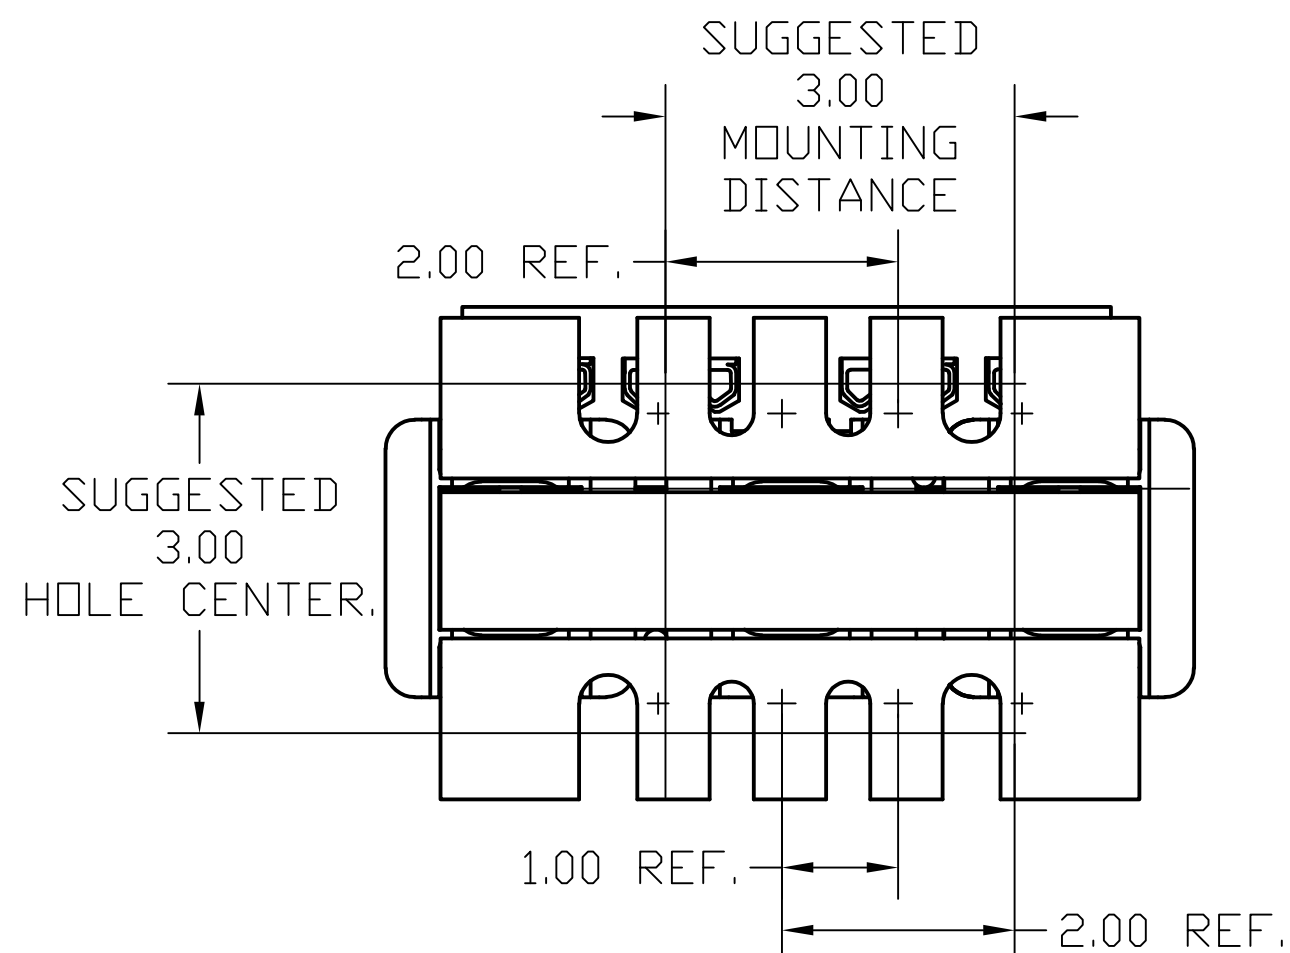

TOLERANCES (EXCEPT AS NOTED)				TCI W132 N10611 GRANT DRIVE GERMANTOWN, WI. 53022	
DECIMAL				KDRC2TT LINE REACTOR	
.XX ±.25					
.XXX±.1					
FRACTIONAL				DRN BY DSW DATE 2/25/16 DVG. NO. 106441DG	
± 1/16				SCALE TO FIT APRVD. DSW	
ANGULAR				SHT.1 OF1	
± 1°					
AS DESIGNED	2/25/16	DSW			
NO	REVISION	DATE	BY		